




# OIL ANALYSIS REPORT

Sample Rating Trend

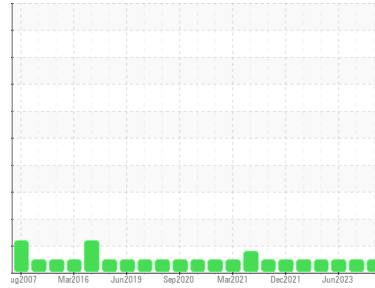

**NORMAL**



Area  
**System 71 - Main Power Generation**  
 Machine Id  
**Z-7101A Hydraulic Start Oil Train A**

Component  
**Hydraulic System**  
 Fluid  
**IRVING HYDRAULIC OIL LP 32 (290 LTR)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PP</b>	PP	PP
Sample Date	Client Info	<b>10 Dec 2023</b>	31 Aug 2023	02 Jun 2023
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

### WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m) >20	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185(m) >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m) >10	<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Aluminum	ppm	ASTM D5185(m) >10	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185(m) >20	<b>2</b>	6	<1
Copper	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m) >10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

### ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	0
Barium	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185(m)	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)	<b>0</b>	<1	<1
Calcium	ppm	ASTM D5185(m)	<b>38</b>	42	39
Phosphorus	ppm	ASTM D5185(m)	<b>185</b>	242	197
Zinc	ppm	ASTM D5185(m) 400	<b>150</b>	215	151
Sulfur	ppm	ASTM D5185(m)	<b>1967</b>	2074	2191
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

### CONTAMINANTS






method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m) >15	<b>&lt;1</b>	4	<1
Sodium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	1
Potassium	ppm	ASTM D5185(m) >20	<b>0</b>	<1	<1
Water	%	ASTM D6304* >0.05	<b>0.003</b>	0.001	0.003
ppm Water	ppm	ASTM D6304* >500	<b>34</b>	7.6	29.1

### FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>5000	<b>904</b>	340	86
Particles >6µm	ASTM D7647	>1300	<b>230</b>	55	47
Particles >14µm	ASTM D7647	>160	<b>18</b>	3	9
Particles >21µm	ASTM D7647	>40	<b>5</b>	1	3
Particles >38µm	ASTM D7647	>10	<b>1</b>	0	0
Particles >71µm	ASTM D7647	>3	<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>17/15/11</b>	16/13/9	14/13/10







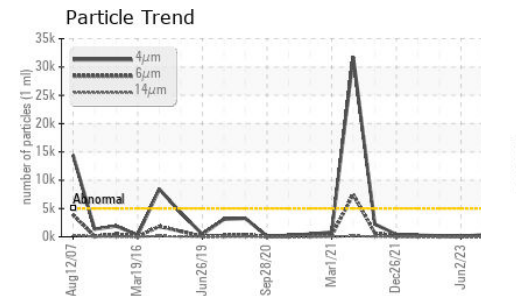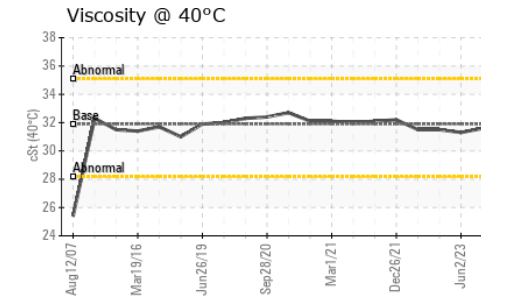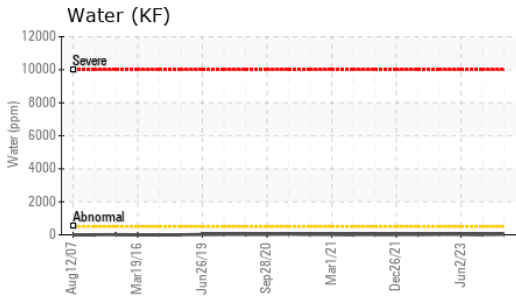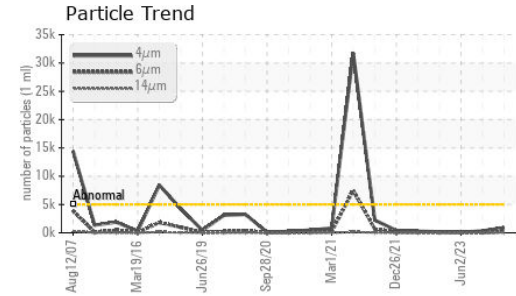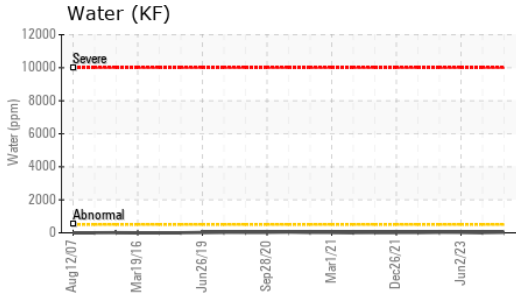

# OIL ANALYSIS REPORT








FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		<b>0.30</b>	0.37	0.28
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	31.9	<b>31.6</b>	31.6	31.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

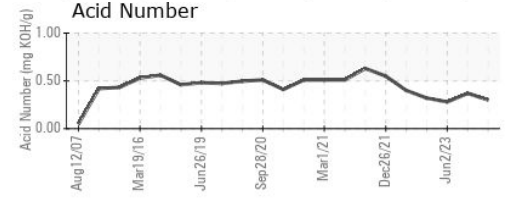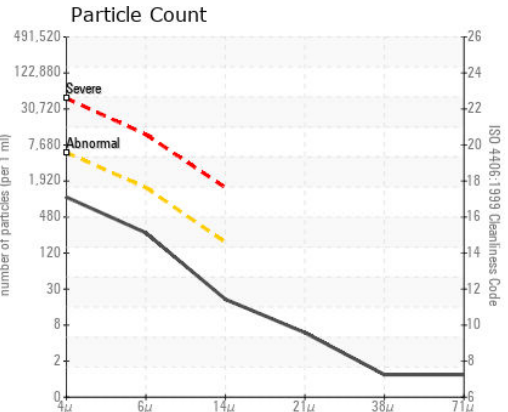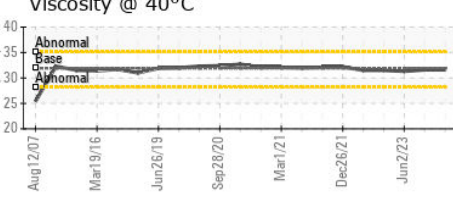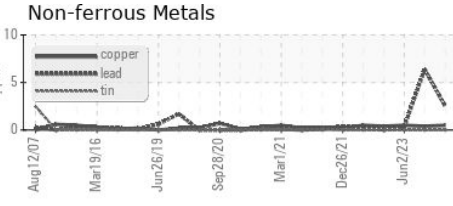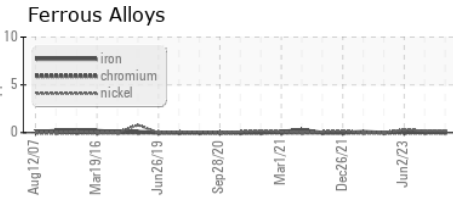

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **HIBERNIA MGMT & DEVELOPMENT CO. LTD**  
**Sample No.** : PP **Received** : 15 Dec 2023 **SUITE 1000,, 100 NEW GOWER STREET**  
**Lab Number** : **02603497** **Diagnosed** : 18 Dec 2023 **ST.JOHN'S, NL**  
**Unique Number** : 5696582 **Diagnostician** : Wes Davis **CA A1C 6K3**  
**Test Package** : MAR 2 ( Additional Tests: KF )  
 To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.