




# PROBLEM SUMMARY


Sample Rating Trend

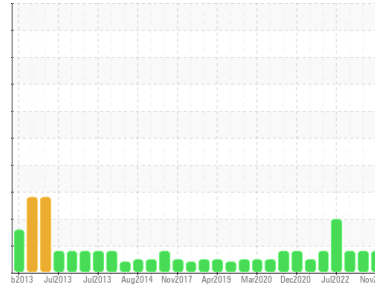

Area  
**(ZONE3) BRUCE A/2/33310**  
 Machine Id  
**2-33310-P2-Tank Vent**  
 Component  
**Bulk Fluid Tank**  
 Fluid  
**MOBIL DTE 732 (--- GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Non-ferrous Metals

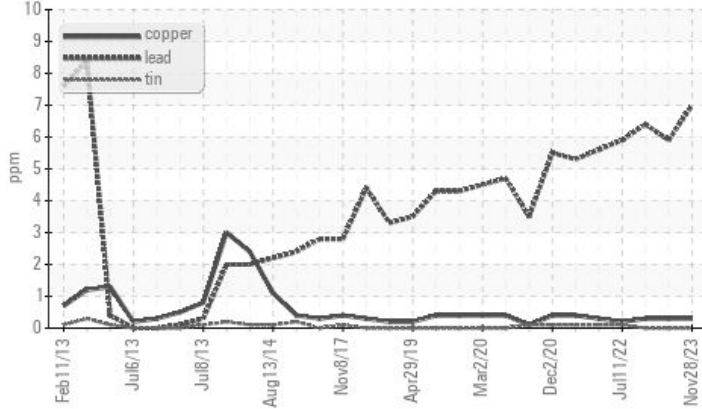

## RECOMMENDATION

We recommend an early resample to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status		<b>ABNORMAL</b>	ABNORMAL	ABNORMAL		
Lead	ppm	ASTM D5185(m)	>5	▲ 7	▲ 6	▲ 6

Customer Id: BRUTIV  
 Sample No.: WC0871712  
 Lab Number: 02603831  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Kevin Marson +1 (289)291-4644 x4644  
[Kevin.Marson@wearcheck.com](mailto:Kevin.Marson@wearcheck.com)

To change component or sample information:  
 Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	---	---	?	We recommend an early resample to monitor this condition.

## HISTORICAL DIAGNOSIS

### 22 Jun 2023 Diag: Kevin Marson

#### WEAR



We recommend an early resample to monitor this condition. Lead ppm levels are abnormal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid.

[view report](#)



### 16 Jan 2023 Diag: Bill Quesnel

#### WEAR



We recommend an early resample to monitor this condition. Lead ppm levels are abnormal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The Rotating Pressure Vessel Oxidation Test (RPVOT – ASTM D2272) result indicates suitable amounts of anti-oxidant(s) present in the oil.

[view report](#)



### 11 Jul 2022 Diag: Kevin Marson

#### WEAR



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Lead ppm levels are abnormal. There is a light amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The AN level is acceptable for this fluid.


[view report](#)





# OIL ANALYSIS REPORT

Sample Rating Trend

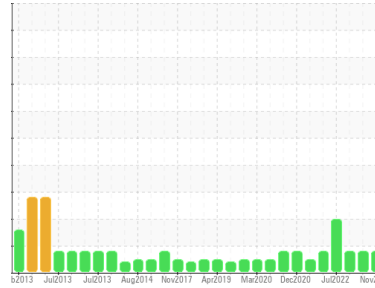

Area  
**(ZONE3) BRUCE A/2/33310**  
 Machine Id  
**2-33310-P2-Tank Vent**  
 Component  
**Bulk Fluid Tank**  
 Fluid  
**MOBIL DTE 732 (--- GAL)**

## DIAGNOSIS

- Recommendation**  
We recommend an early resample to monitor this condition.
- Wear**  
Lead ppm levels are abnormal.
- Contamination**  
The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.
- Fluid Condition**  
The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0871712</b>	WC0801488	WC0718962
Sample Date	Client Info		<b>28 Nov 2023</b>	22 Jun 2023	16 Jan 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>10	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Titanium	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>5	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185(m)	>5	<b>▲ 7</b>	▲ 6	▲ 6
Copper	ppm	ASTM D5185(m)	>5	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	0
Barium	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185(m)		<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Calcium	ppm	ASTM D5185(m)		<b>&lt;1</b>	1	0
Phosphorus	ppm	ASTM D5185(m)		<b>&lt;1</b>	1	0
Zinc	ppm	ASTM D5185(m)		<b>&lt;1</b>	2	1
Sulfur	ppm	ASTM D5185(m)		<b>1106</b>	1106	1300
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

## CONTAMINANTS






	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>5	<b>3</b>	3	3
Sodium	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	1	<1
Water	%	ASTM D6304*	>0.005	<b>0.003</b>	0.001	0.00
ppm Water	ppm	ASTM D6304*	>50	<b>26</b>	9.7	0.00

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>384</b>	3499	1435
Particles >6µm	ASTM D7647	>1300	<b>77</b>	805	267
Particles >14µm	ASTM D7647	>320	<b>4</b>	46	17
Particles >21µm	ASTM D7647	>80	<b>2</b>	10	5
Particles >38µm	ASTM D7647	>20	<b>0</b>	0	1
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/15	<b>16/13/9</b>	19/17/13	18/15/11



# OIL ANALYSIS REPORT

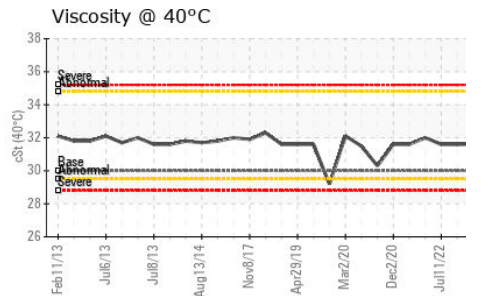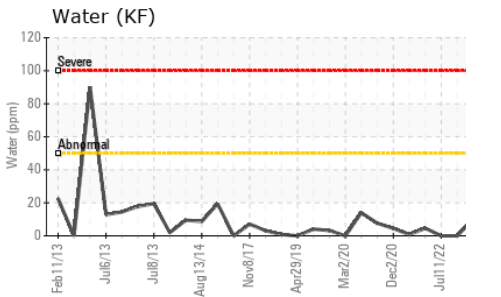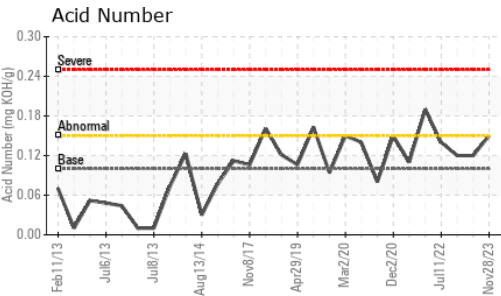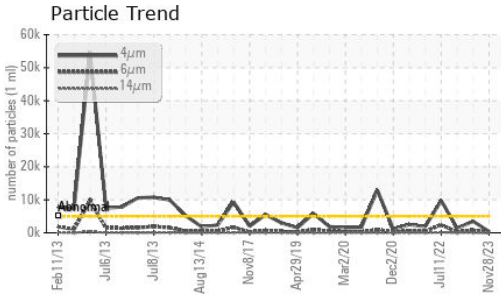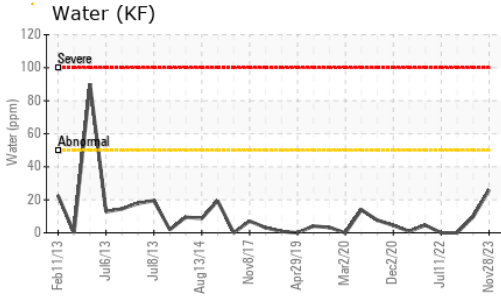


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.10	<b>0.15</b>	0.12	0.12






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.005	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	30.0	<b>31.7</b>	31.6	31.6

## SAMPLE IMAGES

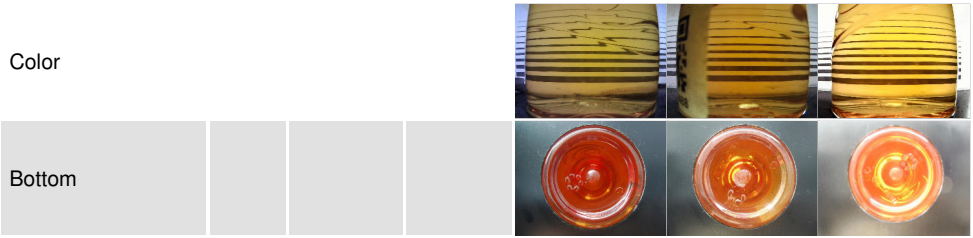

## GRAPHS

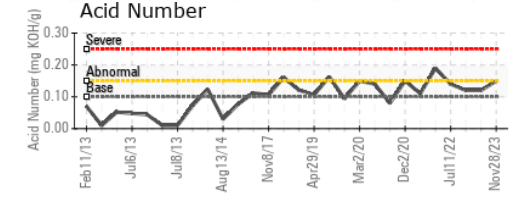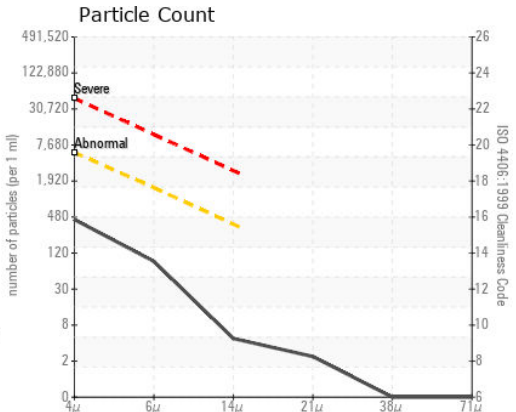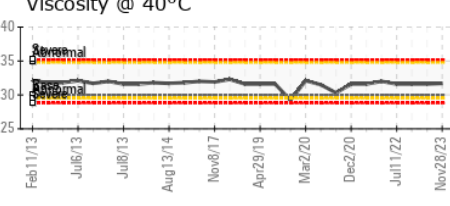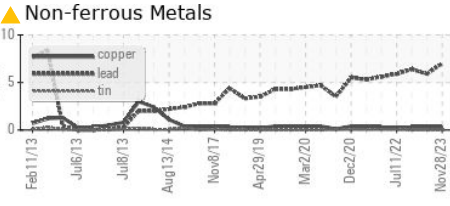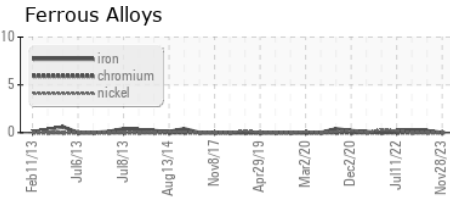

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0871712 **Received** : 18 Dec 2023  
**Lab Number** : 02603831 **Diagnosed** : 20 Dec 2023  
**Unique Number** : 5696916 **Diagnostician** : Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: TAN Man )

**Bruce Power - Bruce A PdM**  
 P.O.Box 1540, 177 Tie Road., RM-222 U2 Column 2N11 615  
 Tiverton, ON  
 CA N0G 2T0  
 Contact: Pierre Adouki  
 pierre.adouki@brucepower.com  
 T: (519)361-2673  
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.