




# OIL ANALYSIS REPORT

Sample Rating Trend

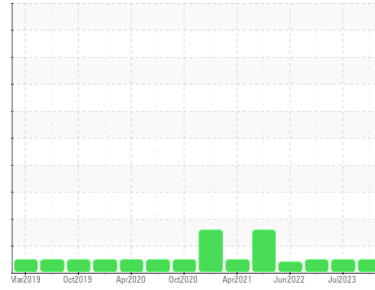

**NORMAL**



Machine Id  
**FORCED DRAFT FAN F1 - outboard bearing (S/N 1-32300-F1)**

Component  
**Outboard Bearing**

Fluid  
**ESSO TERESSO ISO 68 (--- LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.  
NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0861494</b>	WC0803242	WC0745437
Sample Date	Client Info		<b>10 Oct 2023</b>	20 Jul 2023	08 Mar 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185(m) >20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m) >20	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	<1
Copper	ppm	ASTM D5185(m) >20	<b>1</b>	2	2
Tin	ppm	ASTM D5185(m) >20	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185(m)	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES


	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 4.5	<b>&lt;1</b>	0	<1
Barium	ppm	ASTM D5185(m) 0.4	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m) 0	<b>0</b>	<1	0
Calcium	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	3	<1
Phosphorus	ppm	ASTM D5185(m) 0.7	<b>6</b>	16	21
Zinc	ppm	ASTM D5185(m) 0	<b>4</b>	11	12
Sulfur	ppm	ASTM D5185(m) 1315	<b>4938</b>	4927	5389
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	<b>9</b>	5	5
Sodium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Potassium	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304* >2	<b>0.005</b>	---	---
ppm Water	ppm	ASTM D6304*	<b>52</b>	---	---




# OIL ANALYSIS REPORT

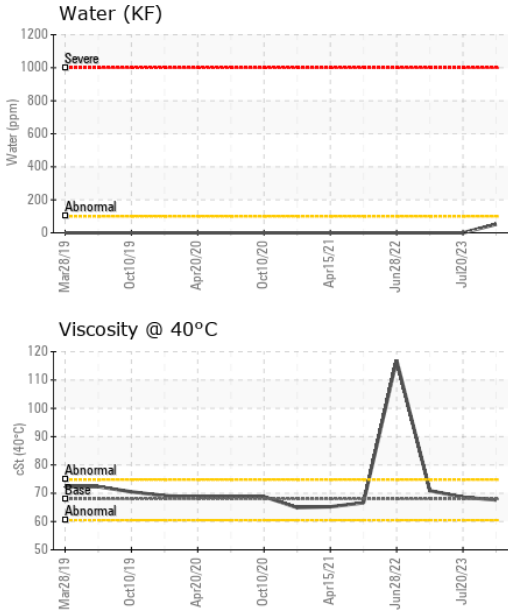


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68	67.6	68.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

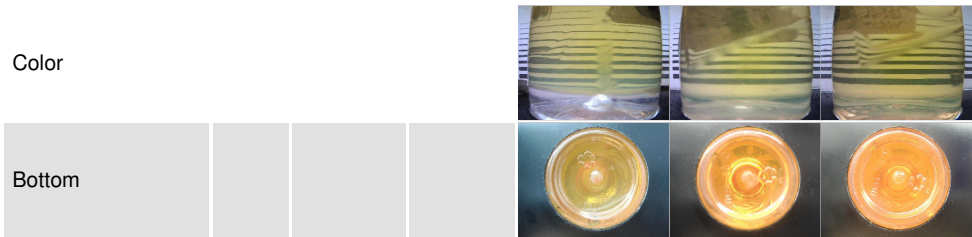

## GRAPHS

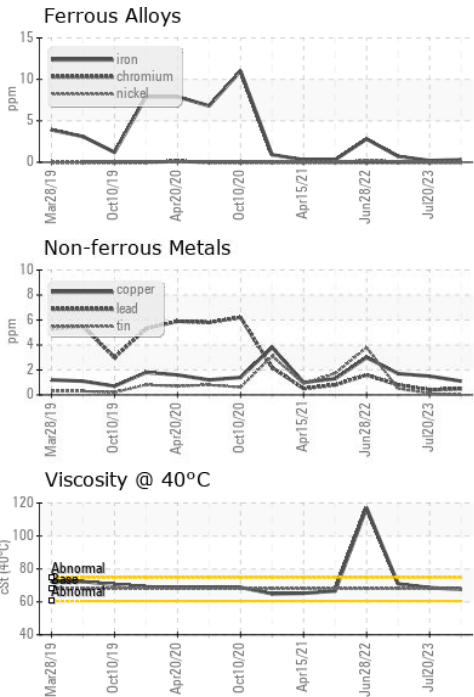

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0861494 **Recieved** : 19 Dec 2023  
**Lab Number** : 02604155 **Diagnosed** : 20 Dec 2023  
**Unique Number** : 5697240 **Diagnostician** : Kevin Marson  
**Test Package** : IND 1 ( Additional Tests: KF )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**Ontario Power Generation**  
 ATIKOKAN T.G.S., BOX 1900  
 ATIKOKAN, ON  
 CA P0T 1C0  
 Contact: Dale Anthony  
 dale.anthony@opg.com  
 T:  
 F: (807)597-1198