



# FUEL REPORT

Sample Rating Trend

ISO



Area  
**VANTAGE QC-61 [331084]**

Machine Id  
**A-I-E1**

Component  
**Diesel Fuel**

Fluid  
**No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)**



## DIAGNOSIS

### Recommendation

Laboratory test indicate that this fuel is suitable for use and meets all test requirements. We advise that you filter this fluid before use. We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

### Contaminants

There is a moderate amount of silt (particulates < 14 microns in size) present in the fuel. The water content is negligible.

### Fuel Condition

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B). The fuel is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

## SAMPLE INFORMATION

| method        | limit/base      | current            | history1 | history2 |
|---------------|-----------------|--------------------|----------|----------|
| Sample Number | Client Info     | <b>CU0022036</b>   | ---      | ---      |
| Sample Date   | Client Info     | <b>18 Dec 2023</b> | ---      | ---      |
| Machine Age   | hrs Client Info | <b>70</b>          | ---      | ---      |
| Sample Status |                 | <b>ABNORMAL</b>    | ---      | ---      |

## PHYSICAL PROPERTIES

| method                     | limit/base          | current | history1     | history2 |
|----------------------------|---------------------|---------|--------------|----------|
| Specific Gravity           | ASTM D1298*         | 0.839   | <b>0.822</b> | ---      |
| Fuel Color                 | text Visual Screen* | Yllow   | <b>Pink</b>  | ---      |
| Visc @ 40°C                | cSt ASTM D7279(m)   | 3.0     | <b>1.9</b>   | ---      |
| Pensky-Martens Flash Point | °C ASTM D7215*      | 52      | <b>49.4</b>  | ---      |

## SULFUR CONTENT

| method | limit/base        | current | history1 | history2 |
|--------|-------------------|---------|----------|----------|
| Sulfur | ppm ASTM D5185(m) | 10      | <b>8</b> | ---      |

## DISTILLATION

| method                 | limit/base     | current | history1   | history2 |
|------------------------|----------------|---------|------------|----------|
| Initial Boiling Point  | °C ASTM D2887* | 165     | <b>157</b> | ---      |
| 5% Distillation Point  | °C ASTM D2887* |         | <b>176</b> | ---      |
| 10% Distill Point      | °C ASTM D2887* | 201     | <b>183</b> | ---      |
| 15% Distillation Point | °C ASTM D2887* |         | <b>189</b> | ---      |
| 20% Distill Point      | °C ASTM D2887* | 216     | <b>196</b> | ---      |
| 30% Distill Point      | °C ASTM D2887* | 230     | <b>209</b> | ---      |
| 40% Distill Point      | °C ASTM D2887* | 243     | <b>222</b> | ---      |
| 50% Distill Point      | °C ASTM D2887* | 255     | <b>235</b> | ---      |
| 60% Distill Point      | °C ASTM D2887* | 267     | <b>249</b> | ---      |
| 70% Distill Point      | °C ASTM D2887* | 280     | <b>264</b> | ---      |
| 80% Distill Point      | °C ASTM D2887* | 295     | <b>281</b> | ---      |
| 85% Distillation Point | °C ASTM D2887* |         | <b>294</b> | ---      |
| 90% Distill Point      | °C ASTM D2887* | 310     | <b>307</b> | ---      |
| 95% Distillation Point | °C ASTM D2887* |         | <b>329</b> | ---      |
| Final Boiling Point    | °C ASTM D2887* | 341     | <b>363</b> | ---      |

## IGNITION QUALITY

| method       | limit/base  | current | history1  | history2 |
|--------------|-------------|---------|-----------|----------|
| API Gravity  | ASTM D1298* | 37.7    | <b>40</b> | ---      |
| Cetane Index | ASTM D4737* | <40.0   | <b>48</b> | ---      |

## CONTAMINANTS






| method    | limit/base        | current | history1     | history2 |
|-----------|-------------------|---------|--------------|----------|
| Silicon   | ppm ASTM D5185(m) | <1.0    | <b>&lt;1</b> | ---      |
| Sodium    | ppm ASTM D5185(m) | <0.1    | <b>0</b>     | ---      |
| Potassium | ppm ASTM D5185(m) | <0.1    | <b>&lt;1</b> | ---      |
| Water     | % ASTM D6304*     | <0.05   | <b>0.003</b> | ---      |
| ppm Water | ppm ASTM D6304*   | <500    | <b>30</b>    | ---      |

## FLUID CLEANLINESS

| method          | limit/base   | current   | history1        | history2 |
|-----------------|--------------|-----------|-----------------|----------|
| Particles >4µm  | ASTM D7647   | >2500     | <b>4439</b>     | ---      |
| Particles >6µm  | ASTM D7647   | >640      | <b>2265</b>     | ---      |
| Particles >14µm | ASTM D7647   | >80       | <b>130</b>      | ---      |
| Particles >21µm | ASTM D7647   | >20       | <b>10</b>       | ---      |
| Particles >38µm | ASTM D7647   | >4        | <b>1</b>        | ---      |
| Particles >71µm | ASTM D7647   | >3        | <b>0</b>        | ---      |
| Oil Cleanliness | ISO 4406 (c) | >18/16/13 | <b>19/18/14</b> | ---      |






# FUEL REPORT

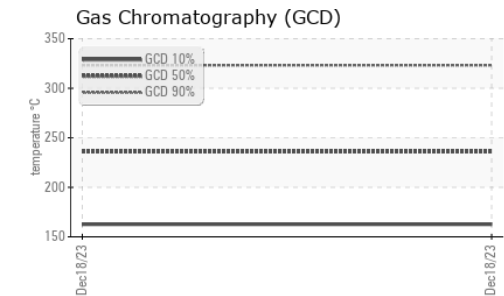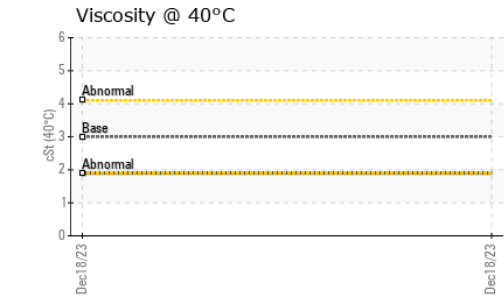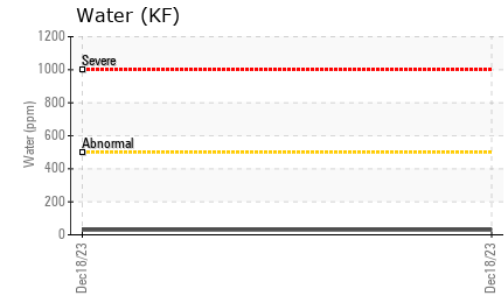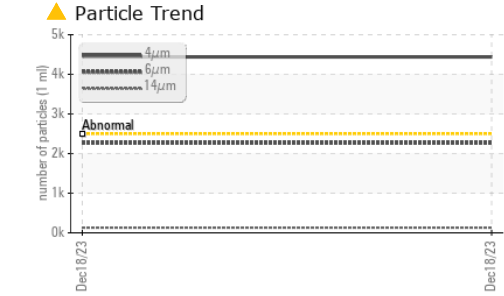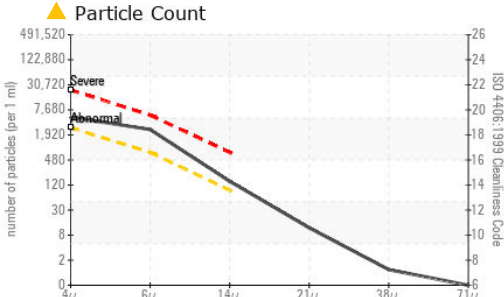

| HEAVY METALS | method | limit/base    | current | history1 | history2 |
|--------------|--------|---------------|---------|----------|----------|
| Aluminum     | ppm    | ASTM D5185(m) | <0.1    | 0        | ---      |
| Nickel       | ppm    | ASTM D5185(m) | <0.1    | 0        | ---      |
| Lead         | ppm    | ASTM D5185(m) | <0.1    | 0        | ---      |
| Vanadium     | ppm    | ASTM D5185(m) | <0.1    | 0        | ---      |
| Iron         | ppm    | ASTM D5185(m) | <0.1    | <1       | ---      |
| Calcium      | ppm    | ASTM D5185(m) | <0.1    | 0        | ---      |
| Magnesium    | ppm    | ASTM D5185(m) | <0.1    | 0        | ---      |
| Phosphorus   | ppm    | ASTM D5185(m) | <0.1    | <1       | ---      |
| Zinc         | ppm    | ASTM D5185(m) | <0.1    | 0        | ---      |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
| Color         |        |            |         | no image | no image |
| Bottom        |        |            |         | no image | no image |

## GRAPHS

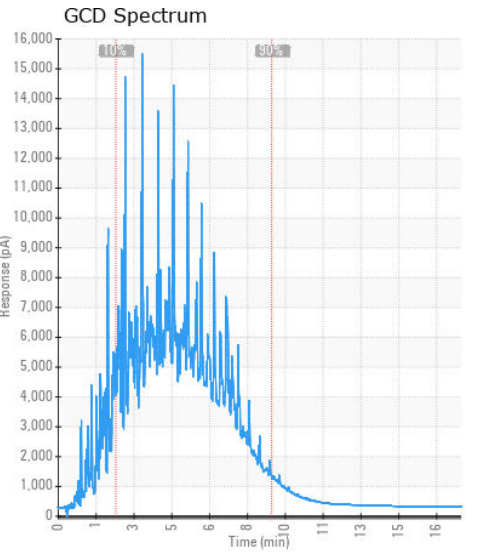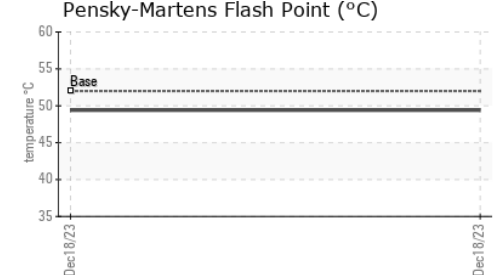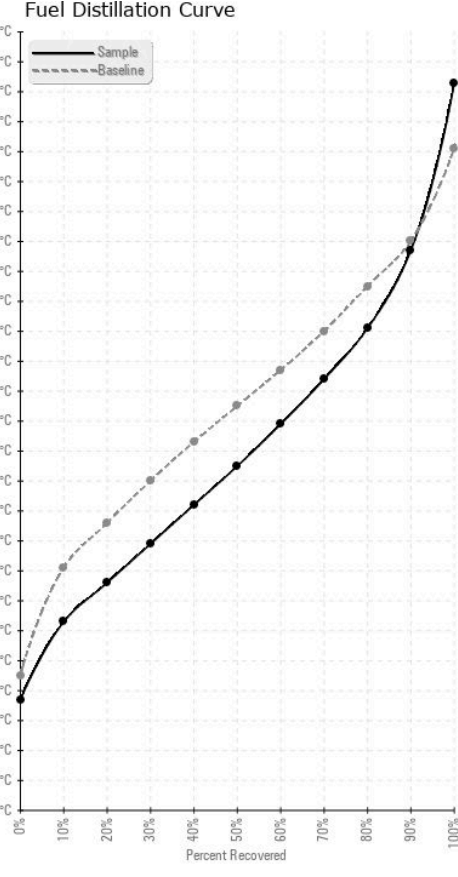

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : CU0022036 **Received** : 20 Dec 2023  
**Lab Number** : 02604533 **Tested** : 22 Dec 2023  
**Unique Number** : 5697618 **Diagnosed** : 22 Dec 2023 - Kevin Marson  
**Test Package** : FUEL ( Additional Tests: CC Flash, GC-PercFuel, PrtCount )

**CUMMINS EASTERN CANADA LP**  
 315 AV LIBERTE  
 CANDIAC, QC  
 CA J5R 6Z7  
 Contact: Thomas Owens  
 is275@cummins.com  
 T: (450)638-6863  
 F: (450)638-1202

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.