




# OIL ANALYSIS REPORT

## Sample Rating Trend

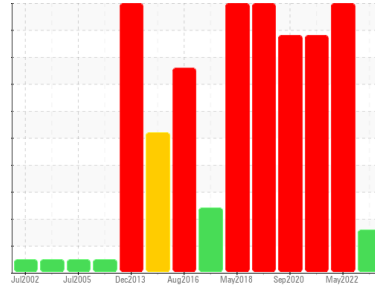

**OFF SPEC**



Area  
**[02437560]**

Machine Id  
**A10 - Thrust Bearing**

Component  
**Thrust Bearing**

Fluid  
**PETRO CANADA TURBOFLO R&O 46 (750 LTR)**

### DIAGNOSIS

#### Recommendation

We recommend that you perform vacuum distillation and/or air drying to attempt to remove any residual water and/or entrained gases from this oil that may be contributing to abnormal foaming and/or poor water separability. We recommend an early resample to monitor this condition.

#### Wear

All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system.

#### Contaminants

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

#### Oil Condition

Foaming Tendency stage I (ASTM D892) result is abnormal indicating a tendency for oil foaming. Rust Prevention test (ASTM D665) indicates the oil retains good anti-corrosion properties. The AN level is acceptable for this fluid.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0844627</b>	WC0679963	WC
Sample Date	Client Info		<b>19 Sep 2023</b>	03 May 2022	28 Jun 2021
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	SEVERE	SEVERE

### WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	0	0
Iron	ppm	ASTM D5185(m) >85	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185(m) >20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m) >40	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185(m) >60	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185(m) >7	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m) >40	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185(m)	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<b>0</b>	<1	<1
Barium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	<1
Calcium	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	0	<1
Phosphorus	ppm	ASTM D5185(m) 3	<b>2</b>	1	2
Zinc	ppm	ASTM D5185(m) 0	<b>1</b>	<1	<1
Sulfur	ppm	ASTM D5185(m)	<b>430</b>	487	505
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	1	1
Sodium	ppm	ASTM D5185(m)	<b>0</b>	<1	0
Potassium	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	<1
Water	%	ASTM D6304* >2	<b>0.001</b>	0.001	0.001
ppm Water	ppm	ASTM D6304*	<b>5</b>	1.3	4.7

### INFRA-RED






	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*	<b>1.9</b>	2.2	2.2
Sulfation	Abs/.1mm	ASTM D7415*	<b>11.3</b>	12.3	12.0

Particle Filter (Magn: 200 x)





# OIL ANALYSIS REPORT

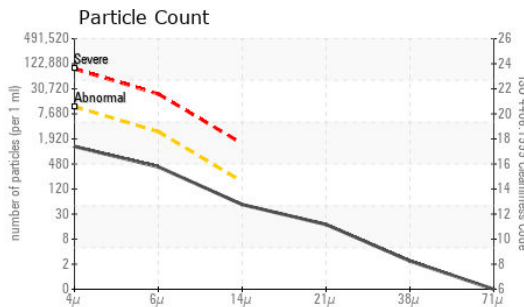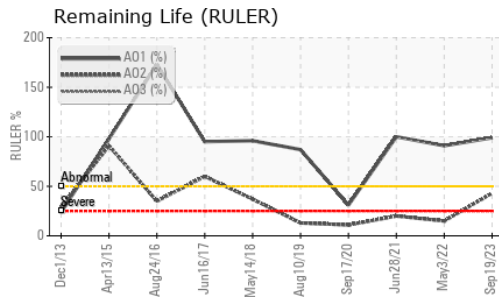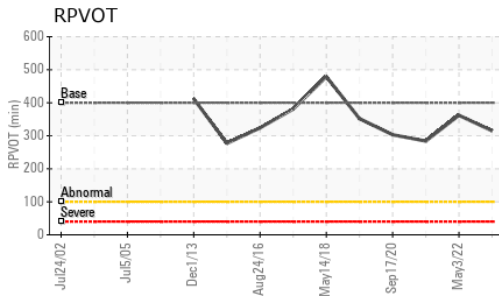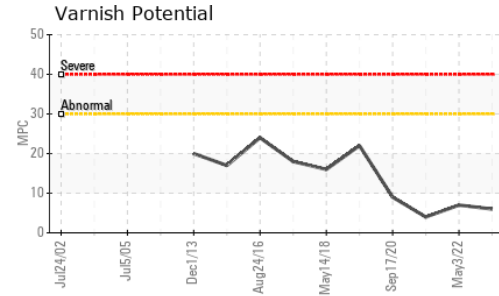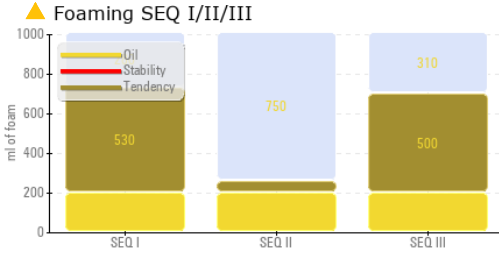

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>1111</b>	1909	697
Particles >6µm	ASTM D7647	>2500	<b>360</b>	492	89
Particles >14µm	ASTM D7647	>160	<b>45</b>	38	6
Particles >21µm	ASTM D7647	>40	<b>15</b>	7	2
Particles >38µm	ASTM D7647	>10	<b>2</b>	0	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	<b>17/16/13</b>	18/16/12	17/14/10

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm ASTM D7414*		<b>2.8</b>	3.5	3.4
Acid Number (AN)	mg KOH/g ASTM D974*	0.12	<b>0.12</b>	0.09	0.09
Anti-Oxidant 1	% ASTM D6971*	<25	<b>99</b>	91	100
Anti-Oxidant 2	% ASTM D6971*	<25	<b>43</b>	▲ 15	▲ 20
MPC Varnish Potential	Scale ASTM D7843(m)*	>15	<b>6</b>	7	4

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar Visual*	>2	<b>NEG</b>	NEG	NEG
Free Water	scalar Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	44.4	<b>46.2</b>	46.8	46.7
Visc @ 100°C	cSt ASTM D7279(m)	6.72	<b>6.8</b>	6.9	6.7
Viscosity Index (VI)	Scale ASTM D2270*	104	<b>100</b>	102	94
Separability	oil/h2o/lem ASTM D1401*	41/39/0	<b>42/38/0 (20)</b>	42/38/0 (25)	▲ 42/38/0 (25)
Air Release Time	min ASTM D3427*	3.5	<b>7.00</b>	8.00	7.90
Foam Tendency	I/II/III ASTM D892*	10	▲ <b>530/60/500</b>	▲ 530/100/530	▲ 560/90/530
Foam Stability	I/II/III ASTM D892*	0	<b>0/0/0</b>	130/0/130	70/0/0
ASTM Color	scalar ASTM D1500*	0.5	<b>&lt;3.5</b>	<4.0	<3.5
Rust Prevention	PASS/FAIL ASTM D665*	PASS	<b>PASS</b>	PASS	PASS
Oxidation Test (RPVOT)	minutes ASTM D2272*	400	<b>315</b>	362	284


SEDIMENT	method	limit/base	current	history1	history2
Pentane Insolubles	% ASTM D893(m)*		<b>0.150</b>	0.177	0.125
Toluene Insolubles	% ASTM D893(m)*		<b>0.003</b>	0.024	0.084






**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0844627  
**Lab Number** : **02604629**  
**Unique Number** : 5697714  
**Test Package** : AOM 3 ( Additional Tests: BottomAnalysis, FilterPatch, PrtFilter, Tollnsol )

**Nalcor Energy - Churchill Falls**  
 PO Box 310  
 Churchill Falls, NL  
 CA A0R 1A0  
 Contact: Robert Noel  
 robertnoel@nlh.nl.ca  
 T: (709)925-8294  
 F: (709)925-8220

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

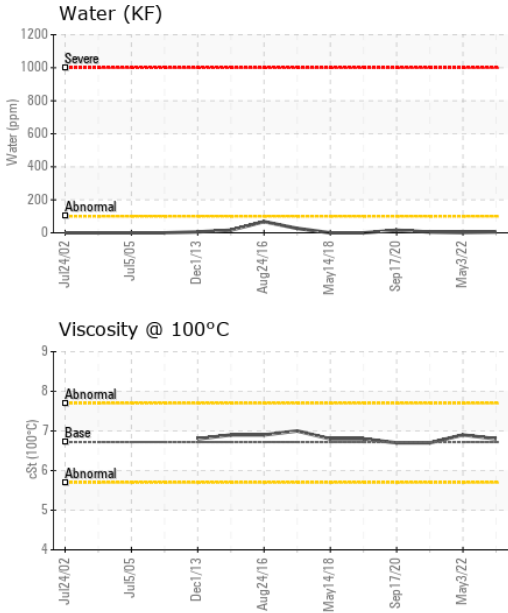

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					
PrtFilter					
MPC					

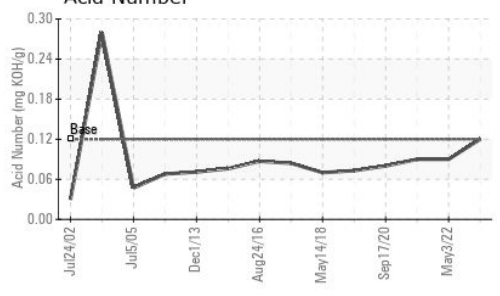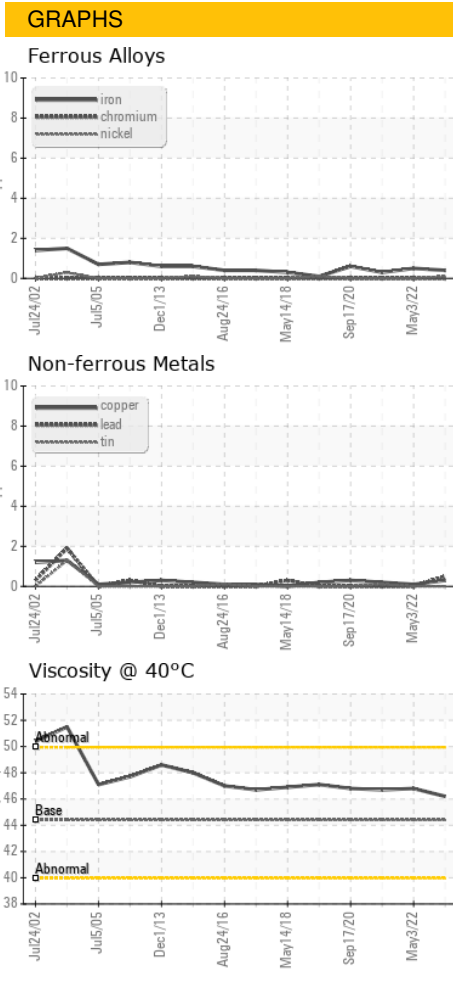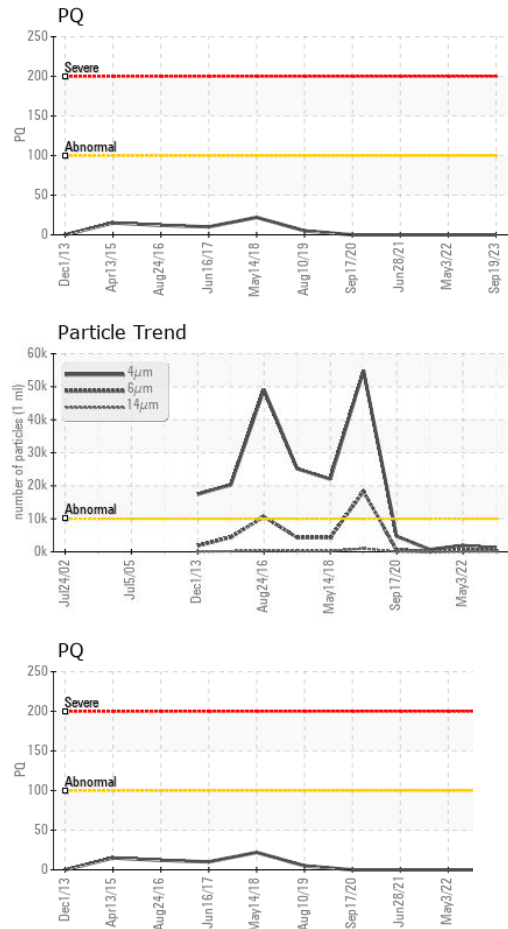

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0844627  
**Lab Number** : 02604629  
**Unique Number** : 5697714  
**Test Package** : AOM 3 ( Additional Tests: BottomAnalysis, FilterPatch, PrtFilter, Tollnsol )


**Nalcor Energy - Churchill Falls**  
 PO Box 310  
 Churchill Falls, NL  
 CA A0R 1A0  
 Contact: Robert Noel  
 robertnoel@nlh.nl.ca  
 T: (709)925-8294  
 F: (709)925-8220

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.


# FERROGRAPHY REPORT

Area  
**[02437560]**  
 Machine Id  
**A10 - Thrust Bearing**  
 Component  
**Thrust Bearing**  
 Fluid  
**PETRO CANADA TURBOFLO R&O 46 (750 LTR)**


Magn: 200x Illum: BC

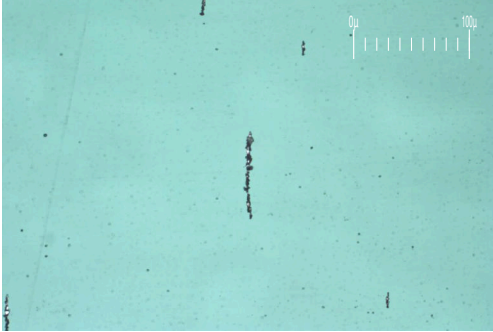

Magn: 50x Illum: RW

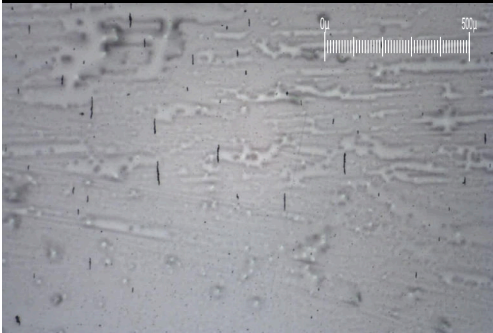

Magn: 100x Illum: RW

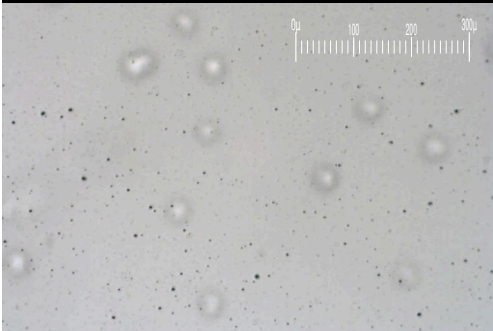


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		<b>1.5</b>	3.3	2.6
Small Particles		DR-Ferr*		<b>1.1</b>	3.0	1.3
Total Particles		DR-Ferr*	>---	<b>2.6</b>	6.3	3.9
Large Particles Percentage	%	DR-Ferr*		<b>15.4</b>	4.8	33.3
Severity Index		DR-Ferr*		<b>1</b>	1	3.4

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		<b>2</b>	1	1
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		<b>1</b>	1	1
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*				
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		<b>1</b>		1
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		<b>1</b>	1	1


### WEAR

All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system.


DR Ferrography

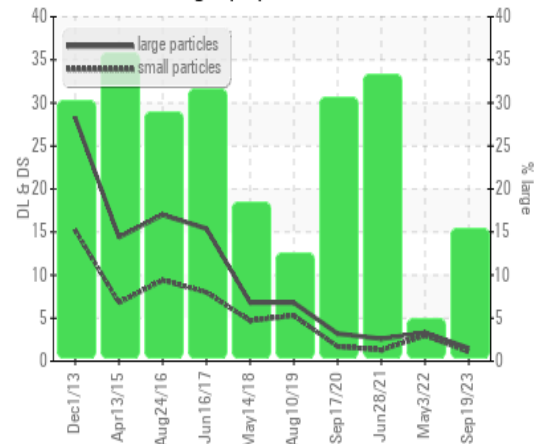


### Rotating Pressure Vessel Oxidation Test

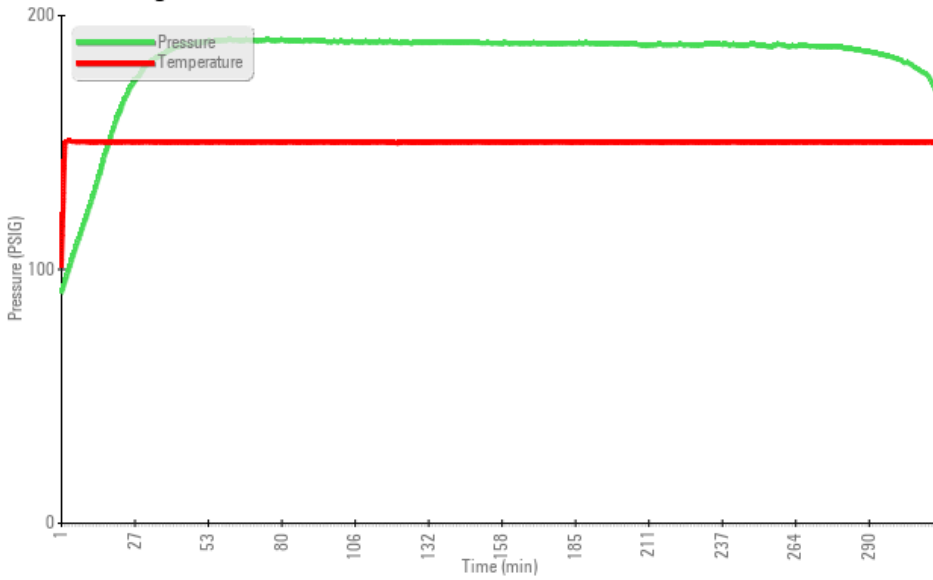


### Foaming SEQ I/II/III

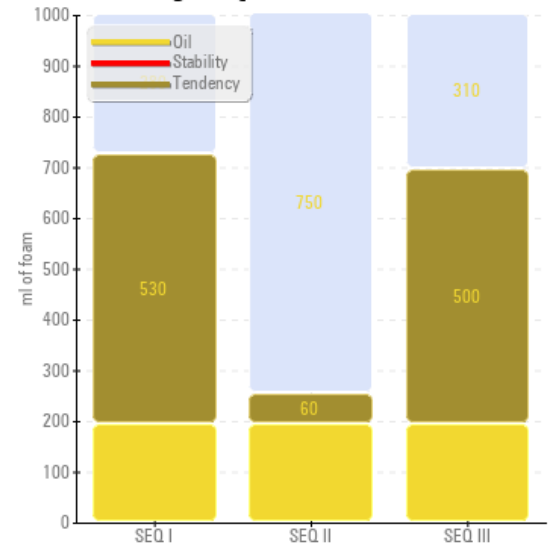


### Remaining Useful Life (RULER)

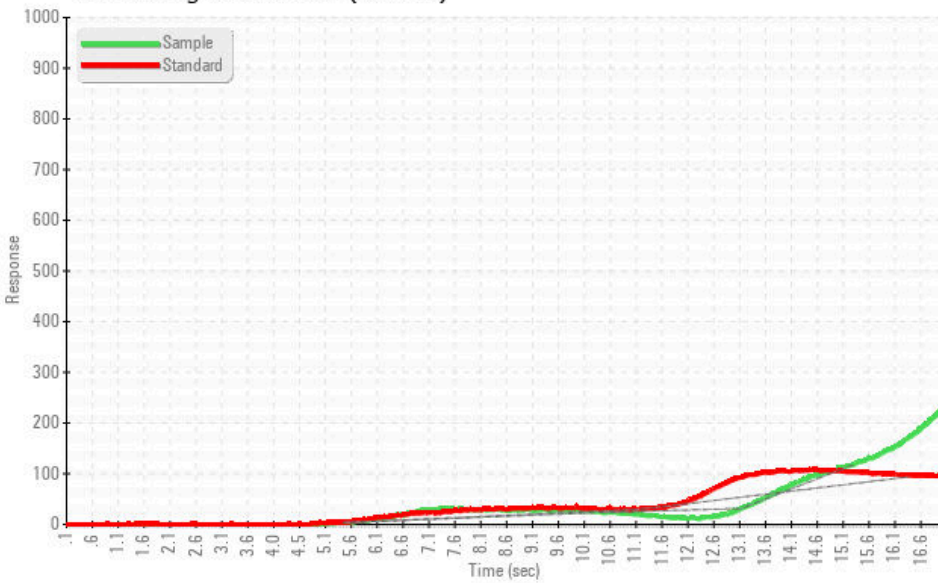

### Water Separability

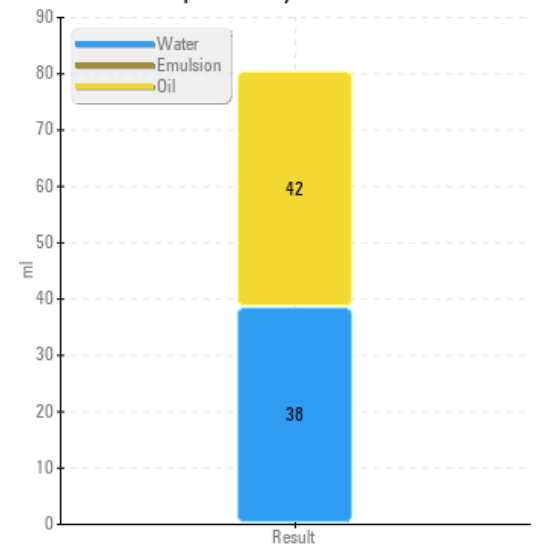

### MPC (Varnish Test)

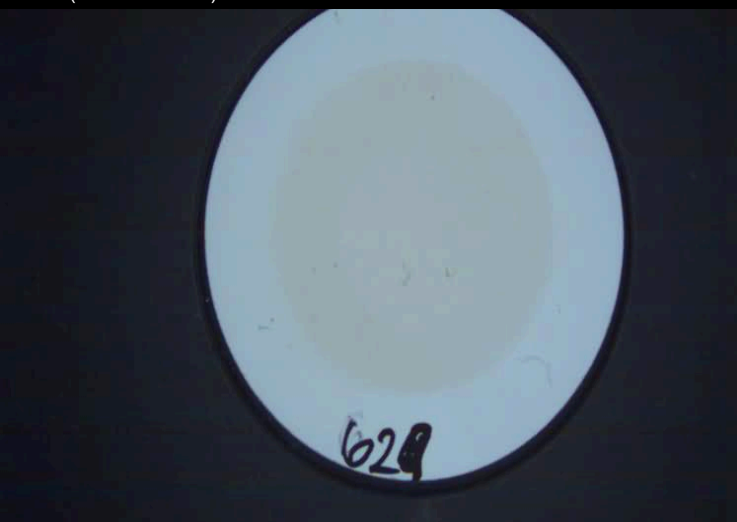

### Sample Color & Clarity



*This page left intentionally blank*