


# OIL ANALYSIS REPORT

Sample Rating Trend



**WEAR**

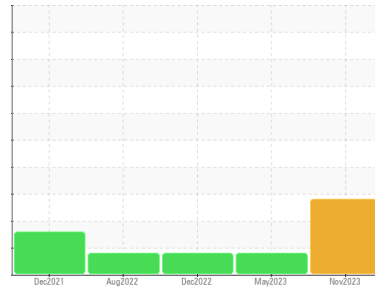

Machine Id  
**TIMM #1 PLUNGER 3**

Component  
**Gearbox**

Fluid  
**SHELL OMALA S2 G 68 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

The oil change at the time of sampling has been noted. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

**Wear**

PQ levels are abnormal. Iron ppm levels are abnormal. Gear wear is indicated. The high ferrous density (PQ) index indicates that abnormal wear is occurring. The ferrography results are normal indicating no abnormal wear in the system.

**Contaminants**

There is no indication of any contamination in the oil.

**Oil Condition**

The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>CB0031423</b>	CB0031106	CB0031048
Sample Date	Client Info			<b>26 Nov 2023</b>	22 May 2023	27 Dec 2022
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>Changed</b>	Changed	Changed
Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	<b>NEG</b>	NEG	NEG





WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		<b>▲ 168</b>	29	17
Iron	ppm	ASTM D5185(m)	>200	<b>▲ 310</b>	123	96
Chromium	ppm	ASTM D5185(m)	>15	<b>4</b>	1	1
Nickel	ppm	ASTM D5185(m)	>15	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>25	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185(m)	>100	<b>&lt;1</b>	<1	0
Copper	ppm	ASTM D5185(m)	>200	<b>6</b>	2	2
Tin	ppm	ASTM D5185(m)	>25	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	>5	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	6.2	<b>&lt;1</b>	<1	<1
Barium	ppm	ASTM D5185(m)	0.0	<b>&lt;1</b>	<1	4
Molybdenum	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>1</b>	<1	<1
Magnesium	ppm	ASTM D5185(m)	0	<b>0</b>	0	<1
Calcium	ppm	ASTM D5185(m)	0.0	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185(m)	290	<b>275</b>	302	308
Zinc	ppm	ASTM D5185(m)	3.8	<b>26</b>	16	26
Sulfur	ppm	ASTM D5185(m)	8167	<b>8131</b>	7874	7950
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>50	<b>2</b>	2	2
Sodium	ppm	ASTM D5185(m)		<b>&lt;1</b>	1	1
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		<b>0.48</b>	0.41	0.31


# OIL ANALYSIS REPORT

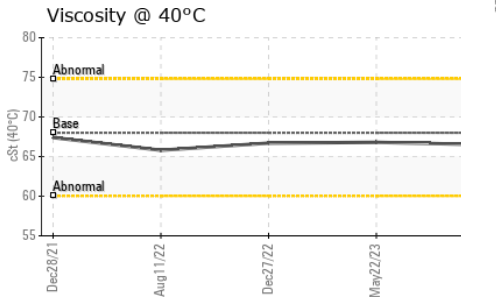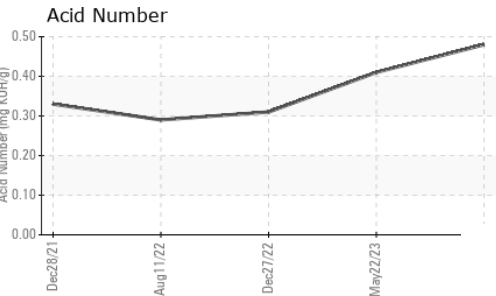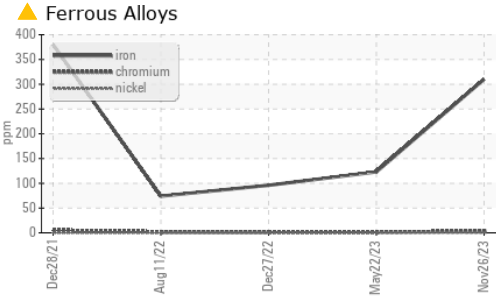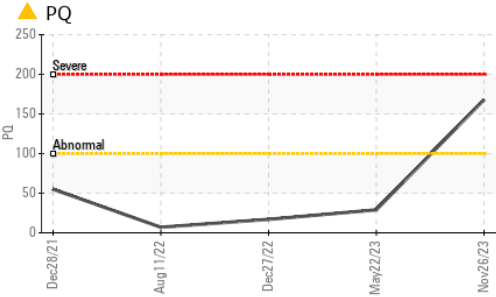






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	<b>LIGHT</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	68.0	<b>66.5</b>	66.8	66.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

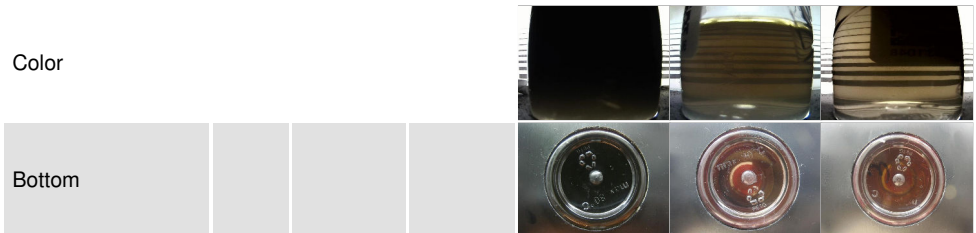

## GRAPHS

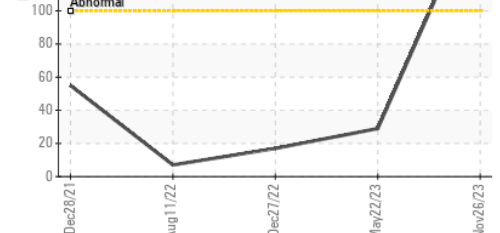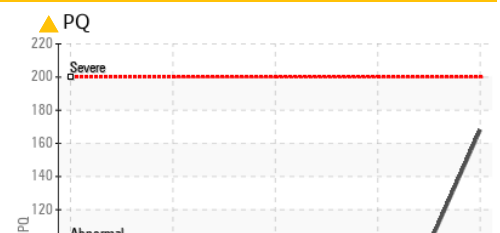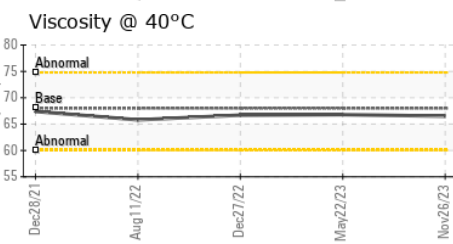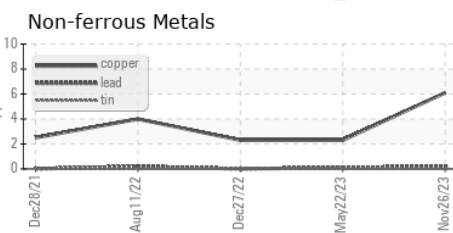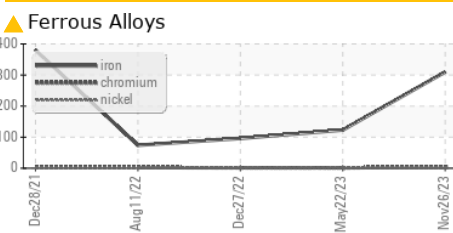




**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : CB0031423 **Received** : 21 Dec 2023  
**Lab Number** : 02604635 **Diagnosed** : 28 Dec 2023  
**Unique Number** : 5697720 **Diagnostician** : Kevin Marson  
**Test Package** : IND 3 ( Additional Tests: TAN Man )

**TOYOTA MOTOR MANUFACT.**  
 1055 FOUNTAIN STREET N.  
 CAMBRIDGE, ON  
 CA N3H 5K2  
 Contact: mike clappison  
 mike.clappison@toyota.com  
 T: (519)212-5023  
 F: (519)653-9638

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

# FERROGRAPHY REPORT

Machine Id  
**TIMM #1 PLUNGER 3**  
Component  
**Gearbox**  
Fluid  
**SHELL OMALA S2 G 68 (--- GAL)**

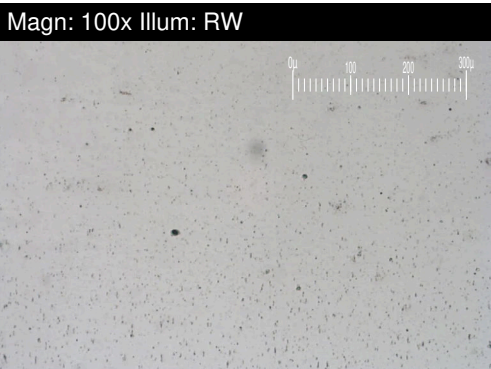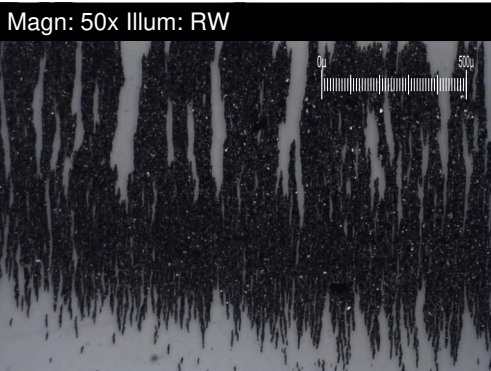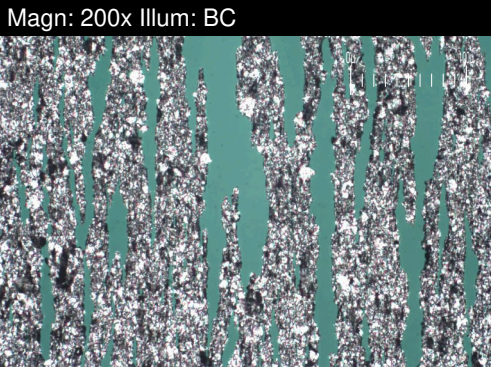


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		<b>20.4</b>	96.1	62.2
Small Particles		DR-Ferr*		<b>4.3</b>	16.6	15.7
Total Particles		DR-Ferr*	>---	<b>24.7</b>	112.7	77.9
Large Particles Percentage	%	DR-Ferr*		<b>65.2</b>	70.5	59.7
Severity Index		DR-Ferr*		<b>328</b>	7640	2892

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		<b>7</b>	0	0
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		<b>3</b>	4	4
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*				
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*		<b>1</b>	2	
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		<b>1</b>	1	1
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		<b>2</b>	1	1

### WEAR

PQ levels are abnormal. Iron ppm levels are abnormal. Gear wear is indicated. The high ferrous density (PQ) index indicates that abnormal wear is occurring. The ferrography results are normal indicating no abnormal wear in the system.

### DR Ferrography

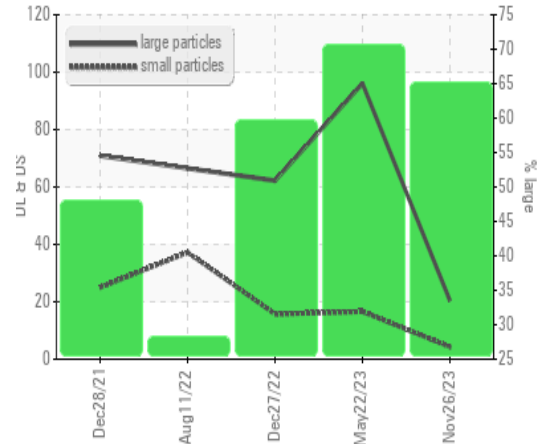

*This page left intentionally blank*