OIL ANALYSIS REPORT

Sample Rating Trend

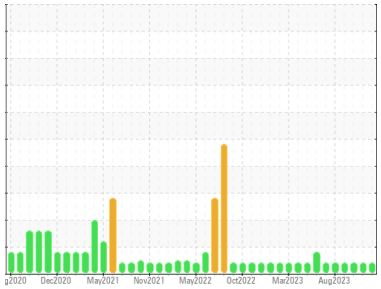

PH

Area
centre énergetique
Machine Id
14-1801-06
Component
6 Screw Compressor
Fluid
SULLAIR SULLUBE (500 LTR)

DIAGNOSIS

Recommendation

Échantillonner de nouveau l`équipement au prochain intervalle de vidange afin d`en surveiller la condition.

Wear

Les taux d`usure de tous les composants sont normaux.

Contamination

La propreté du système est acceptable pour votre objectif de propreté ISO 4406. La teneur en eau est négligeable. La propreté du système et du fluide est acceptable.

Fluid Condition

Le AN est acceptable pour ce fluide. L`état de l`huile permet d`en prolonger l`utilisation.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0879171**	WC0858540	WC0852818
Sample Date		Client Info		**19 Dec 2023**	23 Nov 2023	24 Oct 2023
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**ABNORMAL**	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>60	**1**	1	1
Chromium	ppm	ASTM D5185(m)	>4	**0**	0	0
Nickel	ppm	ASTM D5185(m)		**0**	0	<1
Titanium	ppm	ASTM D5185(m)		**0**	0	0
Silver	ppm	ASTM D5185(m)		**0**	<1	<1
Aluminum	ppm	ASTM D5185(m)	>5	**<1**	0	0
Lead	ppm	ASTM D5185(m)	>10	**0**	<1	<1
Copper	ppm	ASTM D5185(m)	>30	**<1**	<1	<1
Tin	ppm	ASTM D5185(m)	>15	**0**	0	0
Antimony	ppm	ASTM D5185(m)		**0**	0	0
Vanadium	ppm	ASTM D5185(m)		**0**	0	0
Beryllium	ppm	ASTM D5185(m)		**0**	0	0
Cadmium	ppm	ASTM D5185(m)		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	12	**<1**	<1	<1
Barium	ppm	ASTM D5185(m)	500	**536**	520	532
Molybdenum	ppm	ASTM D5185(m)	0.0	**0**	0	0
Manganese	ppm	ASTM D5185(m)		**0**	0	0
Magnesium	ppm	ASTM D5185(m)	0.0	**0**	0	0
Calcium	ppm	ASTM D5185(m)	8.2	**3**	4	3
Phosphorus	ppm	ASTM D5185(m)	4.0	**0**	0	0
Zinc	ppm	ASTM D5185(m)	0.1	**4**	4	4
Sulfur	ppm	ASTM D5185(m)	240	**342**	330	320
Lithium	ppm	ASTM D5185(m)		**<1**	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>50	**1**	1	1
Sodium	ppm	ASTM D5185(m)		**57**	55	55
Potassium	ppm	ASTM D5185(m)	>20	**5**	4	6
Water	%	ASTM D6304*	>0.5	**0.084**	0.153	0.184
ppm Water	ppm	ASTM D6304*	>5000	**850**	1536	1842.9

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	**264**	720	1007
Particles >6µm		ASTM D7647	>2500	**71**	190	271
Particles >14µm		ASTM D7647	>320	**8**	14	26
Particles >21µm		ASTM D7647	>80	**3**	3	6
Particles >38µm		ASTM D7647	>20	**0**	1	0
Particles >71µm		ASTM D7647	>4	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	**15/13/10**	17/15/11	17/15/12

OIL ANALYSIS REPORT

Water (KF)

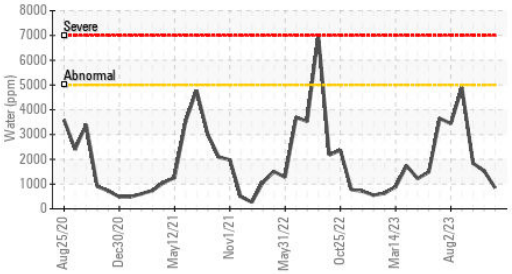

Particle Trend

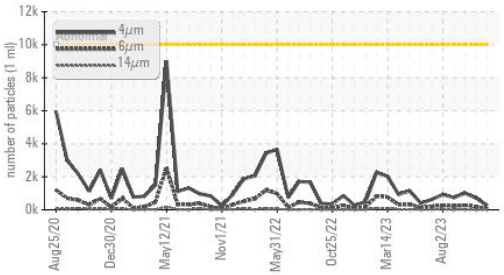

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.06	**0.56**	0.40	0.35

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Precipitate	scalar	Visual*	NONE	**NONE**	NONE	NONE
Silt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Debris	scalar	Visual*	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Appearance	scalar	Visual*	NORML	**NORML**	NORML	NORML
Odor	scalar	Visual*	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	Visual*	>0.5	**NEG**	NEG	NEG
Free Water	scalar	Visual*		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
pH	Scale 0-14	ASTM D1287*		▲ **3.56**	▲ 5.52	▲ 4.55
Visc @ 40°C	cSt	ASTM D7279(m)	38.1	**43.0**	43.7	39.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color			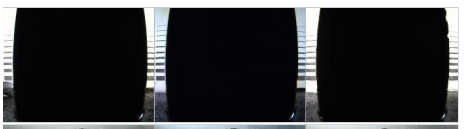		
Bottom					

Water (KF)

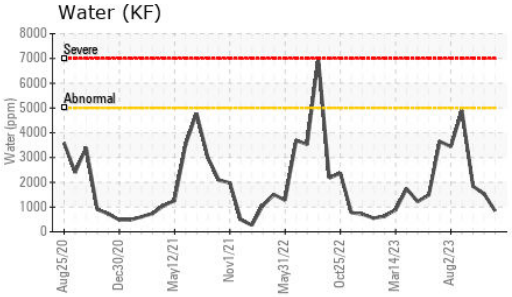

Viscosity @ 40°C

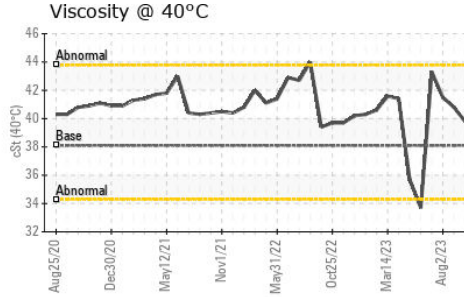

Particle Trend

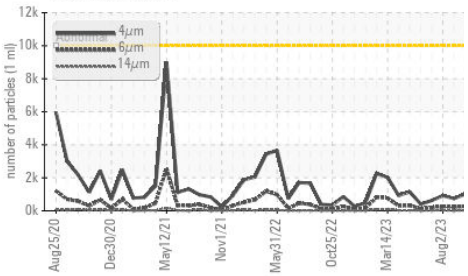

GRAPHS

Ferrous Alloys

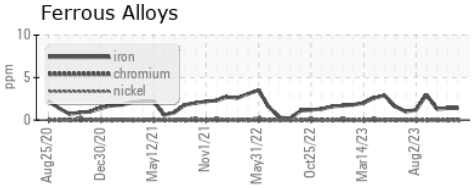

Non-ferrous Metals

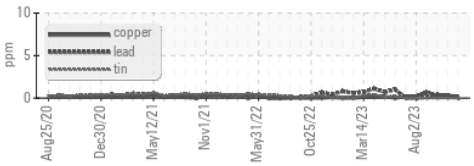

Viscosity @ 40°C

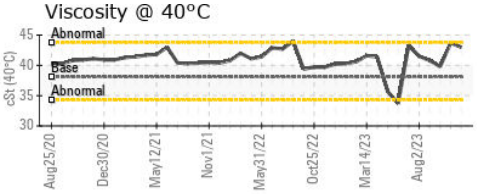

Particle Count

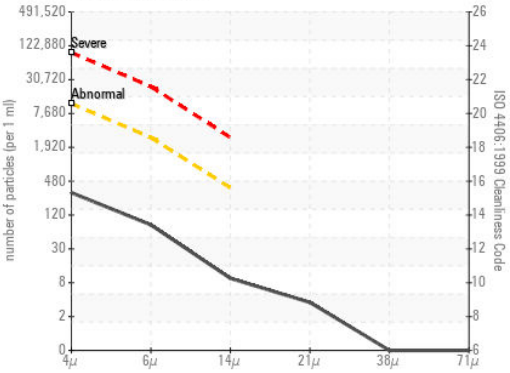

Acid Number

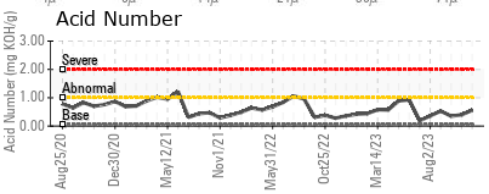

CALA
ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0879171 **Recieved** : 22 Dec 2023
Lab Number : 02605007 **Diagnosed** : 27 Dec 2023
Unique Number : 5698092 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: KF, pH, TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

RTA - UGB
C.P. 900
Ville de la Baie, QC
CA G7B 4G9
Contact: Alcan Epc
mathieu.tremblay2@riotinto.com
T: (418)697-9568
F: (418)697-9550