




OIL ANALYSIS REPORT

Sample Rating Trend

FUEL



Area
REAL PROPERTY SHIPPAGAN [70558]
 Machine Id
74767330
 Component
Diesel Engine
 Fluid
VALVOLINE 15W40 (--- GAL)

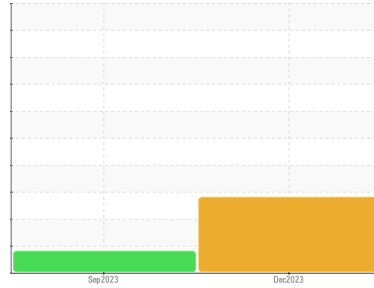

DIAGNOSIS

Recommendation

We advise that you check the fuel injection system. We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

Wear

Metal levels are typical for a new component breaking in.

Contamination

There is a high amount of fuel present in the oil. Tests confirm the presence of fuel in the oil.

Fluid Condition

Fuel is present in the oil and is lowering the viscosity. The oil is no longer serviceable due to the presence of contaminants.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		CU0021688	CU0019900	---
Sample Date	Client Info		05 Dec 2023	22 Sep 2023	---
Machine Age	hrs	Client Info	100	90	---
Oil Age	hrs	Client Info	0	14	---
Oil Changed	Client Info		Not Chngd	Changed	---
Sample Status			SEVERE	ABNORMAL	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	NEG	NEG	---
Glycol	WC Method		NEG	NEG	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >100	28	▲ 617	---
Chromium	ppm	ASTM D5185(m) >20	0	2	---
Nickel	ppm	ASTM D5185(m) >4	<1	<1	---
Titanium	ppm	ASTM D5185(m)	0	0	---
Silver	ppm	ASTM D5185(m) >3	0	0	---
Aluminum	ppm	ASTM D5185(m) >20	2	4	---
Lead	ppm	ASTM D5185(m) >40	<1	4	---
Copper	ppm	ASTM D5185(m) >330	3	16	---
Tin	ppm	ASTM D5185(m) >15	0	<1	---
Antimony	ppm	ASTM D5185(m)	0	0	---
Vanadium	ppm	ASTM D5185(m)	0	0	---
Beryllium	ppm	ASTM D5185(m)	0	0	---
Cadmium	ppm	ASTM D5185(m)	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 39	36	16	---
Barium	ppm	ASTM D5185(m) 1	0	<1	---
Molybdenum	ppm	ASTM D5185(m) 49	37	50	---
Manganese	ppm	ASTM D5185(m) 1	0	5	---
Magnesium	ppm	ASTM D5185(m) 616	627	758	---
Calcium	ppm	ASTM D5185(m) 1554	959	1273	---
Phosphorus	ppm	ASTM D5185(m) 899	580	765	---
Zinc	ppm	ASTM D5185(m) 1069	650	844	---
Sulfur	ppm	ASTM D5185(m) 2624	1653	1927	---
Lithium	ppm	ASTM D5185(m)	<1	<1	---

CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	7	14	---
Sodium	ppm	ASTM D5185(m)	3	5	---
Potassium	ppm	ASTM D5185(m) >20	1	1	---
Fuel	%	ASTM D7593* >5	🔴 11.8	0.4	---

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844* >3	0	0	---
Nitration	Abs/cm	ASTM D7624* >20	6.0	9.9	---
Sulfation	Abs./1mm	ASTM D7415* >30	19.7	25.2	---



OIL ANALYSIS REPORT







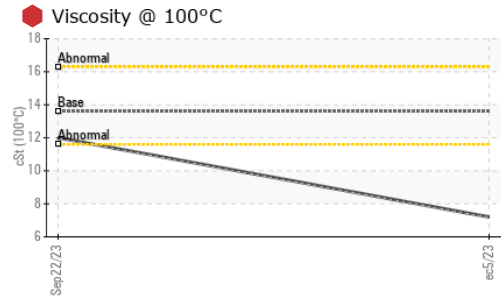
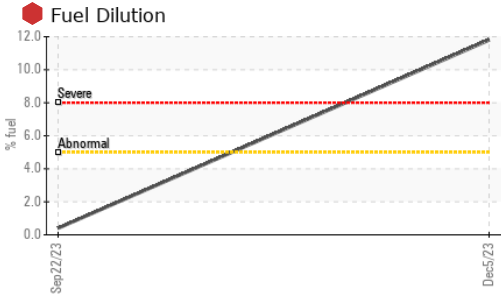


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm ASTM D7414*	>25	15.5	26.6	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	LIGHT	---	---
Yellow Metal	scalar Visual*	NONE	NONE	---	---
Precipitate	scalar Visual*	NONE	NONE	---	---
Silt	scalar Visual*	NONE	NONE	---	---
Debris	scalar Visual*	NONE	NONE	---	---
Sand/Dirt	scalar Visual*	NONE	NONE	---	---
Appearance	scalar Visual*	NORML	NORML	---	---
Odor	scalar Visual*	NORML	NORML	NORML	---
Emulsified Water	scalar Visual*	>0.2	NEG	NEG	---
Free Water	scalar Visual*		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt ASTM D7279(m)	13.6	7.2	12.0	---

GRAPHS

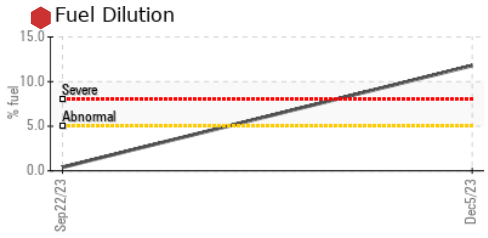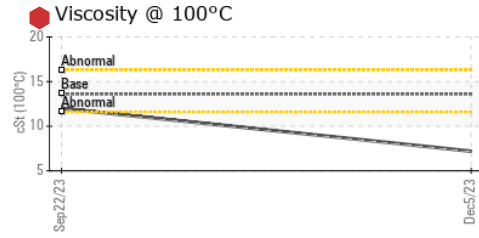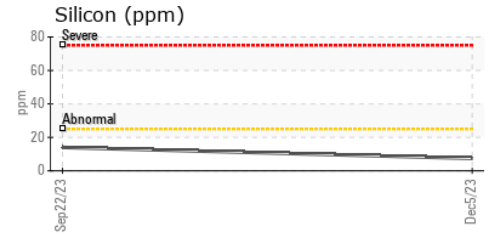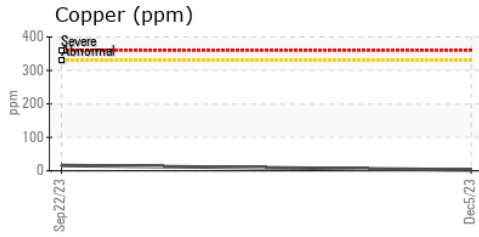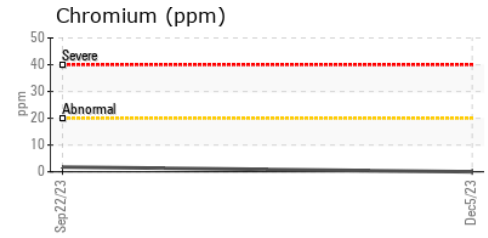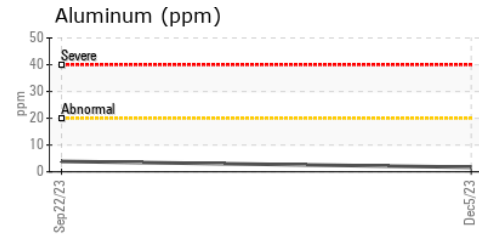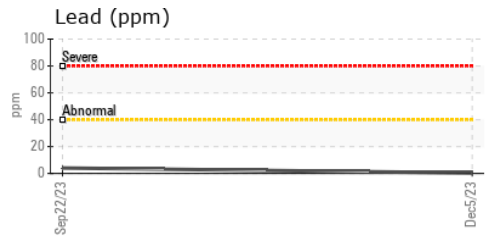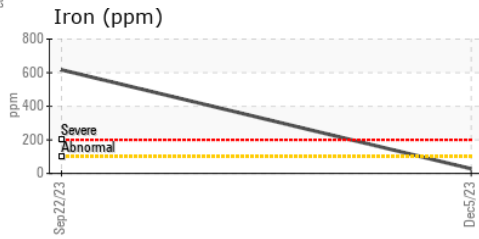

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CU0021688 **Received** : 27 Dec 2023
Lab Number : 02605217 **Diagnosed** : 28 Dec 2023
Unique Number : 5698302 **Diagnostician** : Kevin Marson
Test Package : MOB 1 (Additional Tests: FuelDilution, PercentFuel, Visual)

CUMMINS EASTERN CANADA LP
 321 DOAK ROAD
 FREDERICTON, NB
 CA E3C 2E7
 Contact: Mark Allen
 mark.w.allen@cummins.com
 T: (506)451-1929
 F: (506)451-1927

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.