

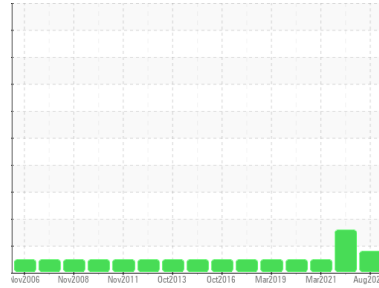


OIL ANALYSIS REPORT



Area
49 Place D'Armes #302A [4500054809]
 Machine Id
CARRIER 0205Q04704(A)
 Component
Chiller
 Fluid
CASTROL AIRCOL SW 220 (--- GAL)

Sample Rating Trend



WEAR

✓

DIAGNOSIS

- ▲ **Recommendation**
We recommend an early resample to monitor this condition.
- ▲ **Wear**
Tin ppm levels are noted. Bearing wear is indicated. All other component wear rates are normal.
- Contamination**
The water content is negligible. There is no indication of any contamination in the oil.
- Fluid Condition**
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GTT0001345	GTT542	GTT543
Sample Date	Client Info		01 Aug 2023	07 Dec 2021	01 Mar 2021
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	MARGINAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >8	3	3	2
Chromium	ppm	ASTM D5185(m) >2	0	<1	<1
Nickel	ppm	ASTM D5185(m)	0	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m) >2	0	---	---
Aluminum	ppm	ASTM D5185(m) >3	<1	<1	<1
Lead	ppm	ASTM D5185(m) >2	<1	<1	<1
Copper	ppm	ASTM D5185(m) >8	<1	<1	<1
Tin	ppm	ASTM D5185(m) >4	▲ 2	<1	<1
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	0	---	---
Barium	ppm	ASTM D5185(m) 0	0	---	---
Molybdenum	ppm	ASTM D5185(m) 0	0	---	---
Manganese	ppm	ASTM D5185(m) 0	0	---	---
Magnesium	ppm	ASTM D5185(m) 0	0	---	---
Calcium	ppm	ASTM D5185(m) 0	0	---	---
Phosphorus	ppm	ASTM D5185(m) 30	13	---	---
Zinc	ppm	ASTM D5185(m) 0	3	2	2
Sulfur	ppm	ASTM D5185(m) 30	13	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	6	---	---
Sodium	ppm	ASTM D5185(m)	<1	---	---
Potassium	ppm	ASTM D5185(m) >20	0	---	---
ppm Water	ppm	ASTM D6304* >200	21	▲ 831	91



FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.03	0.06	0.030	0.028

OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	220	165	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS



Sample No. : GTT0001345 **Recieved** : 28 Dec 2023
Lab Number : **02605615** **Diagnosed** : 05 Jan 2024
Unique Number : 5698700 **Diagnostician** : Bill Quesnel
Test Package : IND 2 (Additional Tests: KV40)

To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.

Test denoted () outside scope of accreditation, (m) method modified, (e) tested at external lab.*

Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.

Carrier Commerical Service
 C/O Conduent Div of Carrier Canada, 1-2740 Matheson Blvd
 Mississauga, ON
 CA L4W 4X3
 Contact: Brian Raymundo
 Brian.Raymundo@carrier.com

T:
F: