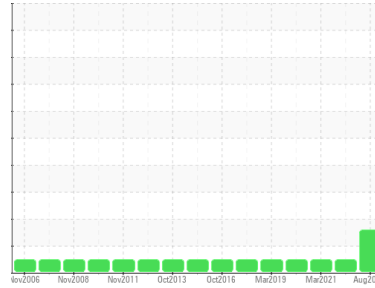




# OIL ANALYSIS REPORT

Sample Rating Trend



**WEAR**



Area  
**49 Place D`Armes Ch#2**  
 Machine Id  
**CARRIER 4897J56840**  
 Component  
**Chiller**  
 Fluid  
**ICI EMKARATE RL 68H (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

This unit should be monitored closely by a service engineer as these wear conditions tend to advance rapidly. We recommend an early resample to monitor this condition.

### ▲ Wear

Tin and lead ppm levels are abnormal. Bearing wear is indicated.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>GTT0001224</b>	GTT15630	GTT15631
Sample Date	Client Info		<b>01 Aug 2023</b>	07 Dec 2021	01 Mar 2021
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >8	<b>2</b>	2	1
Chromium	ppm	ASTM D5185(m) >2	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Silver	ppm	ASTM D5185(m) >2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m) >3	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185(m) >2	<b>▲ 1</b>	<1	<1
Copper	ppm	ASTM D5185(m) >8	<b>3</b>	1	4
Tin	ppm	ASTM D5185(m) >4	<b>▲ 17</b>	1	<1
Antimony	ppm	ASTM D5185(m)	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	---	---
Barium	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185(m)	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185(m) 1900	<b>1143</b>	---	---
Zinc	ppm	ASTM D5185(m) 0	<b>6</b>	4	2
Sulfur	ppm	ASTM D5185(m) 25	<b>0</b>	---	---
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	<b>14</b>	---	---
Sodium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185(m) >20	<b>0</b>	---	---
ppm Water	ppm	ASTM D6304* >100	<b>59</b>	138	134



## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.02	<b>0.08</b>	0.031	0.014

# OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	---	---
Silt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Debris	scalar	Visual*	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	72.3	<b>61.6</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

## GRAPHS



**Sample No.** : GTT0001224      **Recieved** : 28 Dec 2023  
**Lab Number** : **02605651**      **Diagnosed** : 05 Jan 2024  
**Unique Number** : 5698736      **Diagnostician** : Bill Quesnel  
**Test Package** : IND 2 ( Additional Tests: KV40 )

*To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.*

*Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.*

*Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.*

**Carrier Commerical Service**  
 C/O Conduent Div of Carrier Canada, 1-2740 Matheson Blvd  
 Mississauga, ON  
 CA L4W 4X3  
 Contact: Brian Raymundo  
 Brian.Raymundo@carrier.com

T:  
F: