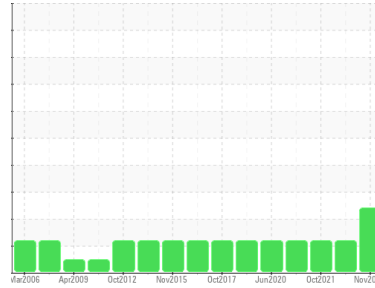


Area  
**5001 Yonge Ch#1 [PR2311300159]**  
 Machine Id  
**CARRIER 1990J43053**  
 Component  
**Chiller**  
 Fluid  
**TRANE 0022 (--- GAL)**



## DIAGNOSIS

### Recommendation

Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor. The fluid was specified as TRANE 0022, however, a fluid match indicates that this fluid is likely Esso Nuto H 46 or a similar product. The increased readings on copper, zinc, phosphorus and the oil acid number are all associated with the effects of additives blended in this oil formulation. Please confirm the oil type and grade on your next sample.

### Wear

Lead ppm levels are noted. All other component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1    | history2    |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info |             | <b>GTT0001280</b>  | GTT7503     | GTT7504     |
| Sample Date   | Client Info |             | <b>21 Nov 2023</b> | 23 Jan 2023 | 20 Oct 2021 |
| Machine Age   | hrs         | Client Info | <b>0</b>           | ---         | ---         |
| Oil Age       | hrs         | Client Info | <b>0</b>           | ---         | ---         |
| Oil Changed   | Client Info |             | <b>N/A</b>         | N/A         | N/A         |
| Sample Status |             |             | <b>ATTENTION</b>   | ABNORMAL    | ABNORMAL    |

## WEAR METALS

|           | method | limit/base       | current      | history1 | history2 |
|-----------|--------|------------------|--------------|----------|----------|
| Iron      | ppm    | ASTM D5185(m) >8 | <b>5</b>     | 2        | 2        |
| Chromium  | ppm    | ASTM D5185(m) >2 | <b>0</b>     | <1       | <1       |
| Nickel    | ppm    | ASTM D5185(m)    | <b>&lt;1</b> | ---      | ---      |
| Titanium  | ppm    | ASTM D5185(m)    | <b>0</b>     | ---      | ---      |
| Silver    | ppm    | ASTM D5185(m) >2 | <b>0</b>     | ---      | ---      |
| Aluminum  | ppm    | ASTM D5185(m) >3 | <b>&lt;1</b> | <1       | <1       |
| Lead      | ppm    | ASTM D5185(m) >2 | <b>▲ 8</b>   | <1       | <1       |
| Copper    | ppm    | ASTM D5185(m) >8 | <b>316</b>   | 214      | 126      |
| Tin       | ppm    | ASTM D5185(m) >4 | <b>0</b>     | <1       | <1       |
| Antimony  | ppm    | ASTM D5185(m)    | <b>0</b>     | ---      | ---      |
| Vanadium  | ppm    | ASTM D5185(m)    | <b>0</b>     | ---      | ---      |
| Beryllium | ppm    | ASTM D5185(m)    | <b>0</b>     | ---      | ---      |
| Cadmium   | ppm    | ASTM D5185(m)    | <b>0</b>     | ---      | ---      |

## ADDITIVES

|            | method | limit/base       | current      | history1 | history2 |
|------------|--------|------------------|--------------|----------|----------|
| Boron      | ppm    | ASTM D5185(m) 0  | <b>0</b>     | ---      | ---      |
| Barium     | ppm    | ASTM D5185(m) 0  | <b>0</b>     | ---      | ---      |
| Molybdenum | ppm    | ASTM D5185(m) 0  | <b>0</b>     | ---      | ---      |
| Manganese  | ppm    | ASTM D5185(m) 0  | <b>0</b>     | ---      | ---      |
| Magnesium  | ppm    | ASTM D5185(m) 0  | <b>0</b>     | ---      | ---      |
| Calcium    | ppm    | ASTM D5185(m) 0  | <b>▲ 34</b>  | ---      | ---      |
| Phosphorus | ppm    | ASTM D5185(m) 35 | <b>▲ 252</b> | ---      | ---      |
| Zinc       | ppm    | ASTM D5185(m) 0  | <b>▲ 126</b> | 72       | 72       |
| Sulfur     | ppm    | ASTM D5185(m) 30 | <b>▲ 584</b> | ---      | ---      |
| Lithium    | ppm    | ASTM D5185(m)    | <b>1</b>     | ---      | ---      |

## CONTAMINANTS

|           | method | limit/base        | current      | history1 | history2 |
|-----------|--------|-------------------|--------------|----------|----------|
| Silicon   | ppm    | ASTM D5185(m) >15 | <b>18</b>    | ---      | ---      |
| Sodium    | ppm    | ASTM D5185(m)     | <b>&lt;1</b> | ---      | ---      |
| Potassium | ppm    | ASTM D5185(m) >20 | <b>&lt;1</b> | ---      | ---      |
| ppm Water | ppm    | ASTM D6304* >50   | <b>15</b>    | 66       | 73       |



## FLUID DEGRADATION

|                  | method   | limit/base      | current     | history1 | history2 |
|------------------|----------|-----------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D974* 0.05 | <b>0.15</b> | ▲ 0.129  | ▲ 0.225  |

# OIL ANALYSIS REPORT

| VISUAL       | method | limit/base | current | history1     | history2 |
|--------------|--------|------------|---------|--------------|----------|
| White Metal  | scalar | Visual*    | NONE    | <b>NONE</b>  | ---      |
| Yellow Metal | scalar | Visual*    | NONE    | <b>NONE</b>  | ---      |
| Precipitate  | scalar | Visual*    | NONE    | <b>NONE</b>  | ---      |
| Silt         | scalar | Visual*    | NONE    | <b>NONE</b>  | ---      |
| Debris       | scalar | Visual*    | NONE    | <b>NONE</b>  | ---      |
| Sand/Dirt    | scalar | Visual*    | NONE    | <b>NONE</b>  | ---      |
| Appearance   | scalar | Visual*    | NORML   | <b>NORML</b> | ---      |
| Odor         | scalar | Visual*    | NORML   | <b>NORML</b> | ---      |

| FLUID PROPERTIES | method | limit/base    | current | history1    | history2 |
|------------------|--------|---------------|---------|-------------|----------|
| Visc @ 40°C      | cSt    | ASTM D7279(m) | 47      | <b>41.5</b> | ---      |

| SAMPLE IMAGES | method | limit/base | current   | history1 | history2 |
|---------------|--------|------------|---|----------|----------|
| Color         |        |            |  | no image | no image |
| Bottom        |        |            |  | no image | no image |

## GRAPHS



**Sample No.** : GTT0001280      **Recieved** : 28 Dec 2023  
**Lab Number** : **02605702**      **Diagnosed** : 09 Jan 2024  
**Unique Number** : 5698787      **Diagnostician** : Bill Quesnel  
**Test Package** : IND 2 ( Additional Tests: KV40 )

*To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.*

*Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.*

*Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.*

**Daikin Applied Canada Inc.**  
 8-641 Chrislea Road  
 Vaughan, ON  
 CA L4L 8A3  
 Contact: Michelle Tomlinson  
 svctoronto@daikinapplied.com

T:  
F: