




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

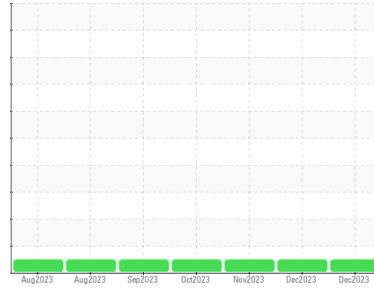

Area  
**KDAC**  
 Machine Id  
**200288**  
 Component  
**Diesel Engine**  
 Fluid  
**PETRO CANADA DURON SHP 10W30 (40 LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

Elevated aluminum (Al) and/or lead (Pb) and potassium (K) levels in your metals analysis are likely a result of solder flux release into the lubricant and is common on new equipment/components. There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0888928</b>	WC0864698	WC0864697
Sample Date	Client Info		<b>28 Dec 2023</b>	03 Dec 2023	28 Nov 2023
Machine Age	kms	Client Info	<b>279661</b>	261217	261216
Oil Age	kms	Client Info	<b>18445</b>	1	64446
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>3.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>200	<b>16</b>	8	42
Chromium	ppm	ASTM D5185(m)	>6	<b>1</b>	<1	2
Nickel	ppm	ASTM D5185(m)	>3	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185(m)	>2	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	>2	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185(m)	>50	<b>8</b>	3	15
Lead	ppm	ASTM D5185(m)	>10	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185(m)	>50	<b>8</b>	5	26
Tin	ppm	ASTM D5185(m)	>6	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	2	<b>1</b>	1	2
Barium	ppm	ASTM D5185(m)	0	<b>0</b>	<1	<1
Molybdenum	ppm	ASTM D5185(m)	50	<b>60</b>	56	62
Manganese	ppm	ASTM D5185(m)	0	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185(m)	950	<b>986</b>	920	982
Calcium	ppm	ASTM D5185(m)	1050	<b>1087</b>	991	1088
Phosphorus	ppm	ASTM D5185(m)	995	<b>1010</b>	944	958
Zinc	ppm	ASTM D5185(m)	1180	<b>1188</b>	1122	1196
Sulfur	ppm	ASTM D5185(m)	2600	<b>2560</b>	2371	1969
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

## CONTAMINANTS



	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>50	<b>3</b>	4	5
Sodium	ppm	ASTM D5185(m)		<b>2</b>	2	2
Potassium	ppm	ASTM D5185(m)	>20	<b>14</b>	5	28

## INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*	>3	<b>0.5</b>	0.1	1.1
Nitration	Abs/cm	ASTM D7624*	>20	<b>7.4</b>	5.3	10.0
Nitration(Diff)	Abs/cm	ASTM D7624*		<b>0.6</b>	---	---
Sulfation	Abs.:1mm	ASTM D7415*	>30	<b>19.6</b>	18.5	22.9
Sulfation(Diff)	Abs/cm	ASTM D7415*		<b>2.3</b>	---	---



# OIL ANALYSIS REPORT







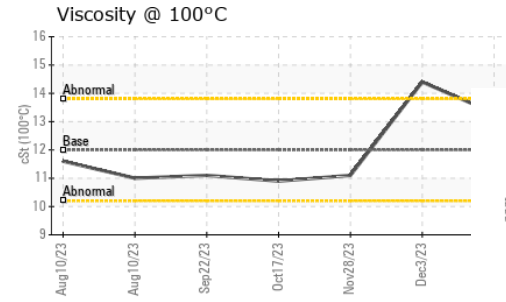
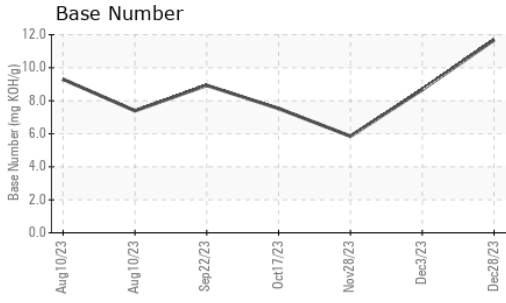


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs./1mm	ASTM D7414*	>25	<b>15.2</b>	13.9	19.7
Oxidation(Diff)	Abs/cm	ASTM D7414*		<b>8.8</b>	---	---
Base Number (BN)	mg KOH/g	ASTM D2896*		<b>11.68</b>	8.67	5.85

VISUAL	method	limit/base	current	history1	history2	
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D7279(m)	12.00	<b>13.3</b>	14.4	11.1

## GRAPHS

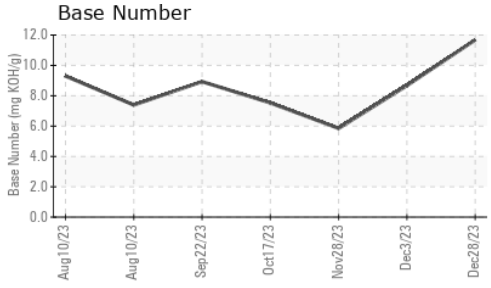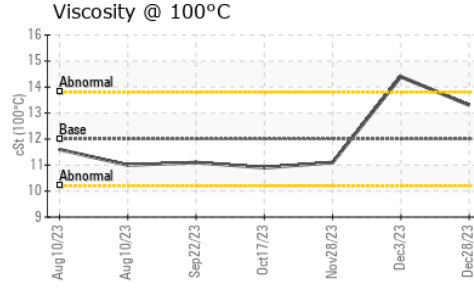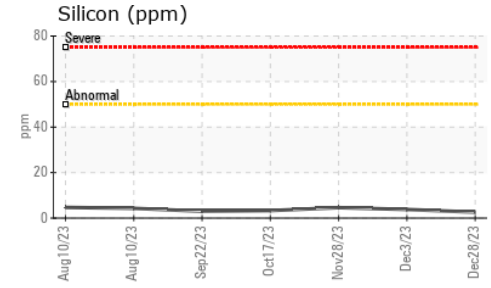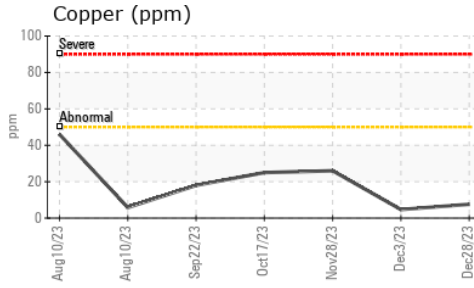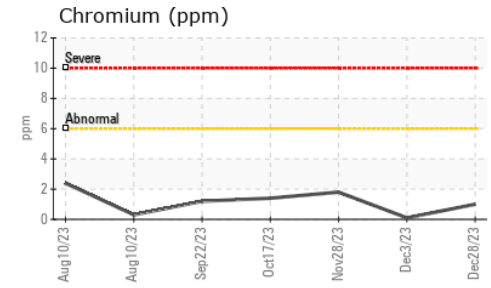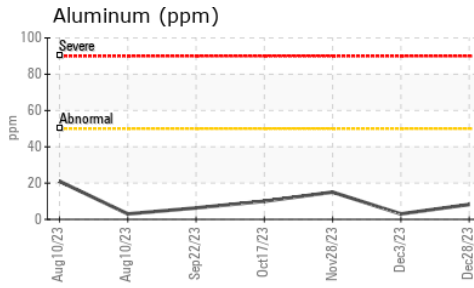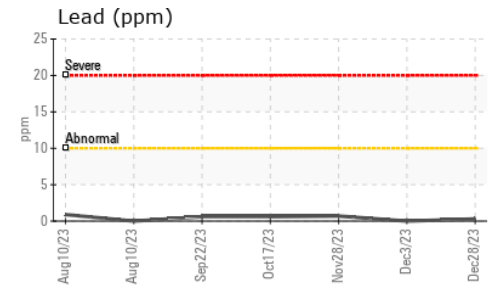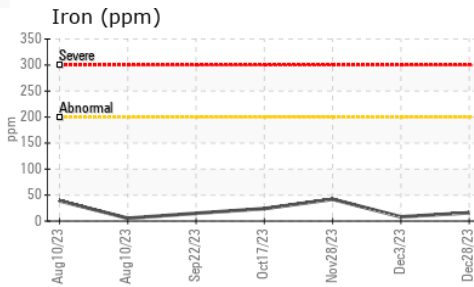

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0888928 **Received** : 02 Jan 2024  
**Lab Number** : **02605826** **Diagnosed** : 04 Jan 2024  
**Unique Number** : 5698911 **Diagnostician** : Kevin Marson  
**Test Package** : MOB 2 ( Additional Tests: FT-IR(Diff) )

**WFR Technical Services**  
 5389 Riverside Drive  
 Burlington, ON  
 CA L7L 3Y1  
 Contact: William Ridley  
 wfr.technical.services@gmail.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

T:  
F: