




OIL ANALYSIS REPORT

Sample Rating Trend

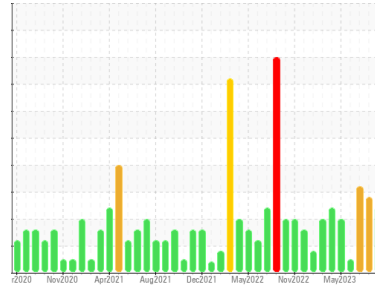

ISO



Area
M13
 Machine Id
71-GG-3300C MAIN POWER GAS GENERATOR C (71-T-3390C) (S/N Maint Plan 22480)
 Component
Jet Turbine
 Fluid
MOBIL JET OIL II (924 LTR)

DIAGNOSIS

Recommendation

We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates (2 to 100 microns in size) present in the oil. The water content is negligible.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PP	PP	PP
Sample Date	Client Info	23 Nov 2023	11 Sep 2023	23 Aug 2023
Machine Age	hrs	0	0	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m) >8	0	0	<1
Chromium	ppm	ASTM D5185(m) >2	0	0	0
Nickel	ppm	ASTM D5185(m) >2	<1	0	0
Titanium	ppm	ASTM D5185(m) >2	0	0	0
Silver	ppm	ASTM D5185(m) >2	0	<1	0
Aluminum	ppm	ASTM D5185(m) >2	<1	0	0
Lead	ppm	ASTM D5185(m) >3	0	<1	<1
Copper	ppm	ASTM D5185(m) >3	0	<1	0
Tin	ppm	ASTM D5185(m) >2	0	0	0
Antimony	ppm	ASTM D5185(m)	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	<1	<1	0
Barium	ppm	ASTM D5185(m)	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	<1	0	0
Calcium	ppm	ASTM D5185(m)	<1	<1	7
Phosphorus	ppm	ASTM D5185(m)	2927	2945	3012
Zinc	ppm	ASTM D5185(m)	1	1	3
Sulfur	ppm	ASTM D5185(m)	0	0	17
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m) >8	<1	3	4
Sodium	ppm	ASTM D5185(m)	<1	<1	<1
Potassium	ppm	ASTM D5185(m) >20	2	<1	1
Water	%	ASTM D6304* >.1	0.045	0.092	▲ 0.116
ppm Water	ppm	ASTM D6304* >1000	460	925.2	▲ 1169.7


FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >2500	▲ 11477	▲ 3200	▲ 4959
Particles >6µm	ASTM D7647 >640	▲ 3279	▲ 895	▲ 1239
Particles >14µm	ASTM D7647 >80	▲ 300	▲ 111	▲ 98
Particles >21µm	ASTM D7647 >20	▲ 89	▲ 43	26
Particles >38µm	ASTM D7647 >4	▲ 7	▲ 10	2
Particles >71µm	ASTM D7647 >3	▲ 1	▲ 6	2
Oil Cleanliness	ISO 4406 (c) >18/16/13	▲ 21/19/15	▲ 19/17/14	▲ 19/17/14




OIL ANALYSIS REPORT


Particle Trend

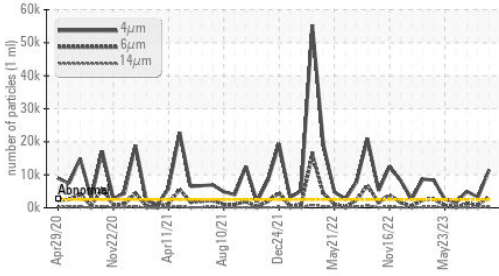


Water (KF)

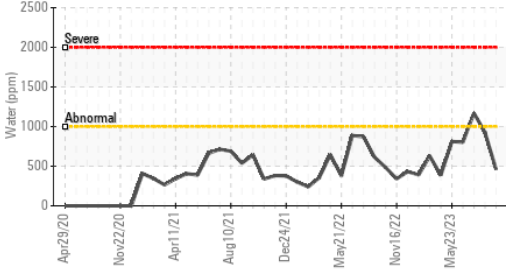


Acid Number

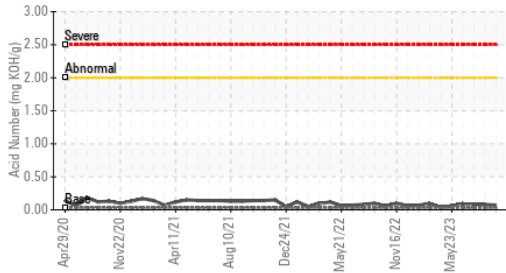

Water (KF)

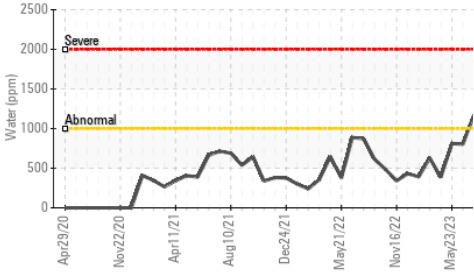

Viscosity @ 40°C

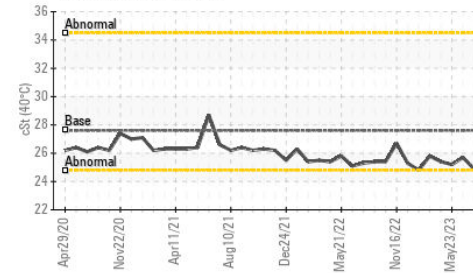


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.03	0.07	0.08	0.08

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	VLITE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>.1	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	27.6	26.0	25.1	24.9

SAMPLE IMAGES

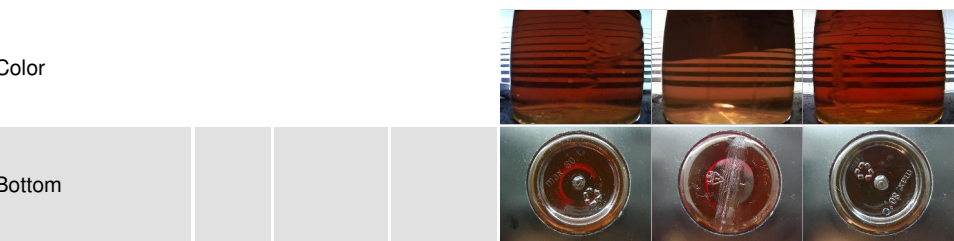


GRAPHS


Ferrous Alloys

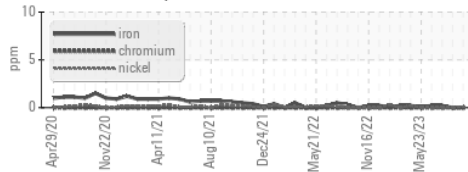


Non-ferrous Metals

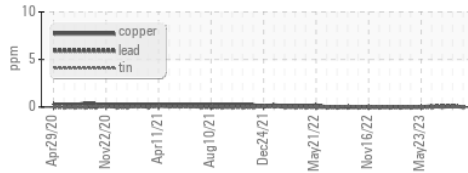


Viscosity @ 40°C

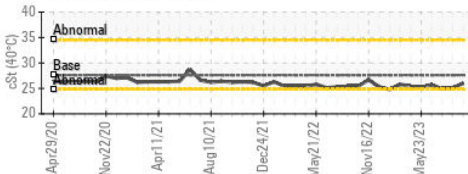

Particle Count

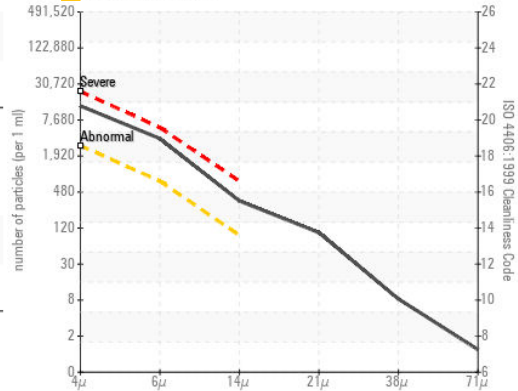

Acid Number

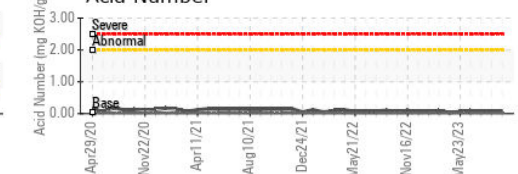

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 HUSKY SEA ROSE /AKER SOLUTIONS
Sample No. : PP **Recieved** : 02 Jan 2024
Lab Number : 02605929 **Diagnosed** : 03 Jan 2024
Unique Number : 5707015 **Diagnostician** : Kevin Marson
Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

PO BOX 20
 ST. JOHN'S, NL
 CA A1C 6C9
 Contact: Nick Fewer
 nick.fewer@akersolutions.com
 T: (709)757-4582
 F: (709)722-8730