




OIL ANALYSIS REPORT

Sample Rating Trend

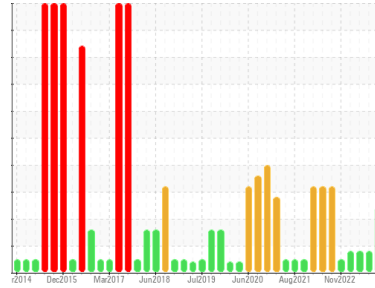

WEAR



Area
ENGINE ROOM 3RD DECK
 Machine Id
27-K-6410B MAIN AIR COMPRESSOR B (S/N Maint Plan 22465)
 Component
2 Air Compressor
 Fluid
MOBIL RARUS 826 (4 LTR)

DIAGNOSIS

▲ Recommendation

We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

▲ Wear

Aluminum, copper and iron ppm levels are abnormal. Oil cooler core leaching or motor piston wear is indicated. Bearing wear is indicated. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PP	PP	PP
Sample Date	Client Info	16 Nov 2023	26 Aug 2023	22 May 2023
Machine Age	days	0	0	0
Oil Age	days	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ATTENTION	ATTENTION

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	6	---	---
Iron	ppm ASTM D5185(m) >50	▲ 75	31	36
Chromium	ppm ASTM D5185(m) >4	0	0	0
Nickel	ppm ASTM D5185(m) >4	<1	<1	<1
Titanium	ppm ASTM D5185(m)	0	0	0
Silver	ppm ASTM D5185(m)	0	0	0
Aluminum	ppm ASTM D5185(m) >10	▲ 33	▲ 20	▲ 21
Lead	ppm ASTM D5185(m) >20	<1	1	<1
Copper	ppm ASTM D5185(m) >40	▲ 43	33	35
Tin	ppm ASTM D5185(m) >5	4	4	4
Antimony	ppm ASTM D5185(m)	0	0	<1
Vanadium	ppm ASTM D5185(m)	0	0	0
Beryllium	ppm ASTM D5185(m)	0	0	0
Cadmium	ppm ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m)	2	2	2
Barium	ppm ASTM D5185(m)	0	0	0
Molybdenum	ppm ASTM D5185(m)	6	5	5
Manganese	ppm ASTM D5185(m)	<1	<1	<1
Magnesium	ppm ASTM D5185(m)	<1	0	<1
Calcium	ppm ASTM D5185(m)	2	2	2
Phosphorus	ppm ASTM D5185(m)	116	117	122
Zinc	ppm ASTM D5185(m)	21	21	20
Sulfur	ppm ASTM D5185(m)	96	92	114
Lithium	ppm ASTM D5185(m)	<1	<1	<1

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >25	7	5	5
Sodium	ppm ASTM D5185(m)	0	<1	<1
Potassium	ppm ASTM D5185(m) >20	2	1	0
Water	% ASTM D6304* >0.6	0.026	---	---
ppm Water	ppm ASTM D6304* >6000	267	---	---


FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974* .12	0.18	---	---




OIL ANALYSIS REPORT


Aluminum (ppm)

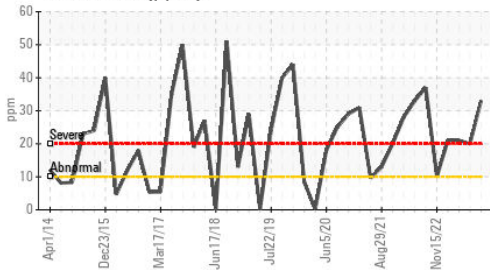


Water (KF)

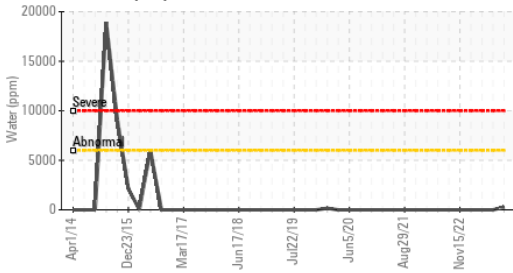


Aluminum (ppm)

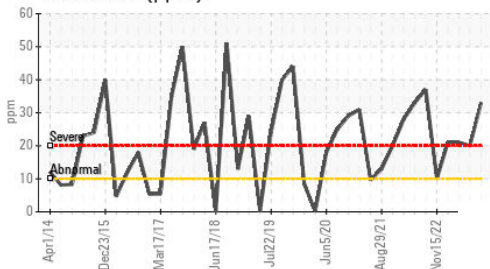

Acid Number

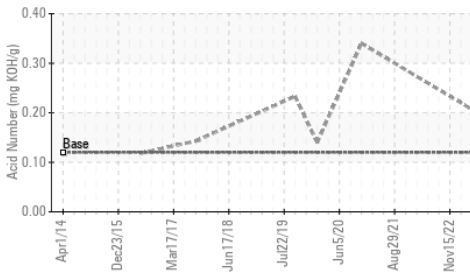


Water (KF)

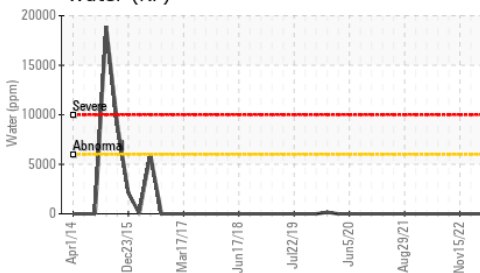

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.6	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	66.5	66.6	65.4

SAMPLE IMAGES

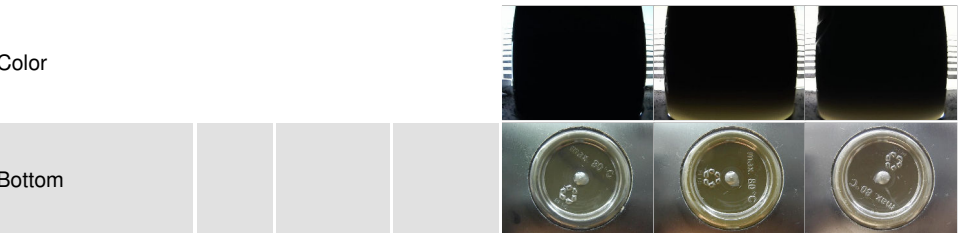


GRAPHS


Ferrous Alloys

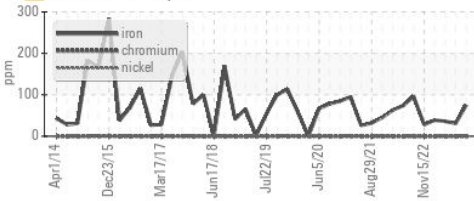


Non-ferrous Metals

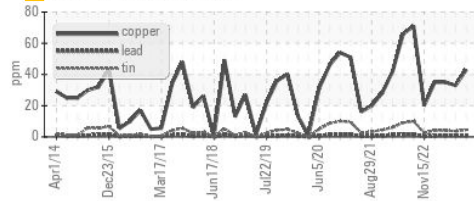


Viscosity @ 40°C

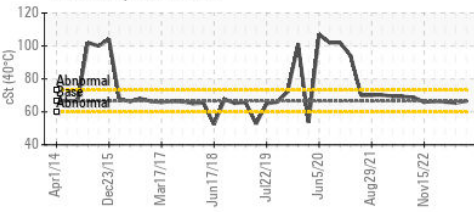

PQ

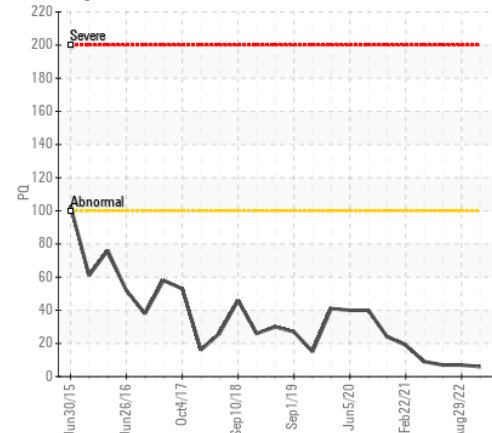

Acid Number

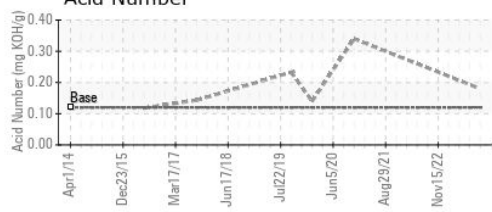

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 HUSKY SEA ROSE /AKER SOLUTIONS
Sample No. : PP **Received** : 02 Jan 2024
Lab Number : 02605971 **Diagnosed** : 03 Jan 2024
Unique Number : 5707057 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: KF)
 To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

ST. JOHN'S, NL
 CA A1C 6C9
 Contact: Maintenance Supervisor
 maintsuper.searose@huskyenergy.ca
 T: x:
 F: x: