




PROBLEM SUMMARY

Sample Rating Trend

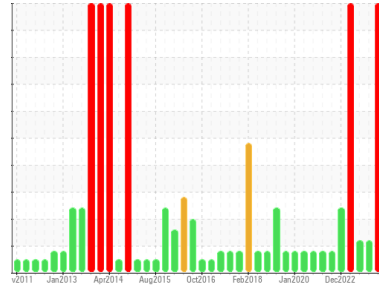


WEAR




Area
System 56 - Hazardous Drains
 Machine Id
Z-5601B Centrifuge Gearbox Lube Oil
 Component
Gearbox
 Fluid
GEAR OIL ISO 320 (13 LTR)

COMPONENT CONDITION SUMMARY

Non-ferrous Metals

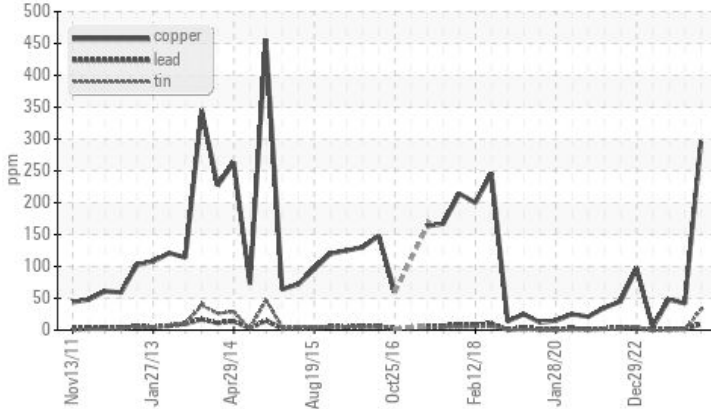

Particle Trend

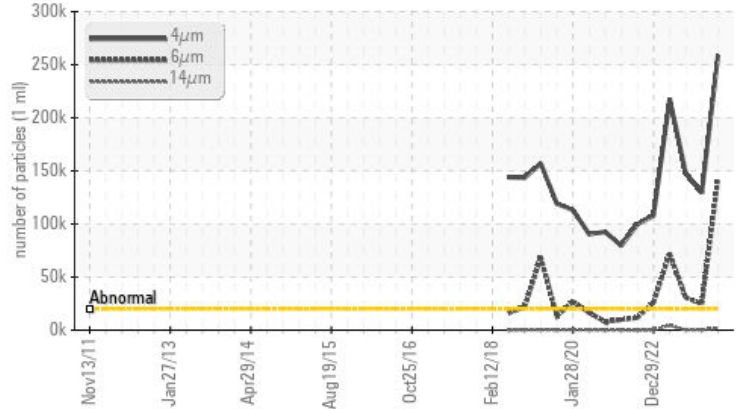

RECOMMENDATION

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. Please specify the brand, type, and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS

Sample Status			SEVERE	ABNORMAL	ABNORMAL	
Copper	ppm	ASTM D5185(m)	>80	296	42	48
Tin	ppm	ASTM D5185(m)	>8	32	1	<1
Particles >4µm		ASTM D7647	>20000	258866	129380	147853
Particles >6µm		ASTM D7647	>5000	141754	24750	30616
Particles >14µm		ASTM D7647	>640	1909	198	191
Oil Cleanliness		ISO 4406 (c)	>21/19/16	25/24/18	24/22/15	24/22/15

Customer Id: HIBSTJ
 Sample No.: WC0861476
 Lab Number: 02606103
 Test Package: MAR 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	Resample in 30-45 days to monitor this situation.
Information Required	---	---	?	Please specify the brand, type, and viscosity of the oil on your next sample.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.

HISTORICAL DIAGNOSIS

16 Oct 2023 Diag: Wes Davis



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.



08 Aug 2023 Diag: Wes Davis



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.



11 Mar 2023 Diag: Kevin Marson




Check seals and/or filters for points of contaminant entry. We advise that you check all areas where contaminants can enter the system. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend that you drain the oil from the component if this has not already been done. Resample in 30-45 days to monitor this situation. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. Particles >6µm are severely high. Oil Cleanliness are severely high. Particles >4µm are severely high. Particles >4µm are severely high. ppm Water and water and water and water contamination levels are abnormal. Particles >14µm are abnormally high. Particles >21µm are abnormally high. There is a moderate concentration of water present in the oil. Free water present. The white residue present in the sample is oil additive precipitate. Viscosity of sample indicates oil is within ISO 320 range, advise investigate. The AN level is acceptable for this fluid. The oil is no longer serviceable due to the presence of contaminants.





OIL ANALYSIS REPORT

Sample Rating Trend

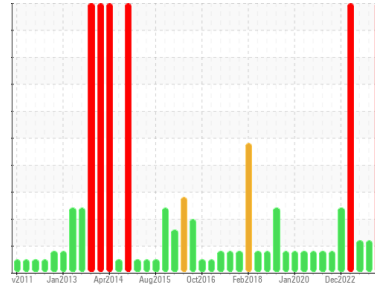

WEAR



Area
System 56 - Hazardous Drains
 Machine Id
Z-5601B Centrifuge Gearbox Lube Oil
 Component
Gearbox
 Fluid
GEAR OIL ISO 320 (13 LTR)

DIAGNOSIS

Recommendation

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

Copper and tin ppm levels are severe.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible.

Fluid Condition

The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0861476	PP	PP
Sample Date	Client Info		13 Dec 2023	16 Oct 2023	08 Aug 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>150	17	22	14
Chromium	ppm	ASTM D5185(m)	>10	0	0	<1
Nickel	ppm	ASTM D5185(m)	>10	2	<1	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	<1	0
Aluminum	ppm	ASTM D5185(m)	>5	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>65	9	2	2
Copper	ppm	ASTM D5185(m)	>80	296	42	48
Tin	ppm	ASTM D5185(m)	>8	32	1	<1
Antimony	ppm	ASTM D5185(m)	>5	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	50	10	4	3
Barium	ppm	ASTM D5185(m)	15	<1	<1	<1
Molybdenum	ppm	ASTM D5185(m)	15	0	0	0
Manganese	ppm	ASTM D5185(m)		0	<1	<1
Magnesium	ppm	ASTM D5185(m)	50	1	4	2
Calcium	ppm	ASTM D5185(m)	50	3	10	7
Phosphorus	ppm	ASTM D5185(m)	350	216	224	239
Zinc	ppm	ASTM D5185(m)	100	12	27	10
Sulfur	ppm	ASTM D5185(m)	12500	6059	6105	6478
Lithium	ppm	ASTM D5185(m)		1	<1	<1

CONTAMINANTS






	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>20	2	9	6
Sodium	ppm	ASTM D5185(m)		2	7	4
Potassium	ppm	ASTM D5185(m)	>20	3	<1	<1
Water	%	ASTM D6304*	>0.2	0.009	0.006	0.032
ppm Water	ppm	ASTM D6304*	>2000	97	65.0	327.5

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	258866	129380	147853
Particles >6µm	ASTM D7647	>5000	141754	24750	30616
Particles >14µm	ASTM D7647	>640	1909	198	191
Particles >21µm	ASTM D7647	>160	76	31	46
Particles >38µm	ASTM D7647	>40	1	6	4
Particles >71µm	ASTM D7647	>10	0	5	2
Oil Cleanliness	ISO 4406 (c)	>21/19/16	25/24/18	24/22/15	24/22/15



OIL ANALYSIS REPORT

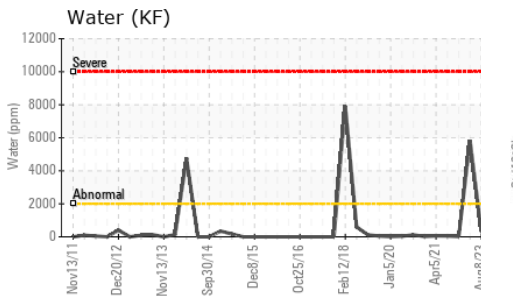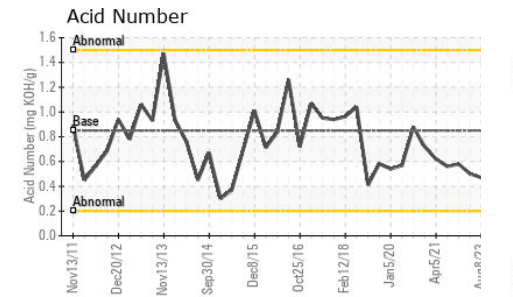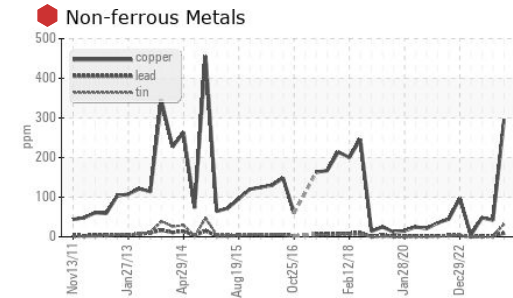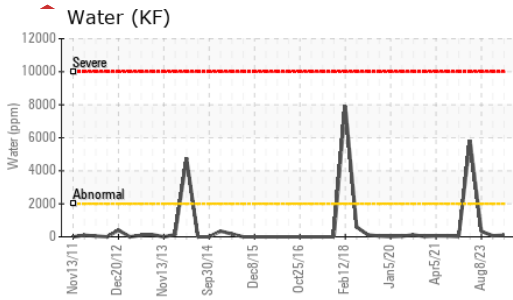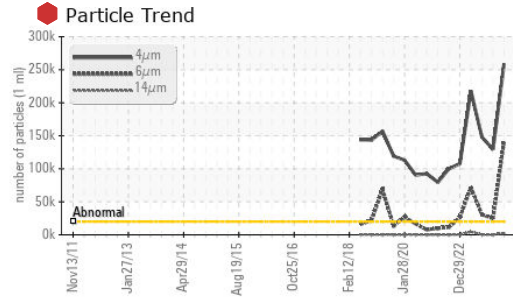






FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.85	0.57	0.48	0.47

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	VLITE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	VLITE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	VLITE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	.2%
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	320	321	319	316

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						

GRAPHS

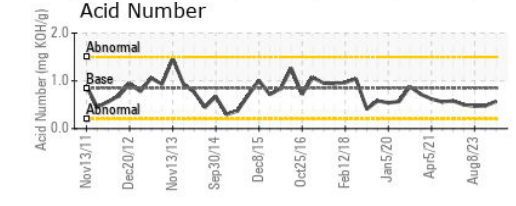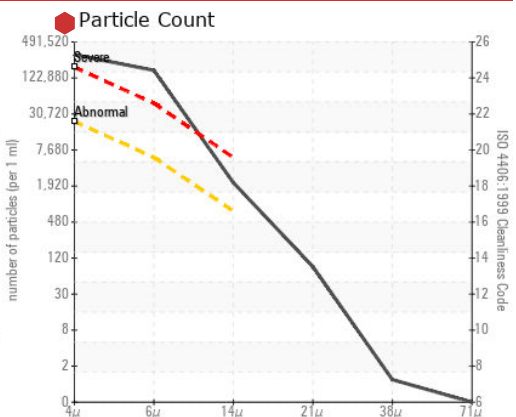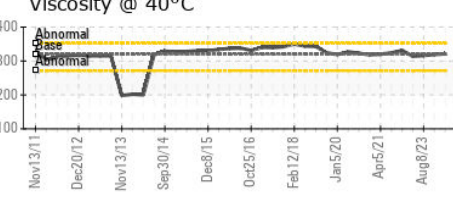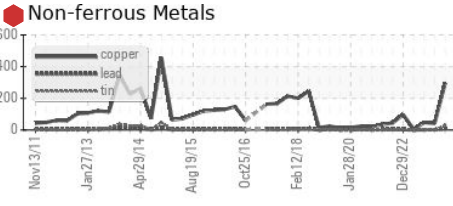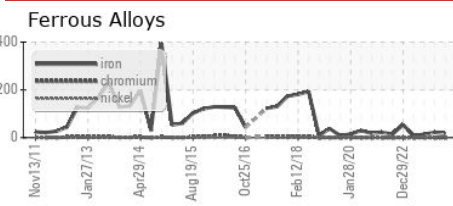

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 HIBERNIA MGMT & DEVELOPMENT CO. LTD
Sample No. : WC0861476 **Received** : 02 Jan 2024
Lab Number : 02606103 **Diagnosed** : 03 Jan 2024
Unique Number : 5707189 **Diagnostician** : Kevin Marson
Test Package : MAR 2 (Additional Tests: KF, PrtCount, TAN Man)

SUITE 1000,, 100 NEW GOWER STREET
 ST.JOHNS, NL
 CA A1C 6K3
 Contact: Christopher Michelau
 christopher.j.michelau@exxonmobil.com
 T:
 F: (709)722-3766

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.