




OIL ANALYSIS REPORT



Area
Gatineau Hosp. Ch#1 Circ A
 Machine Id
CARRIER 3208Q16362(1A)
 Component
Chiller
 Fluid
COMP OIL (ESTER) ISO 220 (--- GAL)

Sample Rating Trend

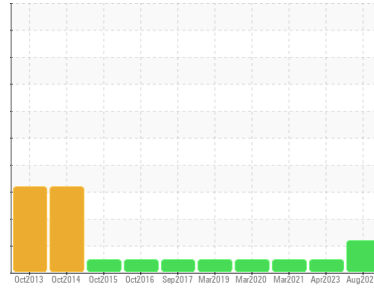

DEGRADATION



DIAGNOSIS

Recommendation
 Do NOT change the oil. Resample in 3-4 months or 2500 hours. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear
 All component wear rates are normal.

Contamination
 The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition
 The AN level is at the top-end of the recommended limit. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GTT0001467	GTT11039	GTT11040
Sample Date	Client Info		23 Aug 2023	05 Apr 2023	01 Mar 2021
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >8	1	<1	1
Chromium	ppm	ASTM D5185(m) >2	0	<1	<1
Nickel	ppm	ASTM D5185(m)	0	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m) >2	0	---	---
Aluminum	ppm	ASTM D5185(m) >3	<1	<1	<1
Lead	ppm	ASTM D5185(m) >2	<1	<1	<1
Copper	ppm	ASTM D5185(m) >8	2	<1	<1
Tin	ppm	ASTM D5185(m) >4	0	<1	<1
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 5	1	---	---
Barium	ppm	ASTM D5185(m) 5	0	---	---
Molybdenum	ppm	ASTM D5185(m) 5	0	---	---
Manganese	ppm	ASTM D5185(m)	0	---	---
Magnesium	ppm	ASTM D5185(m) 5	0	---	---
Calcium	ppm	ASTM D5185(m) 5	0	---	---
Phosphorus	ppm	ASTM D5185(m) 400	32	---	---
Zinc	ppm	ASTM D5185(m) 5	4	2	1
Sulfur	ppm	ASTM D5185(m) 100	17	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	6	---	---
Sodium	ppm	ASTM D5185(m)	2	---	---
Potassium	ppm	ASTM D5185(m) >20	<1	---	---
ppm Water	ppm	ASTM D6304* >100	81	82	209



FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.40	▲ 0.14	0.094	0.124

OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	220	179	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS



Sample No. : GTT0001467 **Recieved** : 03 Jan 2024
Lab Number : 02606347 **Diagnosed** : 09 Jan 2024
Unique Number : 5707433 **Diagnostician** : Bill Quesnel
Test Package : IND 2 (Additional Tests: KV40)

To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.

Test denoted () outside scope of accreditation, (m) method modified, (e) tested at external lab.*

Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.

Carrier Commerical Service
 C/O Conduent Div of Carrier Canada, 1-2740 Matheson Blvd
 Mississauga, ON
 CA L4W 4X3
 Contact: Brian Raymundo
 Brian.Raymundo@carrier.com

T:
F: