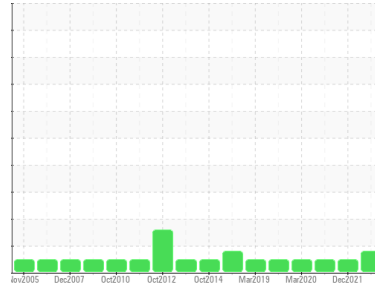




Area
Queens Univ. Chernoff Ch#2
 Machine Id
CARRIER 2301Q65662
 Component
Chiller
 Fluid
ICI EMKARATE RL 46H (--- GAL)



DIAGNOSIS

▲ Recommendation

This unit should be monitored closely by a service engineer as these wear conditions tend to advance rapidly. We recommend an early resample to monitor this condition.

▲ Wear

Tin ppm levels are abnormal. The tin reading shows moderate wear occurring on the compressor bearings or motor bearings.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GTT0001430	GTT8597	GTT8598
Sample Date	Client Info		02 Sep 2023	30 Dec 2021	01 Mar 2021
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >8	<1	<1	<1
Chromium	ppm	ASTM D5185(m) >2	0	<1	<1
Nickel	ppm	ASTM D5185(m)	<1	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m) >2	0	---	---
Aluminum	ppm	ASTM D5185(m) >3	<1	<1	<1
Lead	ppm	ASTM D5185(m) >2	0	<1	<1
Copper	ppm	ASTM D5185(m) >8	2	2	<1
Tin	ppm	ASTM D5185(m) >4	▲ 5	<1	<1
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<1	---	---
Barium	ppm	ASTM D5185(m) 0	0	---	---
Molybdenum	ppm	ASTM D5185(m) 0	0	---	---
Manganese	ppm	ASTM D5185(m) 0	0	---	---
Magnesium	ppm	ASTM D5185(m) 0	<1	---	---
Calcium	ppm	ASTM D5185(m) 0	0	---	---
Phosphorus	ppm	ASTM D5185(m) 1900	1913	---	---
Zinc	ppm	ASTM D5185(m) 0	4	1	<1
Sulfur	ppm	ASTM D5185(m) 25	4	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	42	---	---
Sodium	ppm	ASTM D5185(m)	<1	---	---
Potassium	ppm	ASTM D5185(m) >20	<1	---	---
ppm Water	ppm	ASTM D6304* >100	42	288	127

FLUID DEGRADATION



	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.03	0.02	0.017	0.008

OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	46.8	43.0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color					no image	no image
Bottom					no image	no image

GRAPHS



Sample No. : GTT0001430 **Recieved** : 03 Jan 2024
Lab Number : **02606353** **Diagnosed** : 09 Jan 2024
Unique Number : 5707439 **Diagnostician** : Bill Quesnel
Test Package : IND 2 (Additional Tests: KV40)

To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.

Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.

Carrier Commerical Service
 C/O Conduent Div of Carrier Canada, 1-2740 Matheson Blvd
 Mississauga, ON
 CA L4W 4X3
 Contact: Brian Raymundo
 Brian.Raymundo@carrier.com

T:
F: