




OIL ANALYSIS REPORT



Area
Carleton U- Athletics Ch#1-1
 Machine Id
TRANE U04M08759(1,1)
 Component
Chiller
 Fluid
TRANE 0048 (--- GAL)

Sample Rating Trend

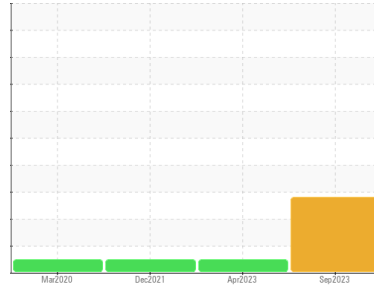

WATER



DIAGNOSIS

▲ Recommendation

If not recently done change any filter driers to reduce moisture level. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a trace of moisture present in the oil.

▲ Fluid Condition

The AN level is at the top-end of the recommended limit. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GTT0001418	GTT77575	GTT77576
Sample Date	Client Info		14 Sep 2023	05 Apr 2023	07 Dec 2021
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >8	<1	<1	1
Chromium	ppm	ASTM D5185(m) >2	0	<1	<1
Nickel	ppm	ASTM D5185(m)	0	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m) >2	0	---	---
Aluminum	ppm	ASTM D5185(m) >3	<1	<1	<1
Lead	ppm	ASTM D5185(m) >2	<1	<1	<1
Copper	ppm	ASTM D5185(m) >8	<1	<1	<1
Tin	ppm	ASTM D5185(m) >4	0	<1	<1
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 1	2	---	---
Barium	ppm	ASTM D5185(m) 0	0	---	---
Molybdenum	ppm	ASTM D5185(m) 0	0	---	---
Manganese	ppm	ASTM D5185(m) 0	0	---	---
Magnesium	ppm	ASTM D5185(m) 0	<1	---	---
Calcium	ppm	ASTM D5185(m) 0	0	---	---
Phosphorus	ppm	ASTM D5185(m) 5	5	---	---
Zinc	ppm	ASTM D5185(m) 0	3	5	3
Sulfur	ppm	ASTM D5185(m) 10	0	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	14	---	---
Sodium	ppm	ASTM D5185(m)	0	---	---
Potassium	ppm	ASTM D5185(m) >20	4	---	---
ppm Water	ppm	ASTM D6304* >300	▲ 581	332	163


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.09	▲ 0.19	0.115	0.052

OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68	55.1	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS



Sample No. : GTT0001418 **Recieved** : 03 Jan 2024
Lab Number : **02606404** **Diagnosed** : 12 Jan 2024
Unique Number : 5707490 **Diagnostician** : Bill Quesnel
Test Package : IND 2 (Additional Tests: KV40)

To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.

Test denoted () outside scope of accreditation, (m) method modified, (e) tested at external lab.*

Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.

Carrier Commerical Service
 C/O Conduent Div of Carrier Canada, 1-2740 Matheson Blvd
 Mississauga, ON
 CA L4W 4X3
 Contact: Brian Raymundo
 Brian.Raymundo@carrier.com

T:
F: