




# OIL ANALYSIS REPORT

Sample Rating Trend

**WATER**



Area  
**220 Simcoe Ch#3 [792224]**  
 Machine Id  
**YORK SCFM390280**  
 Component  
**Chiller**  
 Fluid  
**YORK TYPE K (--- GAL)**

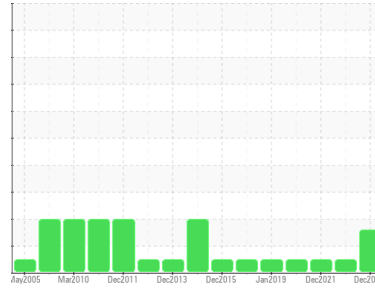

## DIAGNOSIS

### ▲ Recommendation

If not recently done change any filter driers to reduce moisture level. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a trace of moisture present in the oil. The elevated moisture content is associated with POE oils which are hygroscopic, and can absorb moisture from sampling and processing.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>GTT0001503</b>	GTT62667	GTT62668
Sample Date	Client Info		<b>20 Dec 2023</b>	07 Mar 2023	22 Dec 2021
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>MARGINAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >8	<b>3</b>	<1	<1
Chromium	ppm	ASTM D5185(m) >2	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Silver	ppm	ASTM D5185(m) >2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m) >3	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185(m) >2	<b>&lt;1</b>	<1	<1
Copper	ppm	ASTM D5185(m) >8	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m) >4	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185(m)	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Barium	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Calcium	ppm	ASTM D5185(m) 0	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185(m) 5	<b>0</b>	---	---
Zinc	ppm	ASTM D5185(m) 0	<b>7</b>	2	1
Sulfur	ppm	ASTM D5185(m) 10	<b>0</b>	---	---
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	<b>11</b>	---	---
Sodium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185(m) >20	<b>5</b>	---	---
ppm Water	ppm	ASTM D6304* >300	<b>▲ 649</b>	50	296



## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.03	<b>0.05</b>	0.031	0.031

# OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	---	---
Silt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Debris	scalar	Visual*	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	32.0	<b>27.5</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

## GRAPHS



**Sample No.** : GTT0001503      **Recieved** : 03 Jan 2024  
**Lab Number** : **02606409**      **Diagnosed** : 12 Jan 2024  
**Unique Number** : 5707495      **Diagnostician** : Bill Quesnel  
**Test Package** : IND 2 ( Additional Tests: KV40 )

*To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.*

*Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.*

*Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.*

**Ainsworth Electric**  
 131 Bermondsey Road  
 Toronto, ON  
 CA M4A 1X4  
 Contact: Service Manager  
 invoices@ainsworth.com  
 T: (905)694-6302  
 F: