




# FUEL REPORT

Sample Rating Trend

ISO

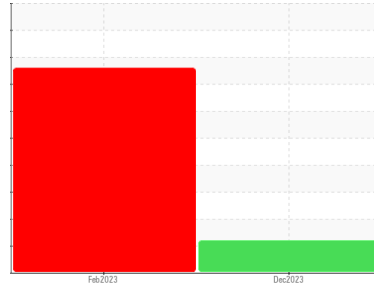

Area  
**[1879916]**  
 Machine Id  
**19-GRES-01-006-F**  
 Component  
**Diesel Fuel**  
 Fluid  
**No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)**

## DIAGNOSIS

### Recommendation

Laboratory test indicate that this fuel is suitable for use and meets all test requirements. We advise that you filter this fluid before use. We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

### Corrosion

{not applicable}

### Contaminants

There is a moderate amount of silt (particulates < 14 microns in size) present in the fuel. The water content is negligible.

### Fuel Condition

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B). The fuel is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0786860</b>	WC0786859	---
Sample Date	Client Info	<b>13 Dec 2023</b>	22 Feb 2023	---
Machine Age	hrs	<b>0</b>	0	---
Sample Status		<b>ABNORMAL</b>	SEVERE	---

## PHYSICAL PROPERTIES

method	limit/base	current	history1	history2		
Specific Gravity	ASTM D1298*	0.839	<b>0.816</b>	0.817	---	
Fuel Color	text	Visual Screen*	Yllow	<b>Red</b>	Pink	---
Visc @ 40°C	cSt	ASTM D7279(m)	3.0	<b>2.4</b>	2.5	---
Pensky-Martens Flash Point	°C	ASTM D7215*	52	<b>63.3</b>	63.2	---

## SULFUR CONTENT

method	limit/base	current	history1	history2		
Sulfur	ppm	ASTM D5185(m)	10	<b>10</b>	10	---

## DISTILLATION

method	limit/base	current	history1	history2		
Initial Boiling Point	°C	ASTM D2887*	165	<b>174</b>	174	---
5% Distillation Point	°C	ASTM D2887*		<b>189</b>	189	---
10% Distill Point	°C	ASTM D2887*	201	<b>198</b>	198	---
15% Distillation Point	°C	ASTM D2887*		<b>205</b>	206	---
20% Distill Point	°C	ASTM D2887*	216	<b>212</b>	213	---
30% Distill Point	°C	ASTM D2887*	230	<b>229</b>	229	---
40% Distill Point	°C	ASTM D2887*	243	<b>244</b>	244	---
50% Distill Point	°C	ASTM D2887*	255	<b>259</b>	260	---
60% Distill Point	°C	ASTM D2887*	267	<b>273</b>	274	---
70% Distill Point	°C	ASTM D2887*	280	<b>288</b>	288	---
80% Distill Point	°C	ASTM D2887*	295	<b>304</b>	305	---
85% Distillation Point	°C	ASTM D2887*		<b>315</b>	316	---
90% Distill Point	°C	ASTM D2887*	310	<b>326</b>	327	---
95% Distillation Point	°C	ASTM D2887*		<b>345</b>	345	---
Final Boiling Point	°C	ASTM D2887*	341	<b>357</b>	358	---

## IGNITION QUALITY

method	limit/base	current	history1	history2	
API Gravity	ASTM D1298*	37.7	<b>41</b>	41	---
Cetane Index	ASTM D4737*	<40.0	<b>57</b>	57	---

## CONTAMINANTS






method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185(m)	<1.0	<b>0</b>	0	---
Sodium	ppm	ASTM D5185(m)	<0.1	<b>&lt;1</b>	0	---
Potassium	ppm	ASTM D5185(m)	<0.1	<b>0</b>	0	---
Water	%	ASTM D6304*	<0.05	<b>0.002</b>	0.002	---
ppm Water	ppm	ASTM D6304*	<500	<b>20</b>	17.3	---

## FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>2500	<b>▲ 7366</b>	▲ 18222	---
Particles >6µm	ASTM D7647	>640	<b>▲ 1518</b>	■ 7076	---
Particles >14µm	ASTM D7647	>80	<b>36</b>	■ 1048	---
Particles >21µm	ASTM D7647	>20	<b>6</b>	■ 380	---
Particles >38µm	ASTM D7647	>4	<b>1</b>	▲ 24	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	2	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	<b>▲ 20/18/12</b>	■ 21/20/17	---






# FUEL REPORT

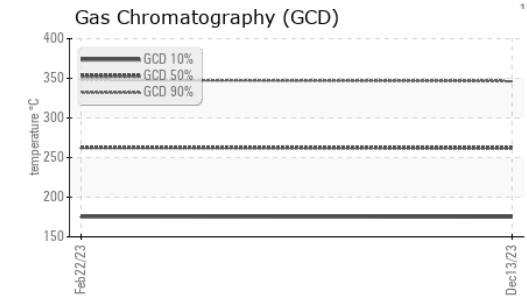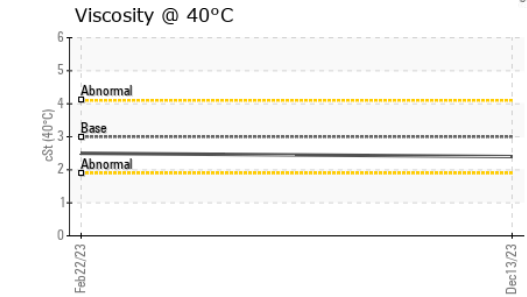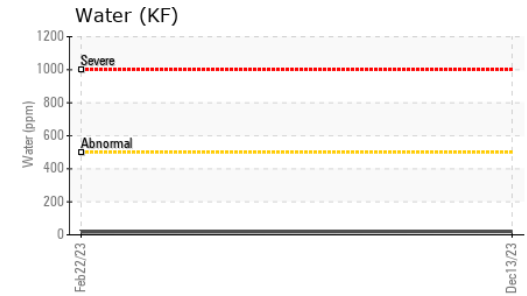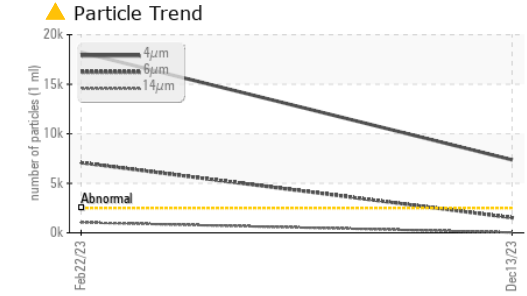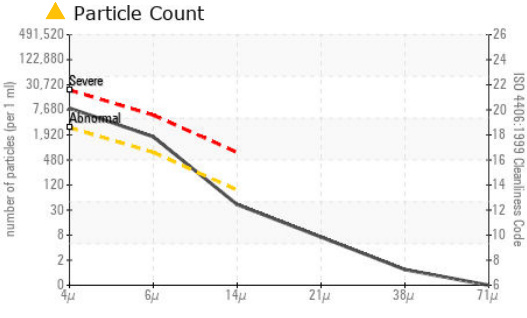

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	0	0	---
Nickel	ppm	ASTM D5185(m)	<0.1	0	0	---
Lead	ppm	ASTM D5185(m)	<0.1	0	0	---
Vanadium	ppm	ASTM D5185(m)	<0.1	0	0	---
Iron	ppm	ASTM D5185(m)	<0.1	0	<1	---
Calcium	ppm	ASTM D5185(m)	<0.1	<1	<1	---
Magnesium	ppm	ASTM D5185(m)	<0.1	0	<1	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	<1	<1	---
Zinc	ppm	ASTM D5185(m)	<0.1	<1	<1	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						no image
Bottom						no image

## GRAPHS

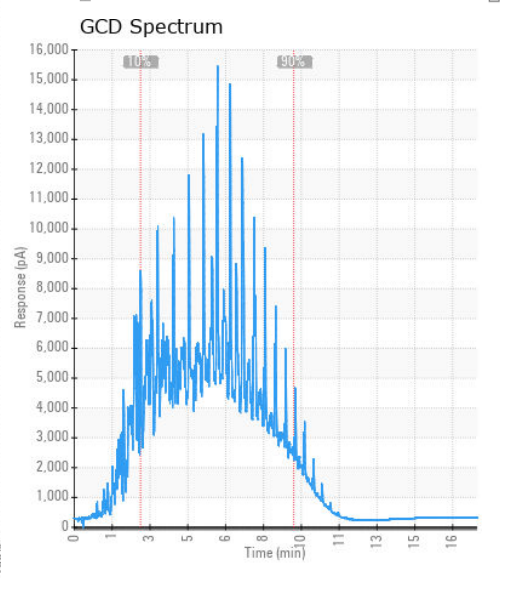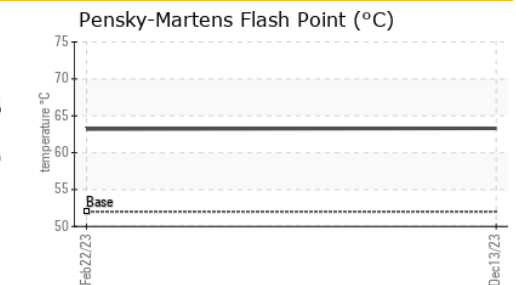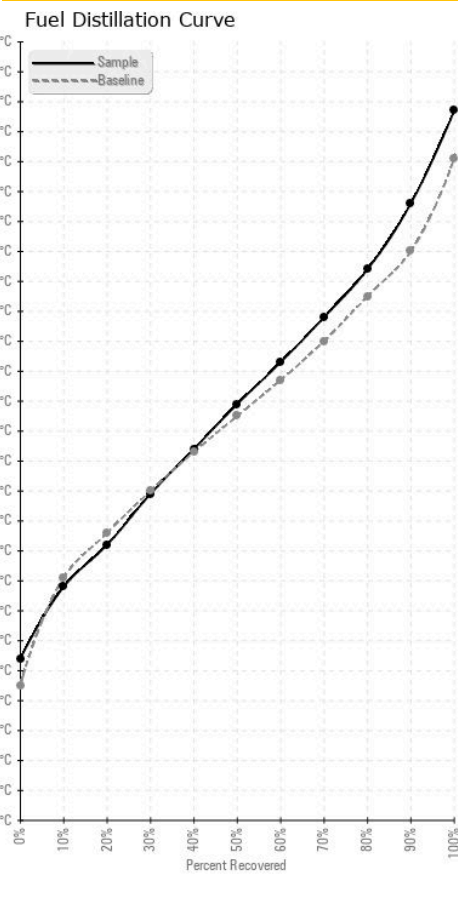

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0786860 **Received** : 05 Jan 2024  
**Lab Number** : 02606854 **Diagnosed** : 08 Jan 2024  
**Unique Number** : 5707940 **Diagnostician** : Kevin Marson  
**Test Package** : FUEL ( Additional Tests: CC Flash, GC-PercFuel, PrtCount )  
 To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**Adrenalube - 9042628 Canada Inc**  
 3755 - E Boul Matte  
 Brossard, QC  
 CA J4Y 2P4  
 Contact: Pierre Beauchamp  
 support-tech@adrenalube.com  
 T: (514)999-5546  
 F: