




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

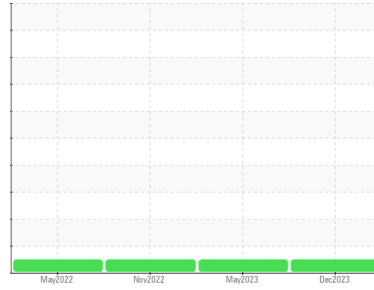

Area
ASPIRE BRANTFORD [4501223531]
 Machine Id
FRICK C7 (S/N F0142VFMCTHAA03)
 Component
7 Screw Compressor
 Fluid
CIMCO TYPE A (90 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0869719	WC0817812	WC0759236
Sample Date	Client Info		23 Dec 2023	31 May 2023	30 Nov 2022
Machine Age	hrs	Client Info	101116	101046	97072
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		Not Changed	Not Changed	Not Changed
Sample Status			NORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >60	1	1	1
Chromium	ppm	ASTM D5185(m) >4	0	0	0
Nickel	ppm	ASTM D5185(m)	<1	0	<1
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	0
Aluminum	ppm	ASTM D5185(m) >5	<1	0	0
Lead	ppm	ASTM D5185(m) >10	0	0	0
Copper	ppm	ASTM D5185(m) >30	<1	0	0
Tin	ppm	ASTM D5185(m) >15	0	0	0
Antimony	ppm	ASTM D5185(m)	0	<1	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	<1	<1
Barium	ppm	ASTM D5185(m)	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	0	<1	0
Calcium	ppm	ASTM D5185(m)	<1	0	0
Phosphorus	ppm	ASTM D5185(m)	0	<1	<1
Zinc	ppm	ASTM D5185(m)	<1	<1	<1
Sulfur	ppm	ASTM D5185(m)	57	71	73
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >50	0	<1	0
Sodium	ppm	ASTM D5185(m)	0	0	<1
Potassium	ppm	ASTM D5185(m) >20	<1	<1	0
Water	%	ASTM D6304* >0.1	0.002	0.00	0.001
ppm Water	ppm	ASTM D6304* >1000	20	0.00	10.0

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	609	8868	---
Particles >6µm	ASTM D7647	>2500	113	1966	---
Particles >14µm	ASTM D7647	>320	10	101	---
Particles >21µm	ASTM D7647	>80	4	24	---
Particles >38µm	ASTM D7647	>20	1	1	---
Particles >71µm	ASTM D7647	>4	0	0	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	16/14/10	20/18/14	---



OIL ANALYSIS REPORT

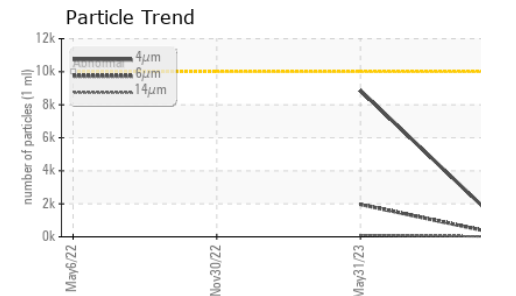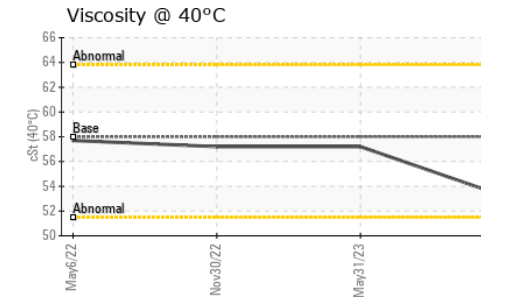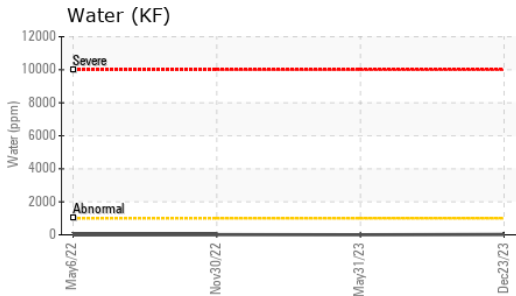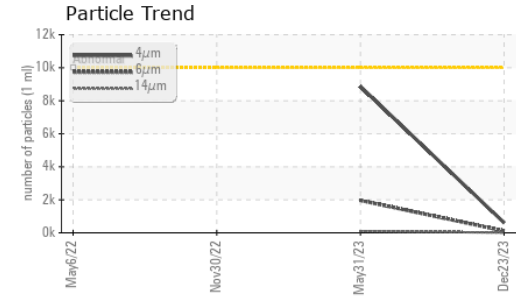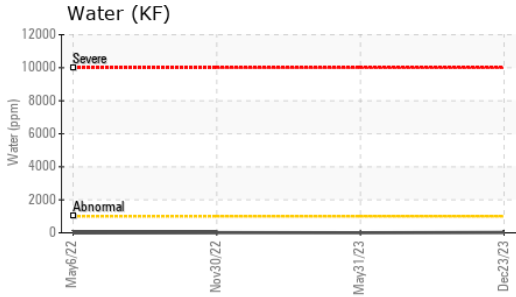


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.05	0.01	0.01	0.01






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	58	53.2	57.2	57.2

SAMPLE IMAGES

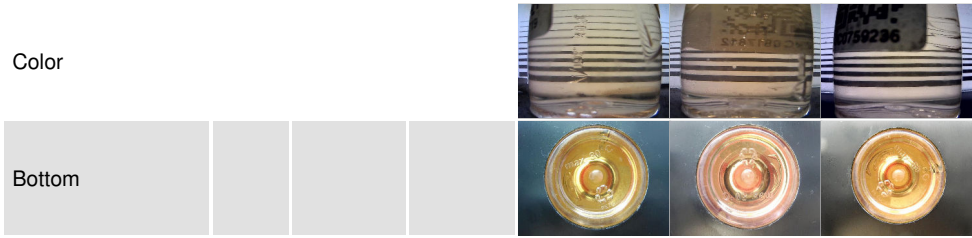

GRAPHS

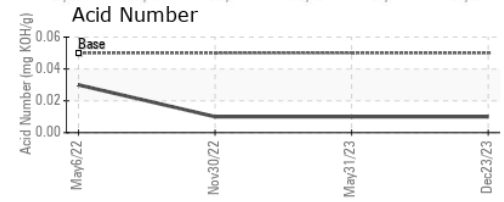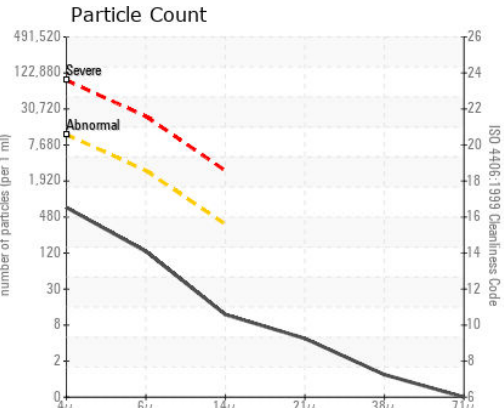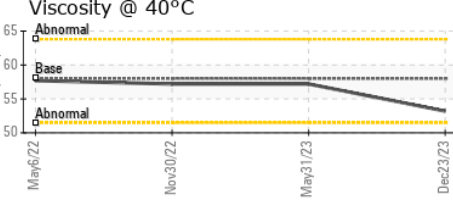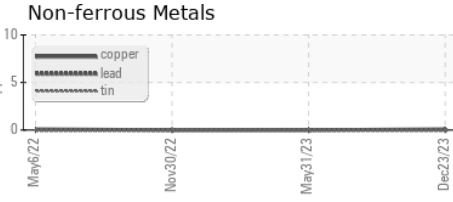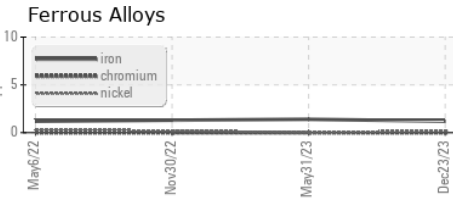

ISO 17025:2017 Accredited Laboratory
 Laboratory Sample No. : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
 Lab Number : 02607094 Recieved : 08 Jan 2024
 Unique Number : 5708180 Diagnosed : 10 Jan 2024
 Test Package : IND 2 (Additional Tests: KF, TAN Man) Diagnostician : Wes Davis
 To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

CIMCO Refrigeration
 1551 Corporate Drive
 Burlington, ON
 CA L7L 6M3
 Contact: DAVID PARISE
 DPARISE@ToROMONT.COM
 T: (416)465-7581
 F: (416)465-8815