


OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

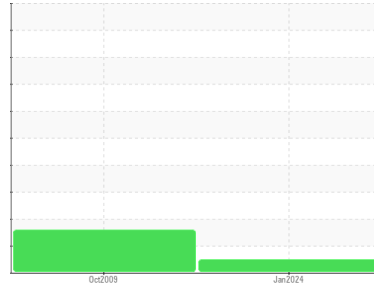

Area
[227963]
Machine Id
KOHLER CFIA
Component
Front Diesel Engine
Fluid
PETRO CANADA 15W40 (40 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

Metal levels are typical for a new component breaking in.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|----------|
| Sample Number | Client Info | | | WA0020865 | AP66223 | --- |
| Sample Date | Client Info | | | 03 Jan 2024 | 29 Oct 2009 | --- |
| Machine Age | hrs | Client Info | | 480 | 740 | --- |
| Oil Age | hrs | Client Info | | 50 | 40 | --- |
| Oil Changed | Client Info | | | Changed | Changed | --- |
| Sample Status | | | | NORMAL | ABNORMAL | --- |

| CONTAMINATION | | method | limit/base | current | history1 | history2 |
|---------------|-----------|--------|------------|----------------|----------|----------|
| Fuel | WC Method | >3.0 | | <1.0 | <1.0 | --- |
| Water | WC Method | >0.2 | | NEG | NEG | --- |
| Glycol | WC Method | | | NEG | NEG | --- |


| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|---------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185(m) | >200 | 3 | 40 | --- |
| Chromium | ppm | ASTM D5185(m) | >20 | 0 | 2 | --- |
| Nickel | ppm | ASTM D5185(m) | >2 | 0 | 0 | --- |
| Titanium | ppm | ASTM D5185(m) | >2 | 0 | <1 | --- |
| Silver | ppm | ASTM D5185(m) | >2 | 0 | <1 | --- |
| Aluminum | ppm | ASTM D5185(m) | >30 | 1 | 1 | --- |
| Lead | ppm | ASTM D5185(m) | >30 | 1 | 5 | --- |
| Copper | ppm | ASTM D5185(m) | >30 | 3 | 3 | --- |
| Tin | ppm | ASTM D5185(m) | >15 | <1 | 5 | --- |
| Antimony | ppm | ASTM D5185(m) | | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185(m) | | 0 | 0 | --- |
| Beryllium | ppm | ASTM D5185(m) | | 0 | --- | --- |
| Cadmium | ppm | ASTM D5185(m) | | 0 | --- | --- |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|---------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185(m) | | 7 | 2 | --- |
| Barium | ppm | ASTM D5185(m) | | 0 | <1 | --- |
| Molybdenum | ppm | ASTM D5185(m) | | 55 | <1 | --- |
| Manganese | ppm | ASTM D5185(m) | | 0 | <1 | --- |
| Magnesium | ppm | ASTM D5185(m) | | 916 | 8 | --- |
| Calcium | ppm | ASTM D5185(m) | | 1081 | 2535 | --- |
| Phosphorus | ppm | ASTM D5185(m) | | 997 | 921 | --- |
| Zinc | ppm | ASTM D5185(m) | | 1141 | 1110 | --- |
| Sulfur | ppm | ASTM D5185(m) | | 2689 | 5043 | --- |
| Lithium | ppm | ASTM D5185(m) | | <1 | --- | --- |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|---------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185(m) | >30 | 3 | ▲ 60 | --- |
| Sodium | ppm | ASTM D5185(m) | | 1 | 4 | --- |
| Potassium | ppm | ASTM D5185(m) | >20 | <1 | 0 | --- |









| INFRA-RED | | method | limit/base | current | history1 | history2 |
|-----------|----------|-------------|------------|-------------|----------|----------|
| Soot % | % | ASTM D7844* | >3 | 0 | 0.2 | --- |
| Nitration | Abs/cm | ASTM D7624* | >20 | 5.3 | 5.7 | --- |
| Sulfation | Abs./1mm | ASTM D7415* | >30 | 18.1 | 20.7 | --- |

OIL ANALYSIS REPORT

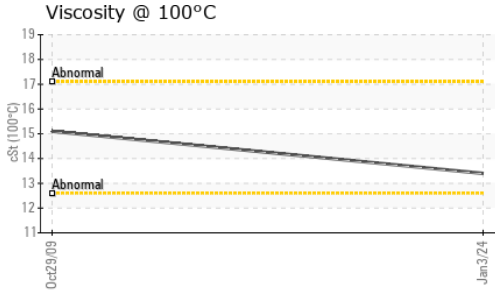

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|---------------|------------|-------------|----------|----------|
| Oxidation | Abs./1mm | ASTM D7414* | >25 | 13.5 | 10.9 | --- |
| VISUAL | | method | limit/base | current | history1 | history2 |
| Emulsified Water | scalar | Visual* | >0.2 | NEG | NEG | --- |
| Free Water | scalar | Visual* | | NEG | NEG | --- |
| FLUID PROPERTIES | | method | limit/base | current | history1 | history2 |
| Visc @ 100°C | cSt | ASTM D7279(m) | | 13.4 | 15.1 | --- |

GRAPHS

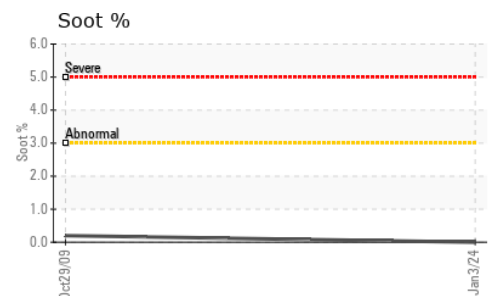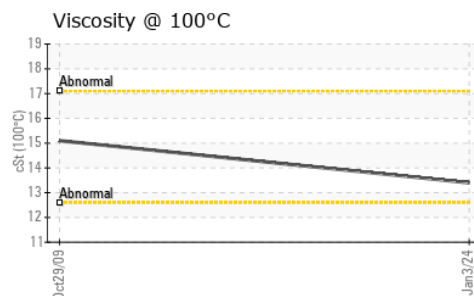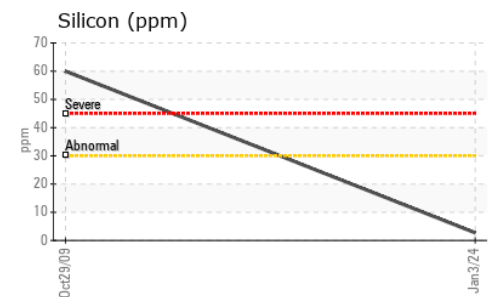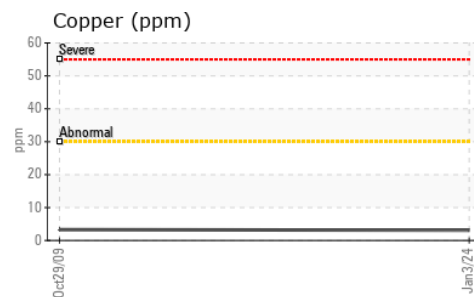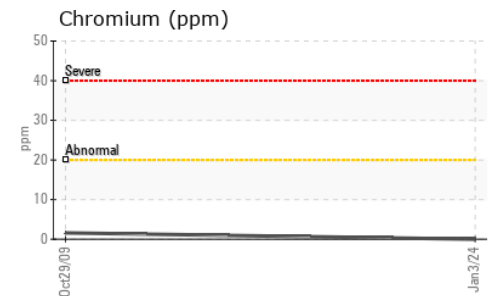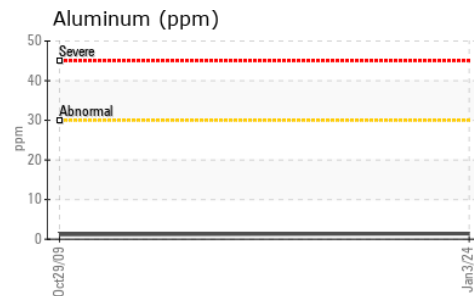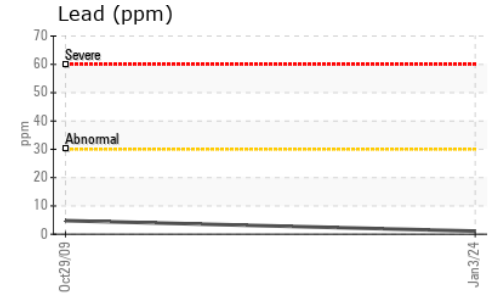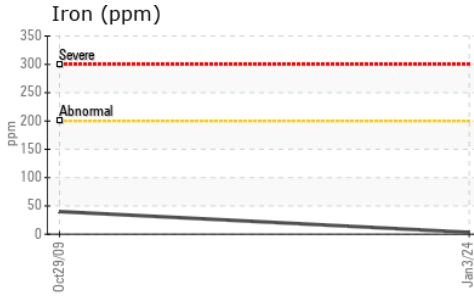

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0020865 **Received** : 09 Jan 2024
Lab Number : **02607385** **Diagnosed** : 09 Jan 2024
Unique Number : 5708471 **Diagnostician** : Wes Davis
Test Package : MOB 1

Wajax Power Systems
 70 Raddall Avenue
 Dartmouth, NS
 CA B3B 1T7
 Contact: Danelle Hoffman
 dhoffman@wajax.com
 T: (902)468-6200
 F: (902)468-3325

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.