


# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

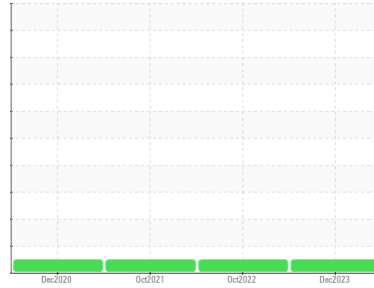

Area  
**HALIFAX WATER - 132 TRINITY LANE**  
Machine Id  
**JOHN DEERE PE4045T504296**  
Component  
**Diesel Engine**  
Fluid  
**SHELL ROTELLA T 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WA0020860</b>	WA0018595	WA0016902
Sample Date	Client Info			<b>29 Dec 2023</b>	27 Oct 2022	29 Oct 2021
Machine Age	hrs	Client Info		<b>4468</b>	422	322
Oil Age	hrs	Client Info		<b>0</b>	100	0
Oil Changed	Client Info			<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>2.1		<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.21		<b>NEG</b>	NEG	NEG
Glycol	WC Method			<b>NEG</b>	NEG	0.0


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>51	<b>1</b>	3	1
Chromium	ppm	ASTM D5185(m)	>11	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Titanium	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Silver	ppm	ASTM D5185(m)	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>31	<b>1</b>	<1	<1
Lead	ppm	ASTM D5185(m)	>26	<b>0</b>	0	0
Copper	ppm	ASTM D5185(m)	>26	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m)	>4	<b>0</b>	<1	0
Antimony	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	35	<b>2</b>	14	164
Barium	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)	0	<b>56</b>	52	5
Manganese	ppm	ASTM D5185(m)	0	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185(m)	10	<b>946</b>	878	88
Calcium	ppm	ASTM D5185(m)	2340	<b>1027</b>	1159	1914
Phosphorus	ppm	ASTM D5185(m)	1110	<b>998</b>	1073	962
Zinc	ppm	ASTM D5185(m)	1210	<b>1130</b>	1194	1073
Sulfur	ppm	ASTM D5185(m)	3890	<b>2717</b>	2706	2852
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>22	<b>2</b>	3	4
Sodium	ppm	ASTM D5185(m)	>31	<b>1</b>	2	2
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	7










INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*	>20	<b>4.6</b>	5.5	5.3
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>17.8</b>	18.9	21.0

# OIL ANALYSIS REPORT

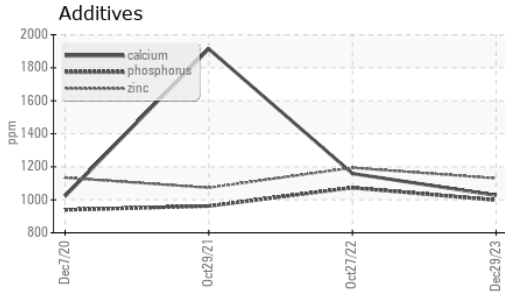

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	<b>13.1</b>	14.2	15.7
VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.21	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	15.7	<b>14.6</b>	14.9	14.5

## GRAPHS

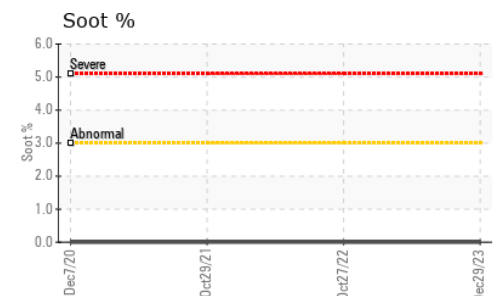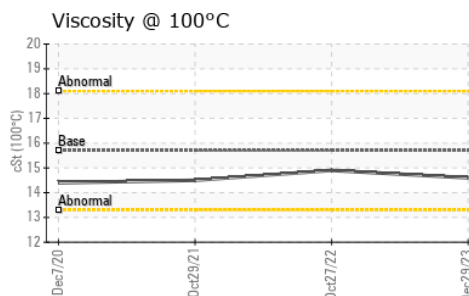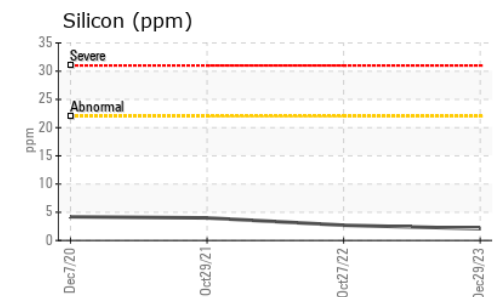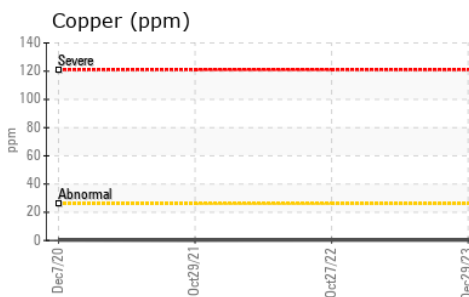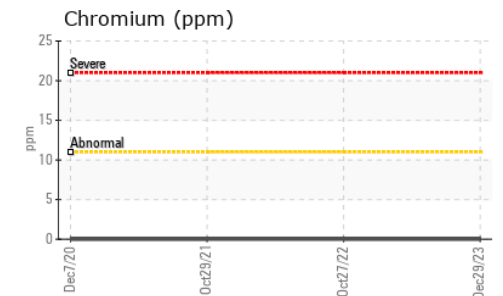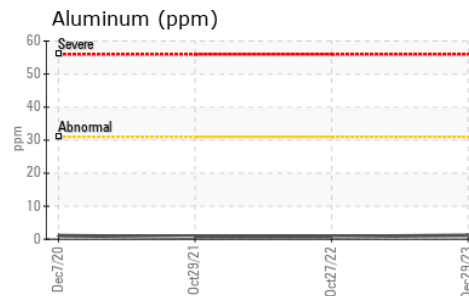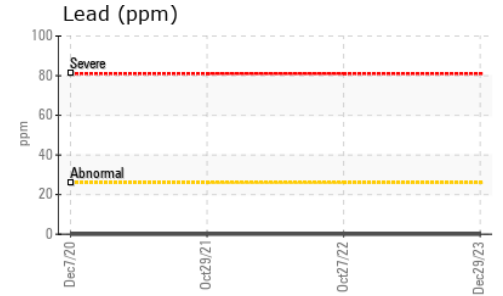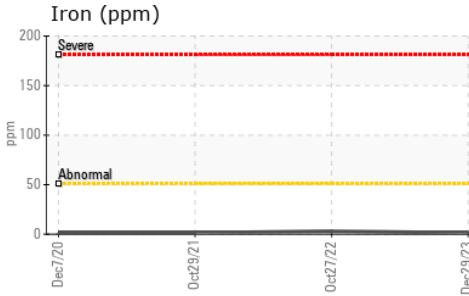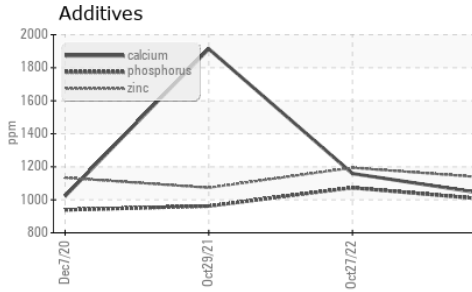

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WA0020860 **Received** : 09 Jan 2024  
**Lab Number** : **02607386** **Diagnosed** : 09 Jan 2024  
**Unique Number** : 5708472 **Diagnostician** : Wes Davis  
**Test Package** : MOB 1

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**Wajax Power Systems**  
 70 Raddall Avenue  
 Dartmouth, NS  
 CA B3B 1T7  
 Contact: Danelle Hoffman  
 dhoffman@wajax.com  
 T: (902)468-6200  
 F: (902)468-3325