



OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area
NEW OIL TEST
 Machine Id
Syn Flo 70 GC
 Component
Reservoir Rotary Screw Compressor - Bearings/Rotors
 Fluid
Syn Flo 70 GC (--- GAL)



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC	---	---
Sample Date	Client Info		08 Jan 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			NORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >50	0	---	---
Chromium	ppm	ASTM D5185(m) >10	0	---	---
Nickel	ppm	ASTM D5185(m)	0	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m)	0	---	---
Aluminum	ppm	ASTM D5185(m) >25	<1	---	---
Lead	ppm	ASTM D5185(m) >25	<1	---	---
Copper	ppm	ASTM D5185(m) >50	0	---	---
Tin	ppm	ASTM D5185(m) >15	0	---	---
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	---	---
Barium	ppm	ASTM D5185(m)	716	---	---
Molybdenum	ppm	ASTM D5185(m)	0	---	---
Manganese	ppm	ASTM D5185(m)	0	---	---
Magnesium	ppm	ASTM D5185(m)	<1	---	---
Calcium	ppm	ASTM D5185(m)	<1	---	---
Phosphorus	ppm	ASTM D5185(m)	44	---	---
Zinc	ppm	ASTM D5185(m)	<1	---	---
Sulfur	ppm	ASTM D5185(m)	191	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	3	---	---
Sodium	ppm	ASTM D5185(m)	<1	---	---
Potassium	ppm	ASTM D5185(m) >20	<1	---	---
Water	%	ASTM D6304* >0.1	0.071	---	---
ppm Water	ppm	ASTM D6304* >1000	717	---	---

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	519	---	---
Particles >6µm	ASTM D7647	>2500	147	---	---
Particles >14µm	ASTM D7647	>320	20	---	---
Particles >21µm	ASTM D7647	>80	9	---	---
Particles >38µm	ASTM D7647	>20	3	---	---
Particles >71µm	ASTM D7647	>4	3	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	16/14/11	---	---



OIL ANALYSIS REPORT

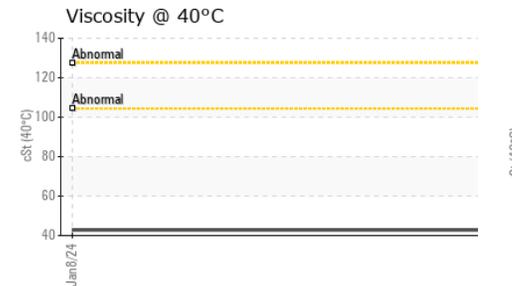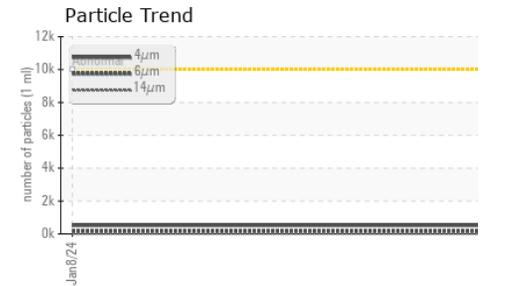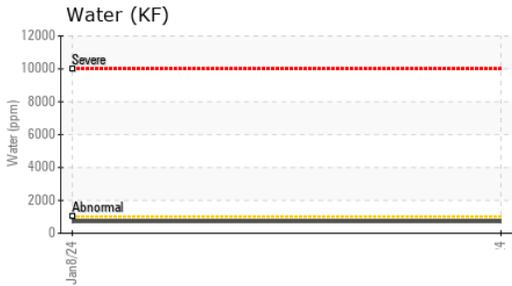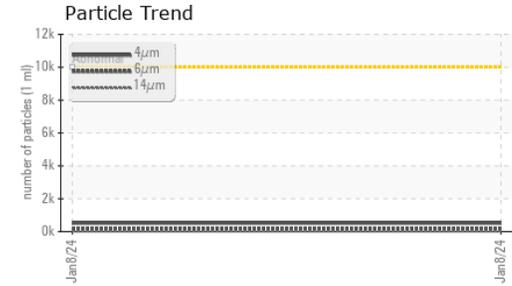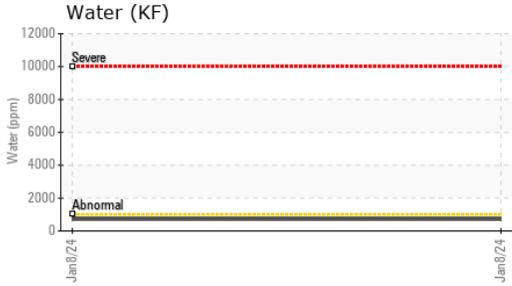

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.03	---	---



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	---	---
Precipitate	scalar	Visual*	NONE	---	---
Silt	scalar	Visual*	NONE	---	---
Debris	scalar	Visual*	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	---	---
Appearance	scalar	Visual*	NORML	---	---
Odor	scalar	Visual*	NORML	---	---
Emulsified Water	scalar	Visual*	>0.1	---	---
Free Water	scalar	Visual*	---	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	42.8	---	---

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color			no image	no image
Bottom			no image	no image

GRAPHS

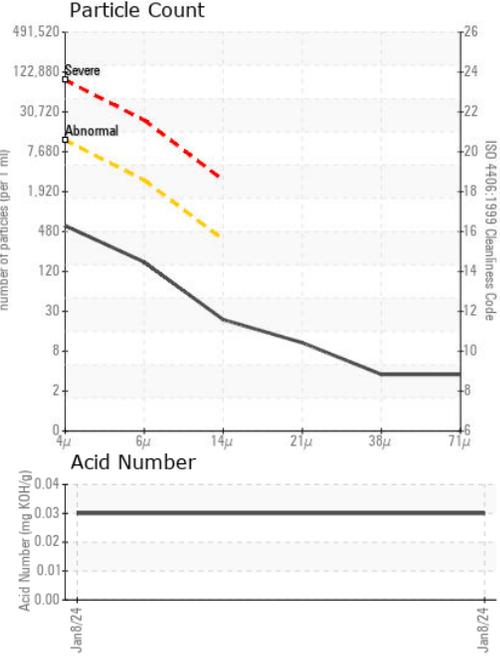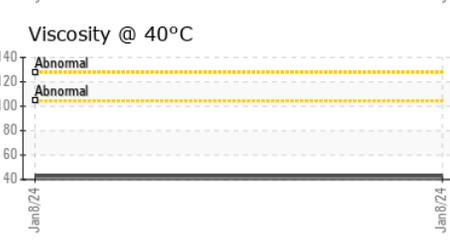

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC **Received** : 09 Jan 2024
Lab Number : **02607490** **Diagnosed** : 12 Jan 2024
Unique Number : 5708576 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: KF, TAN Man)

HIRAM WALKER & SONS LTD.
 2072 RIVERSIDE DRIVE EAST, BOX 2518
 WINDSOR, ON
 CA N8Y 4S5
 Contact: Matt Morand
 matt.morand@pernod-ricard.com
 T: (519)561-5359
 F: (519)971-5719

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.