

FUEL REPORT

Sample Rating Trend





Center Jet Fuel JET FUEL Type A (--- GAL)

DIAGNOSIS

Recommendation

Laboratory test indicate that this fuel is suitable for use and meets all test requirements. Resample at the next service interval to monitor.

Wear

{not applicable}

Contamination

There is no bacteria or fungus (yeast and/or mold) present in the sample. The water content is negligible. The fuel phase was tested for microbes, as there was no separate water phase present in the sample. The MicrobMonitor2 test kit was used to test for microbiological contamination in the sample. There is no indication of any contamination in the jet fuel.


Fluid Condition


All laboratory tests indicate that this sample appears to be Jet Fuel Type A.


				Jan2024		
		ام م مالخ م من			la ta ta mud	bists0
SAMPLE INFORM		method	limit/base	current	history1	history2
Sample Number		Client Info		WC0872245		
Sample Date		Client Info		08 Jan 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Specific Gravity		ASTM D1298*		0.810		
Fuel Color	text	Visual Screen*		Clear		
Visc @ 40°C	cSt	ASTM D7279(m)	<8.0	1.3		
Pensky-Martens Flash Point	°C	ASTM D7215*	38	51.6		
Pour Point	°C	ASTM D97*	-45	-60		
SULFUR CONTE	NT	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185(m)	<3000	846		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D2887*		159		
5% Distillation Point	°C	ASTM D2887*		175		
10% Distill Point	°C	ASTM D2007 ASTM D2887*	205	179		
15% Distillation Point	°C	ASTM D2887*	203	182		
20% Distill Point	°C	ASTM D2007 ASTM D2887*		186		
30% Distill Point	°C	ASTM D2007 ASTM D2887*		192		
40% Distill Point	°C	ASTM D2887*		200		
50% Distill Point	°C	ASTM D2887*		200		
	°C					
60% Distill Point	°C	ASTM D2887*		216		
70% Distill Point	-	ASTM D2887*		224		
80% Distill Point	°C	ASTM D2887*		236		
85% Distillation Point	°C	ASTM D2887*		245		
90% Distill Point	°C	ASTM D2887*		255		
95% Distillation Point	-	ASTM D2887*		271		
Final Boiling Point	°C	ASTM D2887*	300	299		
IGNITION QUALI	ΓY	method	limit/base	current	history1	history2
API Gravity		ASTM D1298*	44	43		
Cetane Index		ASTM D4737*	<40.0	45		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	<1.0	0		
Sodium	ppm	ASTM D5185(m)	<0.1	<1		
Potassium	ppm	ASTM D5185(m)	<0.1	0		
Water	%	ASTM D6304*	< 0.05	0.003		
ppm Water	ppm	ASTM D6304*	<500	28		
MICROBIAL		method	limit/base	current	history1	history2
Microbes	CEU/I	ASTM D6469*	>=100000	0		
	0.0/2			v		



FUEL REPORT





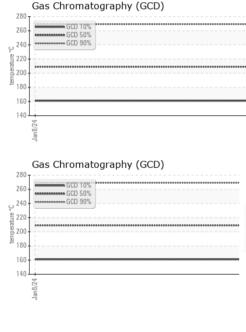

HEAVY METALS		method	limit/base	current	history1	history
Aluminum	ppm	ASTM D5185(m)	<0.1	0		
Nickel	ppm	ASTM D5185(m)	<0.1	0		
Lead	ppm	ASTM D5185(m)	<0.1	0		
Vanadium	ppm	ASTM D5185(m)	<0.1	0		
Iron	ppm	ASTM D5185(m)	<0.1	0		
Calcium	ppm	ASTM D5185(m)	<0.1	0		
Magnesium	ppm	ASTM D5185(m)	<0.1	0		
Phosphorus	ppm	ASTM D5185(m)	<0.1	<1		
Zinc	ppm	ASTM D5185(m)	<0.1	0		
SAMPLE IMAGE	S	method	limit/base	current	history1	history
Color					no image	no image
Bottom					no image	no image
GRAPHS						1
Fuel Distillation C	urve			Pensky-Marte	ns Flash Point ((°C)
Sample			65 -			
Baseline			60 · ب			
			ang 55 -			
			temp eratrure 50 -			
			45.			
			40-	Base		
- And Set 1994 1994				R /0		
: <mark>+</mark>						
:			9	Jan		
			1 I	GCD Spectrur	n	
- - -			28,000	,	n (90%)	
5 - 5 - 5 -			26,000	GCD Spectrur		
			1	GCD Spectrur		
		/	26,000	GCD Spectrur		
			26,000-	GCD Spectrur		
			26,000 - 24,000 - 22,000 - 20,000 - 18,000 -	GCD Spectrur		
			26,000 - 24,000 - 22,000 - 20,000 - 18,000 -	GCD Spectrur		
			26,000 - 24,000 - 22,000 - 20,000 - 18,000 -	GCD Spectrur		
			26,000 - 24,000 - 22,000 - 20,000 - 18,000 -	GCD Spectrur		
			26,000 - 24,000 - 22,000 - 20,000 -	GCD Spectrur		
	/		26,000- 24,000- 22,000- 20,000- 18,000- 18,000- 18,000- 80 14,000- 80 14,000- 80 12,000- 10,000-	GCD Spectrur		
			26,000- 24,000- 22,000- 20,000- 18,000- ¥G 16,000- 88,000- 10,000- 8,000-	GCD Spectrur		
			26,000- 24,000- 22,000- 20,000- 18,000- ₹16,000- ₹16,000- 8,000- 8,000- 6,000-	GCD Spectrur		
			26,000- 24,000- 22,000- 20,000- 18,000- 18,000- 11,000- 8,000- 6,000- 4,000-	GCD Spectrur		
			26,000- 24,000- 22,000- 20,000- 18,000- 18,000- 80,000- 8,000- 4,000- 2,000-	GCD Spectrur		
			26,000- 24,000- 22,000- 20,000- 18,000- 18,000- 8,000- 8,000- 4,000- 4,000- 2,000- 0,000- 4,000- 2,000- 2,000- 0,0	GCD Spectrur		
	ercent Recover		26,000- 24,000- 22,000- 20,000- 18,000- 18,000- 80,000- 8,000- 4,000- 2,000-	GCD Spectrur		13 - 13 - 15 - 15 - 15 - 15 - 15 - 15 -

Laboratory CALA Sample No. : WC0872245 Recieved : 09 Jan 2024 44 FASKEN DRIVE, UNIT 12/13 Lab Number : 02607631 ETOBICOKE, ON Diagnosed : 16 Jan 2024 ISO 17025:2017 Accredited Laboratory Unique Number : 5708717 Diagnostician : Kevin Marson CA M9W 5M8 Test Package : FUEL (Additional Tests: CC Flash, GC-PercFuel) Contact: Geoff Carroll To discuss this sample report, contact Customer Service at 1-800-268-2131. gcarroll@flysunwing.com Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. T: (416)802-9643 Validity of results and interpretation are based on the sample and information as supplied. F: (416)640-1595