


OIL ANALYSIS REPORT

Sample Rating Trend

WEAR



Area
630 Rene Levesque Ch# 3 [0065612-H00908]
 Machine Id
TRANE L89G-02680
 Component
Chiller
 Fluid
REFRIG COMP OIL ISO 68 (--- GAL)

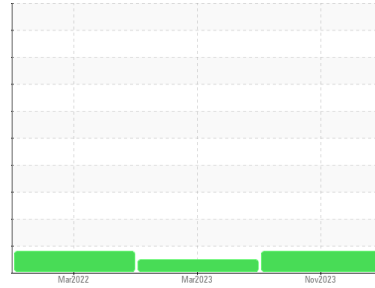

DIAGNOSIS

▲ Recommendation
 Resample at the end of the next operating season. Please specify the brand, type, and viscosity of the oil on your next sample.

▲ Wear
 Tin ppm levels are abnormal. Bearing wear is indicated.

Contamination
 The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition
 The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GTT0001562	GTT53330	GTT53331
Sample Date	Client Info		30 Nov 2023	08 Mar 2023	11 Mar 2022
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	NORMAL	MARGINAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >8	2	<1	<1
Chromium	ppm	ASTM D5185(m) >2	0	<1	<1
Nickel	ppm	ASTM D5185(m)	<1	---	---
Titanium	ppm	ASTM D5185(m)	0	---	---
Silver	ppm	ASTM D5185(m) >2	0	---	---
Aluminum	ppm	ASTM D5185(m) >3	<1	<1	<1
Lead	ppm	ASTM D5185(m) >2	0	<1	<1
Copper	ppm	ASTM D5185(m) >8	<1	<1	<1
Tin	ppm	ASTM D5185(m) >4	▲ 10	<1	▲ 2
Antimony	ppm	ASTM D5185(m)	0	---	---
Vanadium	ppm	ASTM D5185(m)	0	---	---
Beryllium	ppm	ASTM D5185(m)	0	---	---
Cadmium	ppm	ASTM D5185(m)	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 5	<1	---	---
Barium	ppm	ASTM D5185(m) 5	0	---	---
Molybdenum	ppm	ASTM D5185(m) 5	0	---	---
Manganese	ppm	ASTM D5185(m)	0	---	---
Magnesium	ppm	ASTM D5185(m) 5	0	---	---
Calcium	ppm	ASTM D5185(m) 12	0	---	---
Phosphorus	ppm	ASTM D5185(m) 12	0	---	---
Zinc	ppm	ASTM D5185(m) 12	<1	<1	<1
Sulfur	ppm	ASTM D5185(m) 1000	47	---	---
Lithium	ppm	ASTM D5185(m)	<1	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	15	---	---
Sodium	ppm	ASTM D5185(m)	0	---	---
Potassium	ppm	ASTM D5185(m) >20	2	---	---
ppm Water	ppm	ASTM D6304* >100	<10	15	31



FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.10	0.05	0.009	0.043

OIL ANALYSIS REPORT

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---
Precipitate	scalar	Visual*	NONE	NONE	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	68	77.4	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS



Sample No. : GTT0001562 **Recieved** : 09 Jan 2024
Lab Number : **02607648** **Diagnosed** : 16 Jan 2024
Unique Number : 5708734 **Diagnostician** : Bill Quesnel
Test Package : IND 2 (Additional Tests: KV40)

To discuss this sample report, contact Customer Service at 1-905-847-9300 Ext 26.

Test denoted () outside scope of accreditation, (m) method modified, (e) tested at external lab.*

Damages: Seller shall in no event be liable for special, incidental, or consequential damages, of a commercial nature, resulting from any cause.

Baulne Inc
 1850 32nd Avenue
 Montreal, QC
 CA H8T 3J7
 Contact: Paula Carvalho
 pcarvalho@baulne.ca
 T: (514)422-0444
 F: