

# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**[6100109042]**  
Machine Id  
**06D0307980**  
Component  
**Diesel Engine**  
Fluid  
**CASTROL HD SAE 40 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition.

**Wear**  
Les taux d'usure de tous les composants sont normaux.

**Contamination**  
Il n'y a aucun indice de contamination dans l'huile.

**Fluid Condition**  
L'état de l'huile est acceptable pour la durée de service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WA0019030</b>	---	---
Sample Date	Client Info			<b>09 Jan 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>Changed</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>3.0		<b>&lt;1.0</b>	---	---
Water	WC Method	>0.2		<b>NEG</b>	---	---
Glycol	WC Method			<b>NEG</b>	---	---


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>200	<b>7</b>	---	---
Chromium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185(m)	>2	<b>0</b>	---	---
Titanium	ppm	ASTM D5185(m)	>2	<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)	>2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m)	>30	<b>1</b>	---	---
Lead	ppm	ASTM D5185(m)	>30	<b>4</b>	---	---
Copper	ppm	ASTM D5185(m)	>30	<b>3</b>	---	---
Tin	ppm	ASTM D5185(m)	>15	<b>9</b>	---	---
Antimony	ppm	ASTM D5185(m)		<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<b>&lt;1</b>	---	---
Barium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m)		<b>102</b>	---	---
Manganese	ppm	ASTM D5185(m)		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185(m)		<b>14</b>	---	---
Calcium	ppm	ASTM D5185(m)		<b>2429</b>	---	---
Phosphorus	ppm	ASTM D5185(m)		<b>968</b>	---	---
Zinc	ppm	ASTM D5185(m)		<b>1019</b>	---	---
Sulfur	ppm	ASTM D5185(m)		<b>4700</b>	---	---
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>30	<b>9</b>	---	---
Sodium	ppm	ASTM D5185(m)		<b>5</b>	---	---
Potassium	ppm	ASTM D5185(m)	>20	<b>5</b>	---	---

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	<b>0</b>	---	---
Nitration	Abs/cm	ASTM D7624*	>20	<b>3.7</b>	---	---
Sulfation	Abs./1mm	ASTM D7415*	>30	<b>14.0</b>	---	---

# OIL ANALYSIS REPORT

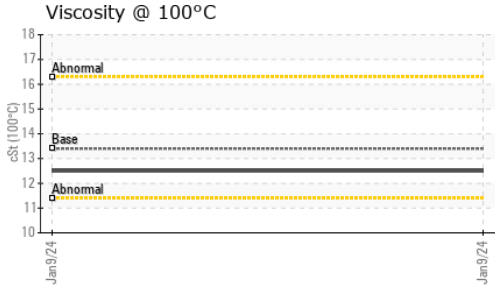


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	6.4	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	VLITE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---
Free Water	scalar	Visual*		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	13.4	12.5	---

## GRAPHS

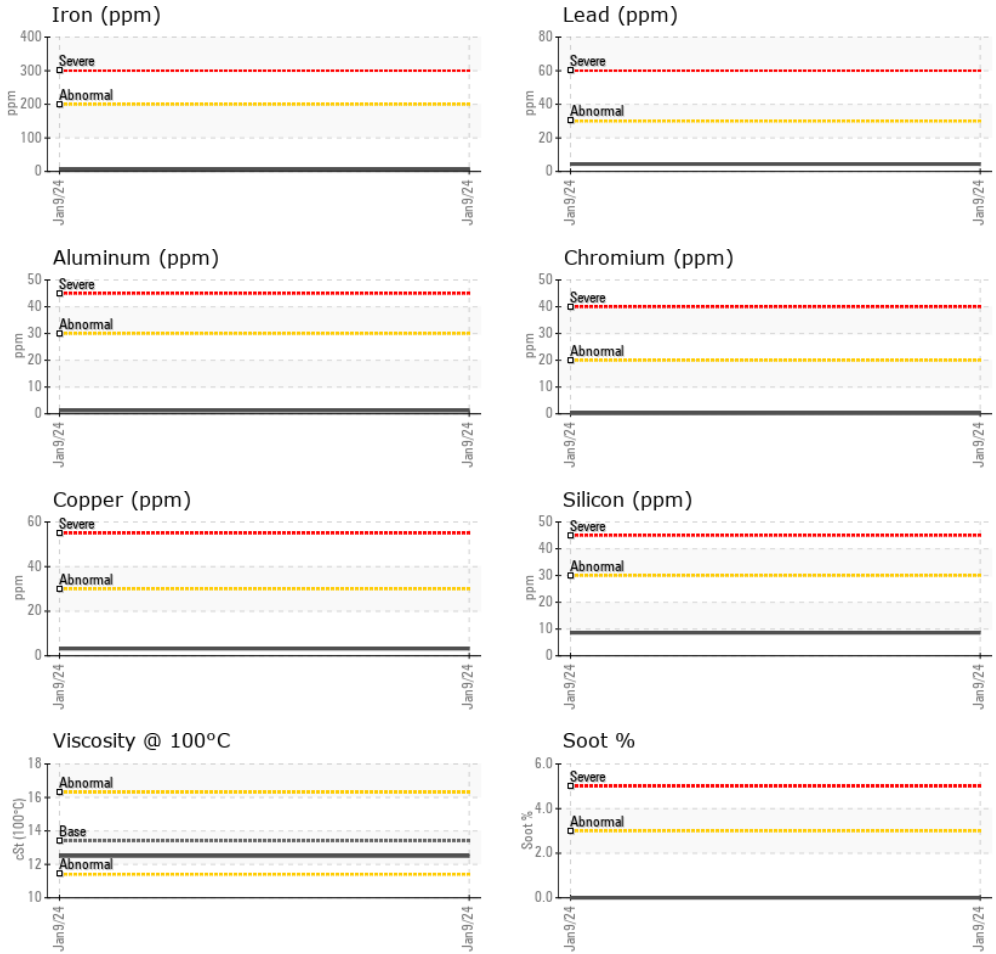

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WA0019030 **Received** : 11 Jan 2024  
**Lab Number** : 02608117 **Diagnosed** : 11 Jan 2024  
**Unique Number** : 5709203 **Diagnostician** : Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: Visual )

**Wajax Power Systems**  
 2997 AV. WATT  
 Quebec, QC  
 CA G1X 3W1  
 Contact: Steve Racine  
 sracine@wajax.com  
 T:  
 F: (418)651-4448

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.