




# PROBLEM SUMMARY

Sample Rating Trend

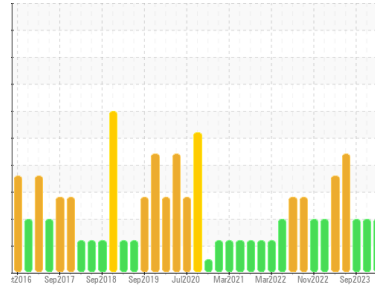


ISO



Area  
**BRUCE B/0B/54300**  
 Machine Id  
**0B-54300-EPG2-CP1-OIL**  
 Component  
**Compressor**  
 Fluid  
**ESSO NUTO H ISO 150 (--- GAL)**

## COMPONENT CONDITION SUMMARY

### Particle Trend

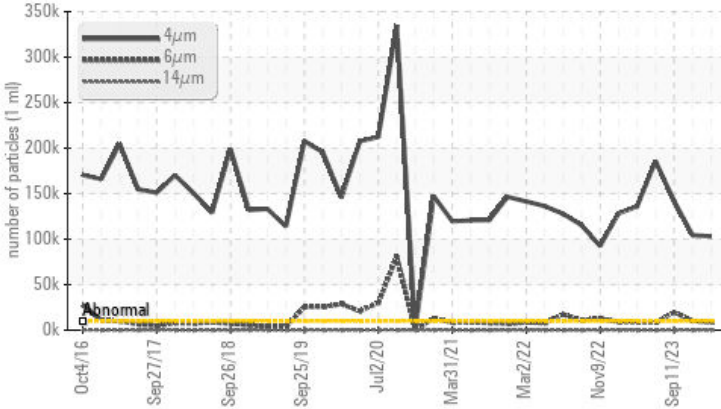

## RECOMMENDATION

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation.

## PROBLEMATIC TEST RESULTS

Sample Status			SEVERE	SEVERE	SEVERE
Particles >4µm	ASTM D7647	>10000	SEVERE 103030	104305	142015
Particles >6µm	ASTM D7647	>2500	SEVERE 8717	10145	19744
Oil Cleanliness	ISO 4406 (c)	>20/18/15	SEVERE 24/20/12	24/21/11	24/21/12
PrtFilter				no image	no image

Customer Id: BRUTIV  
 Sample No.: WC0642725  
 Lab Number: 02608208  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Kevin Marson +1 (289)291-4644 x4644  
[Kevin.Marson@wearcheck.com](mailto:Kevin.Marson@wearcheck.com)

To change component or sample information:  
 Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	Resample in 30-45 days to monitor this situation.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.

## HISTORICAL DIAGNOSIS

### 11 Dec 2023 Diag: Kevin Marson

ISO



Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



### 11 Sep 2023 Diag: Bill Quesnel

ISO



Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



### 11 Aug 2023 Diag: Kevin Marson

WATER



We advise that you check for the source of water entry. Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you follow the water drain-off procedure for this component. We advise that you use off-line filtration with water adsorbent filters to attempt to remove the water from this oil. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. There is a high amount of silt (particulates < 14 microns in size) present in the oil. Free water present. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report






# OIL ANALYSIS REPORT

Sample Rating Trend

ISO

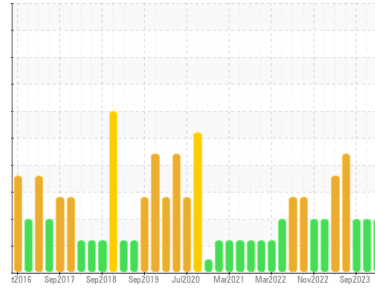

Area  
**BRUCE B/0B/54300**  
 Machine Id  
**0B-54300-EPG2-CP1-OIL**  
 Component  
**Compressor**  
 Fluid  
**ESSO NUTO H ISO 150 (--- GAL)**

## DIAGNOSIS

### Recommendation

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation.

### Wear

All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system.

### Contaminants

There is a high amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible.

### Oil Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0642725</b>	WC0677271	WC0642790
Sample Date	Client Info		<b>05 Jan 2024</b>	11 Dec 2023	11 Sep 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>SEVERE</b>	SEVERE	SEVERE

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>50	<b>4</b>	5	6
Chromium	ppm	ASTM D5185(m)	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185(m)	>25	<b>5</b>	5	5
Lead	ppm	ASTM D5185(m)	>25	<b>1</b>	<1	<1
Copper	ppm	ASTM D5185(m)	>50	<b>2</b>	2	2
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	1

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Barium	ppm	ASTM D5185(m)		<b>1</b>	2	2
Molybdenum	ppm	ASTM D5185(m)		<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)		<b>&lt;1</b>	1	<1
Calcium	ppm	ASTM D5185(m)		<b>43</b>	43	40
Phosphorus	ppm	ASTM D5185(m)		<b>340</b>	338	360
Zinc	ppm	ASTM D5185(m)		<b>414</b>	419	421
Sulfur	ppm	ASTM D5185(m)		<b>3185</b>	3035	3280
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1


## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>25	<b>5</b>	3	4
Sodium	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	<b>4</b>	<1	<1
Water	%	ASTM D6304*	>0.1	<b>0.002</b>	0.002	0.055
ppm Water	ppm	ASTM D6304*	>1000	<b>23</b>	24	551.0

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>103030</b>	104305	142015
Particles >6µm	ASTM D7647	>2500	<b>8717</b>	10145	19744
Particles >14µm	ASTM D7647	>320	<b>39</b>	18	25
Particles >21µm	ASTM D7647	>80	<b>9</b>	2	3
Particles >38µm	ASTM D7647	>20	<b>2</b>	0	0
Particles >71µm	ASTM D7647	>4	<b>2</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>24/20/12</b>	24/21/11	24/21/12

Particle Filter (Magn: 200 x)

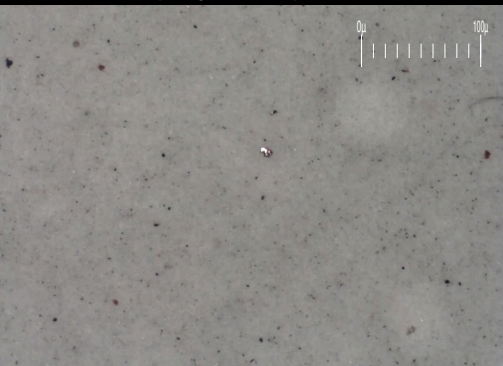



# OIL ANALYSIS REPORT

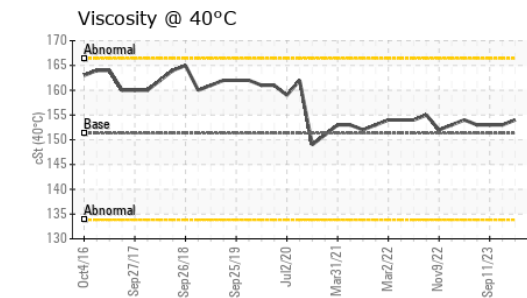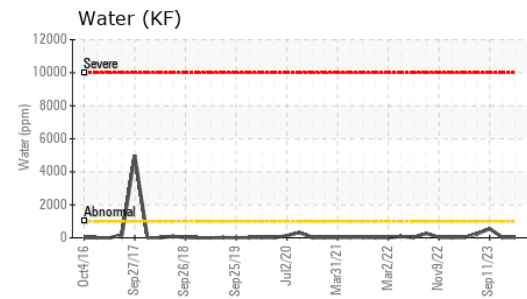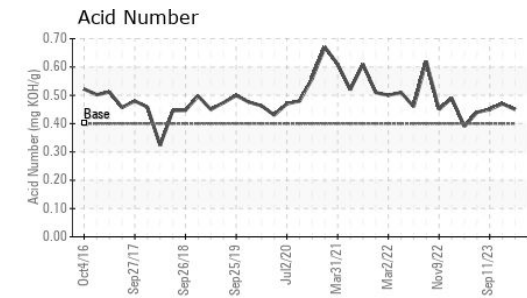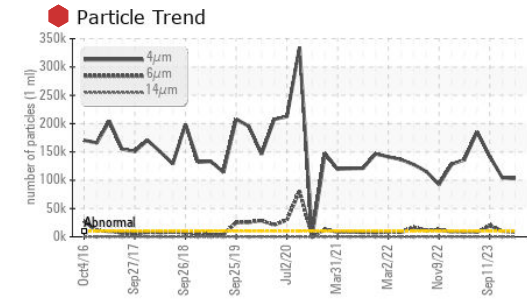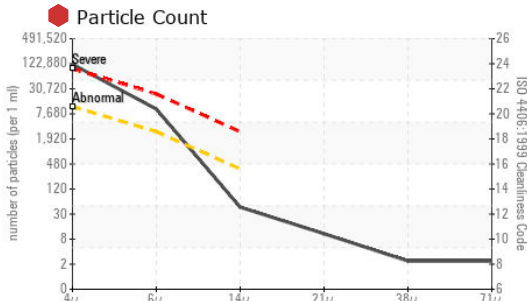

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	.40	<b>0.45</b>	0.47	0.45

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>HAZY</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	151.3	<b>154</b>	153	153

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color						
Bottom						
PrtFilter					no image	no image



**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0642725  
**Lab Number** : 02608208  
**Unique Number** : 5709294  
**Test Package** : IND 2 ( Additional Tests: A-FERR, BottomAnalysis, DR-FERR, FILTERPATCH, PrtFilter, RPVOT )

**Bruce Power - Bruce A PdM**  
 P.O.Box 1540, 177 Tie Road,, RM-222 U2 Column 2N11 615'  
 Tiverton, ON  
 CA N0G 2T0  
 Contact: Pierre Adouki  
 pierre.adouki@brucepower.com  
 T: (519)361-2673  
 F:


To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.



# FERROGRAPHY REPORT

Area  
**BRUCE B/0B/54300**  
 Machine Id  
**0B-54300-EPG2-CP1-OIL**  
 Component  
**Compressor**  
 Fluid  
**ESSO NUTO H ISO 150 (--- GAL)**


Magn: 200x Illum: BC

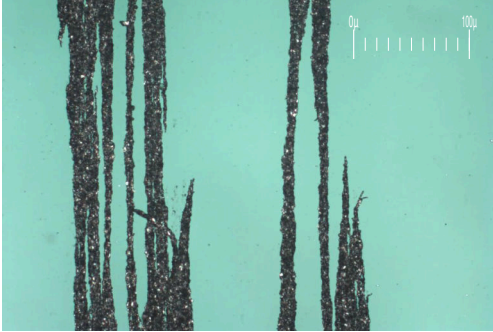

Magn: 50x Illum: RW



Magn: 100x Illum: RW

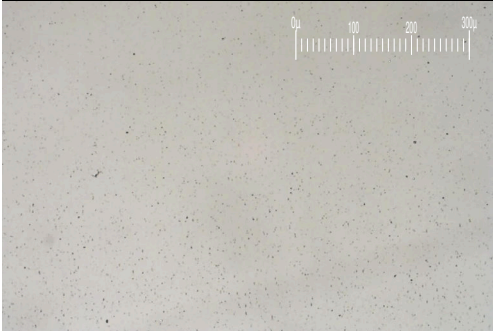


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		37.8	50.5	69.2
Small Particles		DR-Ferr*		17.4	24.3	33.8
Total Particles		DR-Ferr*	>---	55.2	74.8	103
Large Particles Percentage	%	DR-Ferr*		37	35	34.4
Severity Index		DR-Ferr*		771	1323	2450

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		4	4	3
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		2	2	1
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*		1	1	
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*		1	1	3
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*			1	2
Sand/Dirt	Scale 0-10	ASTM D7684*		1	1	2
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		1	1	

## WEAR

All component wear rates are normal.  
 The ferrography results are normal indicating no abnormal wear in the system.

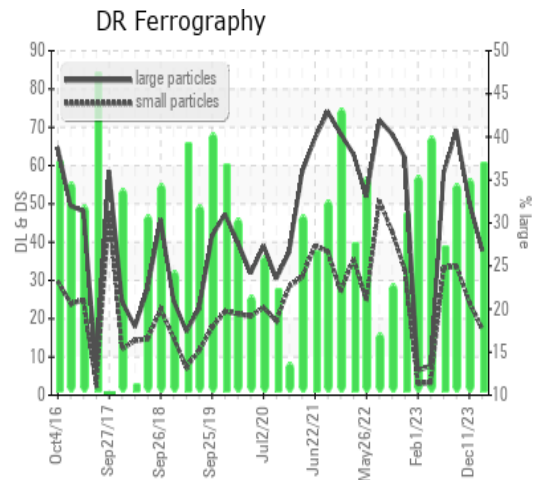

*This page left intentionally blank*