




PROBLEM SUMMARY


Area
(ZONE3) BRUCE A/1/34710
 Machine Id
1-34710-P1-P OB Ball/Sleeve
 Component
Outboard Bearing
 Fluid
MOBIL DTE 732 (--- GAL)

Sample Rating Trend

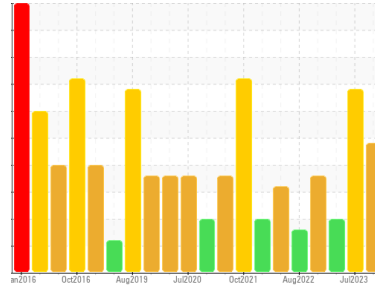


COMPONENT CONDITION SUMMARY

Particle Trend

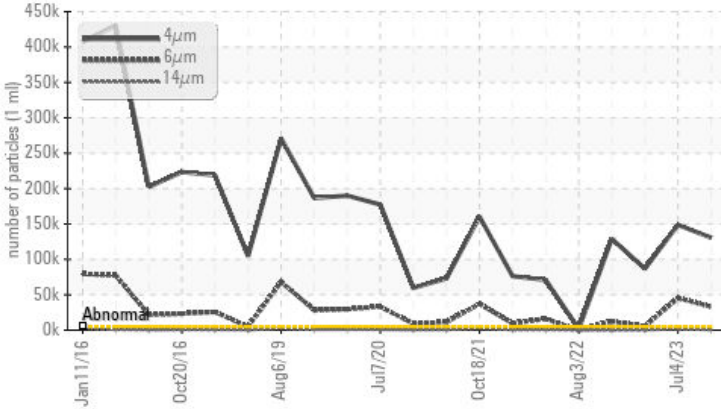

Ferrous Alloys

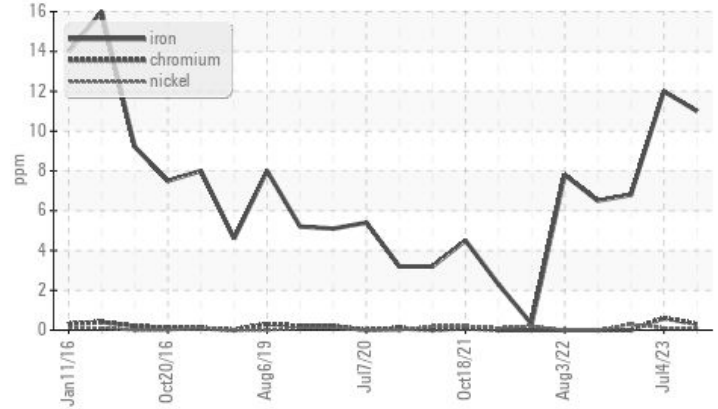

RECOMMENDATION

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	SEVERE	SEVERE
Iron	ppm	ASTM D5185(m)	>10	▲ 11	▲ 12	7
Particles >4µm		ASTM D7647	>5000	● 130735	● 148672	● 86884
Particles >6µm		ASTM D7647	>1300	● 33091	● 45255	▲ 5581
Oil Cleanliness		ISO 4406 (c)	>19/17/15	● 24/22/16	● 24/23/18	● 24/20/13
PrtFilter					no image	no image

Customer Id: BRUTIV
 Sample No.: WC0871698
 Lab Number: 02608224
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com


To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	Resample in 30-45 days to monitor this situation.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.

HISTORICAL DIAGNOSIS


ISO




04 Jul 2023 Diag: Kevin Marson

We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Iron ppm levels are abnormal. Wear particle analysis indicates that the ferrous rolling particles are marginal. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion. There is a high amount of particulates (2 to 100 microns in size) present in the oil. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

view report




ISO




18 Jan 2023 Diag: Kevin Marson

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. Particles >4µm and oil cleanliness are severely high. Particles >6µm are abnormally high. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report




ISO



11 Oct 2022 Diag: Kevin Marson

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. Particles >6µm are severely high. Particles >4µm and oil cleanliness are severely high. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report






OIL ANALYSIS REPORT

Sample Rating Trend

ISO



Area
(ZONE3) BRUCE A/1/34710
 Machine Id
1-34710-P1-P OB Ball/Sleeve
 Component
Outboard Bearing
 Fluid
MOBIL DTE 732 (--- GAL)

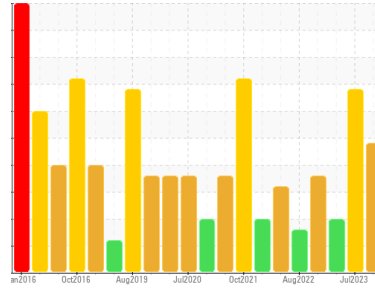

DIAGNOSIS

Recommendation

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

Iron ppm levels are abnormal. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion. The ferrography results are normal indicating no abnormal wear in the system.

Contaminants

There is a high amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code.

Oil Condition

The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0871698	WC0801547	WC0719029
Sample Date	Client Info		20 Dec 2023	04 Jul 2023	18 Jan 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	SEVERE	SEVERE

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		0	0	---
Iron	ppm	ASTM D5185(m) >10	▲ 11	▲ 12	7
Chromium	ppm	ASTM D5185(m) >5	<1	<1	0
Nickel	ppm	ASTM D5185(m) >5	<1	<1	<1
Titanium	ppm	ASTM D5185(m) >5	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	0
Aluminum	ppm	ASTM D5185(m) >5	<1	<1	<1
Lead	ppm	ASTM D5185(m) >5	<1	<1	<1
Copper	ppm	ASTM D5185(m) >5	<1	<1	<1
Tin	ppm	ASTM D5185(m) >5	0	0	0
Antimony	ppm	ASTM D5185(m)	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES


	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	0	<1
Barium	ppm	ASTM D5185(m)	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	<1	<1	<1
Calcium	ppm	ASTM D5185(m)	<1	<1	0
Phosphorus	ppm	ASTM D5185(m)	2	4	3
Zinc	ppm	ASTM D5185(m)	2	3	2
Sulfur	ppm	ASTM D5185(m)	127	207	177
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >5	1	2	2
Sodium	ppm	ASTM D5185(m) >5	0	<1	<1
Potassium	ppm	ASTM D5185(m) >20	4	<1	0
Water	%	ASTM D6304* >0.005	0.002	0.002	0.003
ppm Water	ppm	ASTM D6304* >50	22	15.1	35.4

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	● 130735	● 148672	● 86884
Particles >6µm	ASTM D7647	>1300	● 33091	● 45255	▲ 5581
Particles >14µm	ASTM D7647	>320	▲ 605	▲ 1719	79
Particles >21µm	ASTM D7647	>80	96	▲ 424	12
Particles >38µm	ASTM D7647	>20	4	27	0
Particles >71µm	ASTM D7647	>4	0	3	0
Oil Cleanliness	ISO 4406 (c)	>19/17/15	● 24/22/16	● 24/23/18	● 24/20/13

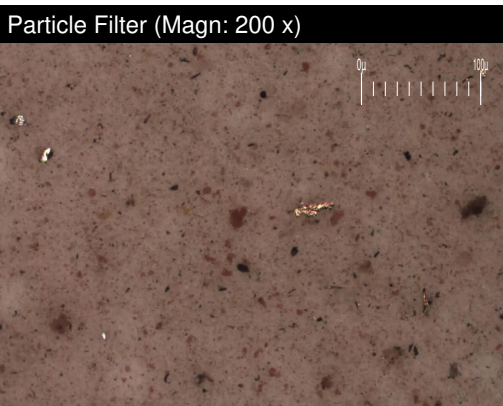

OIL ANALYSIS REPORT

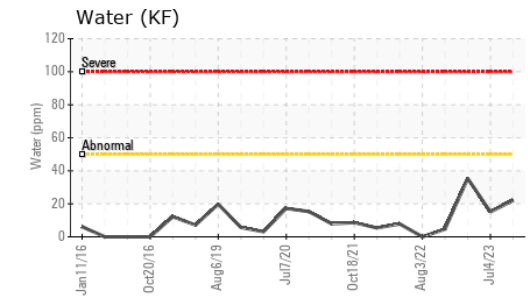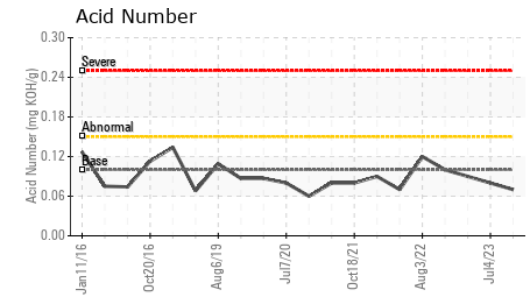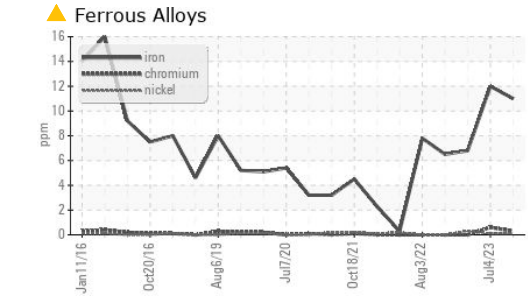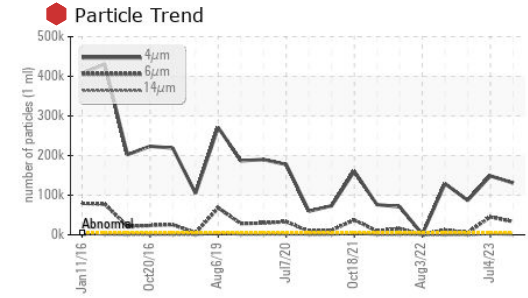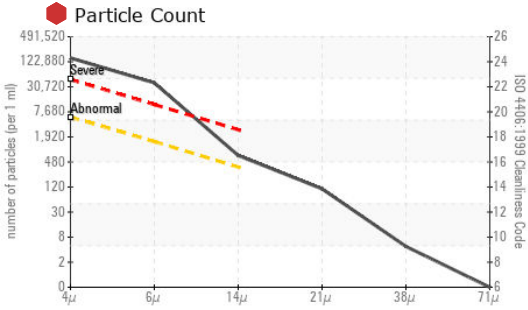

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0871698
Lab Number : 02608224
Unique Number : 5709310
Test Package : IND 2 (Additional Tests: A-FERR, BottomAnalysis, DR-FERR, FILTERPATCH, PQ, PrtFilter, TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

FLUID DEGRADATION	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974*	0.10	0.07	0.08	0.09

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	Visual*	NONE	NONE	VLITE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	VLITE	VLITE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.005	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	30.0	34.1	32.6	32.9


SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color			
Bottom			
PrtFilter		no image	no image


FERROGRAPHY REPORT

Area
(ZONE3) BRUCE A/1/34710
 Machine Id
1-34710-P1-P OB Ball/Sleeve
 Component
Outboard Bearing
 Fluid
MOBIL DTE 732 (--- GAL)


Magn: 200x Illum: BC

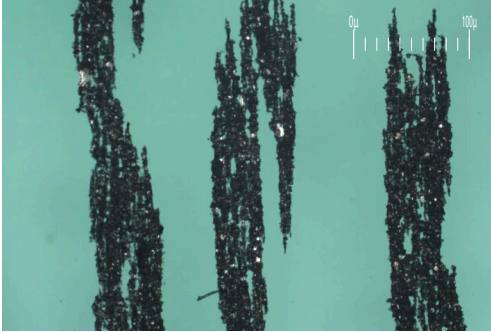

Magn: 50x Illum: RW

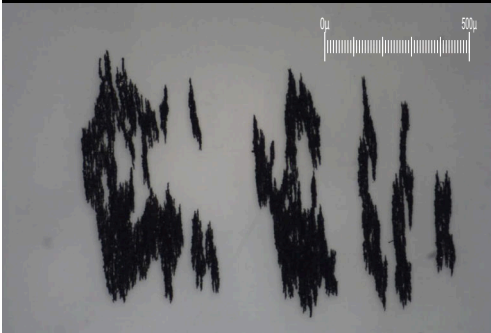

Magn: 100x Illum: RW

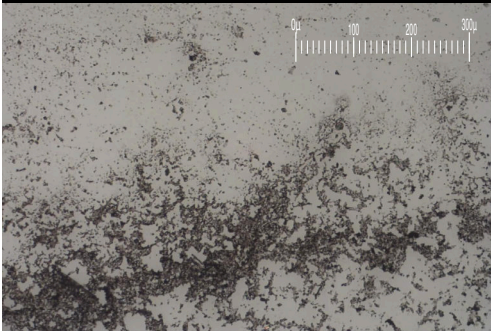


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		69.9	98.1	9.6
Small Particles		DR-Ferr*		40.8	44.2	3.1
Total Particles		DR-Ferr*	>---	110.7	142.3	12.7
Large Particles Percentage	%	DR-Ferr*		26.3	37.9	51.2
Severity Index		DR-Ferr*		2034	5288	62

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		4	5	4
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		2	2	2
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*		1	1	
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*		2	1	1
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		1	1	1
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		3	2	2

WEAR

Iron ppm levels are abnormal. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion. The ferrography results are normal indicating no abnormal wear in the system.

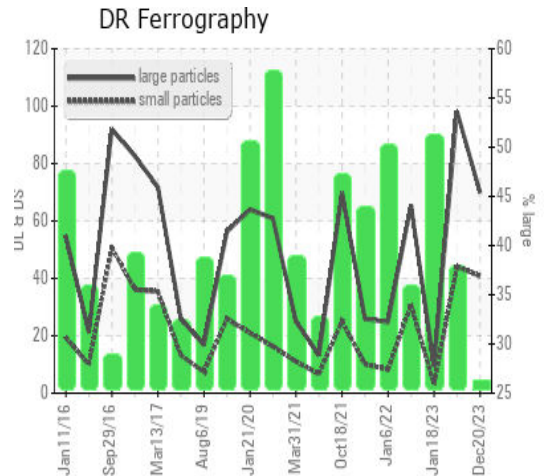

This page left intentionally blank