




OIL ANALYSIS REPORT

Sample Rating Trend

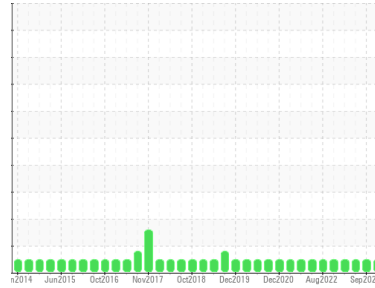

NORMAL



Machine Id
LLHPUG-1 LONG LAKE

Component
Hydraulic System

Fluid
SHELL TELLUS S2 M 32 (150 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | | WC0843686 | WC0843688 | WC0729453 |
| Sample Date | Client Info | | | 21 Dec 2023 | 26 Sep 2023 | 05 Jun 2023 |
| Machine Age | hrs | Client Info | | 7000 | 7000 | 7000 |
| Oil Age | hrs | Client Info | | 0 | 7000 | 0 |
| Oil Changed | Client Info | | | N/A | N/A | N/A |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |

| CONTAMINATION | | method | limit/base | current | history1 | history2 |
|---------------|-----------|--------|------------|------------|----------|----------|
| Water | WC Method | | >0.05 | NEG | NEG | NEG |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|---------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185(m) | >20 | 4 | 4 | 4 |
| Chromium | ppm | ASTM D5185(m) | >20 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185(m) | >20 | 6 | 6 | 6 |
| Titanium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185(m) | | <1 | <1 | <1 |
| Aluminum | ppm | ASTM D5185(m) | >20 | <1 | <1 | <1 |
| Lead | ppm | ASTM D5185(m) | >20 | 1 | 1 | 1 |
| Copper | ppm | ASTM D5185(m) | >20 | 50 | 52 | 54 |
| Tin | ppm | ASTM D5185(m) | >20 | 0 | 0 | 0 |
| Antimony | ppm | ASTM D5185(m) | | 0 | 0 | <1 |
| Vanadium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Beryllium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|---------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185(m) | | 0 | <1 | <1 |
| Barium | ppm | ASTM D5185(m) | | 0 | <1 | 0 |
| Molybdenum | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185(m) | | 1 | <1 | <1 |
| Calcium | ppm | ASTM D5185(m) | | 73 | 73 | 77 |
| Phosphorus | ppm | ASTM D5185(m) | | 239 | 245 | 266 |
| Zinc | ppm | ASTM D5185(m) | | 281 | 288 | 287 |
| Sulfur | ppm | ASTM D5185(m) | | 709 | 707 | 730 |
| Lithium | ppm | ASTM D5185(m) | | <1 | <1 | <1 |


| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|---------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185(m) | >15 | <1 | <1 | <1 |
| Sodium | ppm | ASTM D5185(m) | | 0 | <1 | 0 |
| Potassium | ppm | ASTM D5185(m) | >20 | 11 | <1 | 2 |

| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|-----------------|----------|----------|
| Particles >4µm | | ASTM D7647 | >5000 | 373 | 346 | 191 |
| Particles >6µm | | ASTM D7647 | >1300 | 121 | 104 | 60 |
| Particles >14µm | | ASTM D7647 | >160 | 12 | 8 | 5 |
| Particles >21µm | | ASTM D7647 | >40 | 3 | 2 | 2 |
| Particles >38µm | | ASTM D7647 | >10 | 0 | 0 | 0 |
| Particles >71µm | | ASTM D7647 | >3 | 0 | 0 | 0 |
| Oil Cleanliness | | ISO 4406 (c) | >19/17/14 | 16/14/11 | 16/14/10 | 15/13/10 |




OIL ANALYSIS REPORT


Particle Trend

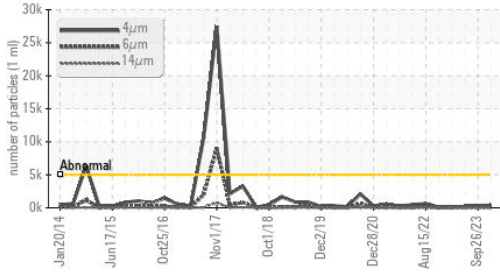


Acid Number

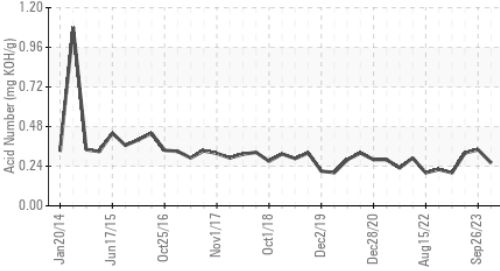


Viscosity @ 40°C

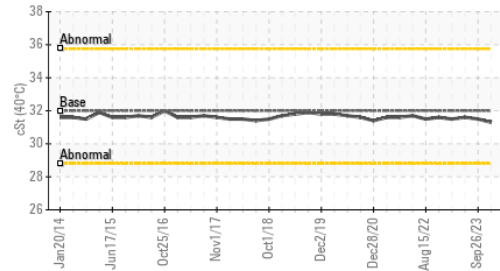

Particle Trend

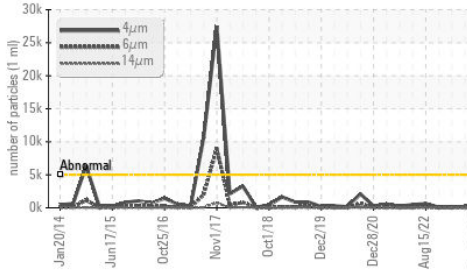

Non-ferrous Metals

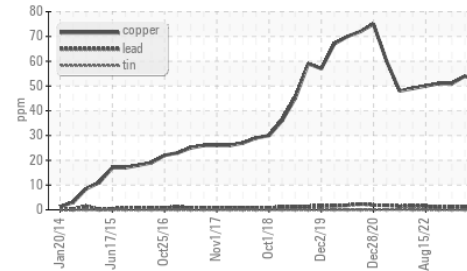


FLUID DEGRADATION

| method | limit/base | current | history1 | history2 | | |
|---------------------------|------------|-------------|----------|--------------|-------|-------|
| Acid Number (AN) mg KOH/g | ASTM D974* | 0.26 | 0.34 | 0.32 | | |
| VISUAL | | | | | | |
| White Metal | scalar | Visual* | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | Visual* | NONE | NONE | NONE | NONE |
| Precipitate | scalar | Visual* | NONE | NONE | NONE | NONE |
| Silt | scalar | Visual* | NONE | NONE | NONE | NONE |
| Debris | scalar | Visual* | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | Visual* | NONE | NONE | NONE | NONE |
| Appearance | scalar | Visual* | NORML | NORML | NORML | NORML |
| Odor | scalar | Visual* | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | Visual* | >0.05 | NEG | NEG | NEG |
| Free Water | scalar | Visual* | | NEG | NEG | NEG |

FLUID PROPERTIES


| method | limit/base | current | history1 | history2 | | |
|-------------|------------|---------------|----------|-------------|------|------|
| Visc @ 40°C | cSt | ASTM D7279(m) | 32.0 | 31.3 | 31.5 | 31.6 |

SAMPLE IMAGES

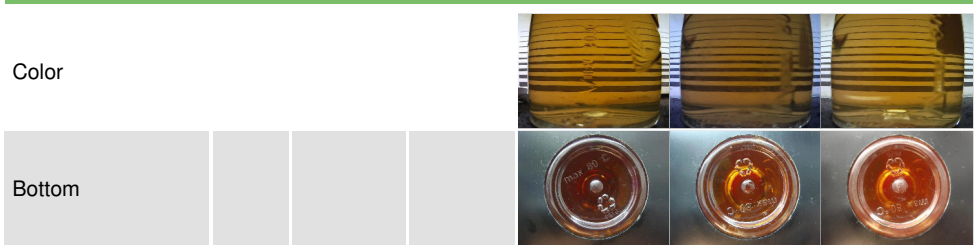


GRAPHS


Ferrous Alloys

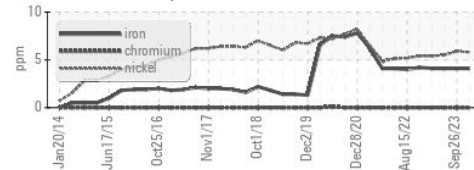


Non-ferrous Metals

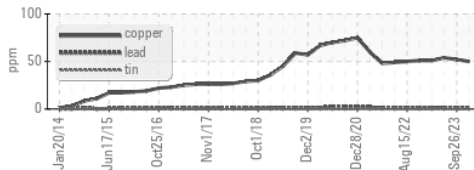


Viscosity @ 40°C

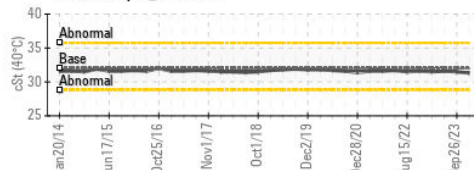

Particle Count

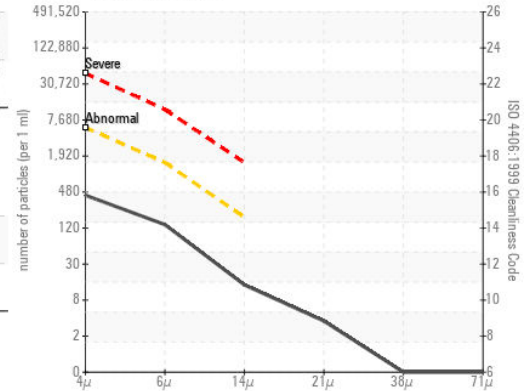

Acid Number

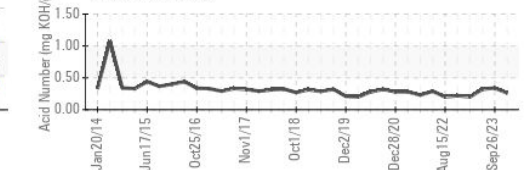

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Long Lake Hydro Inc. (Regional Power)
 Sample No. : WC0843686 Received : 12 Jan 2024 1104 Railway St.
 Lab Number : 02608559 Diagnosed : 16 Jan 2024 Stewart, BC
 Unique Number : 5709645 Diagnostician : Wes Davis CA V0T 1W0
 Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Contact: Jonathan Zappitelli
 jzappitelli@cclinfrastucture.com
 T: (778)794-0385
 F: