

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area
SHEDIAC SEWERAGE [6100246557]
Machine Id
ONAN P2722

Component
Diesel Engine
Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
Metal levels are typical for a new component breaking in.

Contamination
There is no indication of any contamination in the oil.

Fluid Condition
The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WA0020811	---	---
Sample Date	Client Info			12 Jan 2024	---	---
Machine Age	hrs Client Info			738	---	---
Oil Age	hrs Client Info			26	---	---
Oil Changed	Client Info			Changed	---	---
Sample Status				NORMAL	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<1.0	---	---
Water	WC Method	>0.2		NEG	---	---
Glycol	WC Method			NEG	---	---


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>100	6	---	---
Chromium	ppm	ASTM D5185(m)	>20	1	---	---
Nickel	ppm	ASTM D5185(m)	>4	0	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	2	---	---
Lead	ppm	ASTM D5185(m)	>40	<1	---	---
Copper	ppm	ASTM D5185(m)	>330	<1	---	---
Tin	ppm	ASTM D5185(m)	>15	<1	---	---
Antimony	ppm	ASTM D5185(m)		0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
Beryllium	ppm	ASTM D5185(m)		0	---	---
Cadmium	ppm	ASTM D5185(m)		0	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	250	29	---	---
Barium	ppm	ASTM D5185(m)	10	<1	---	---
Molybdenum	ppm	ASTM D5185(m)	100	47	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)	450	786	---	---
Calcium	ppm	ASTM D5185(m)	3000	1276	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	964	---	---
Zinc	ppm	ASTM D5185(m)	1350	1112	---	---
Sulfur	ppm	ASTM D5185(m)	4250	2693	---	---
Lithium	ppm	ASTM D5185(m)		<1	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	3	---	---
Sodium	ppm	ASTM D5185(m)	>158	2	---	---
Potassium	ppm	ASTM D5185(m)	>20	2	---	---


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	5.7	---	---
Sulfation	Abs./1mm	ASTM D7415*	>30	19.2	---	---

OIL ANALYSIS REPORT

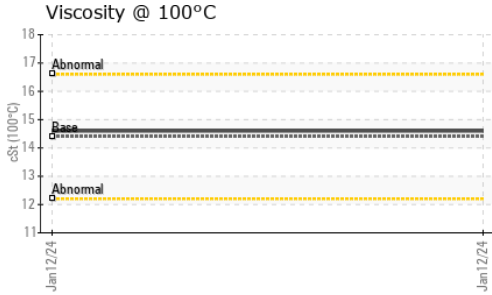

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	15.0	---	---
VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---
Free Water	scalar	Visual*		NEG	---	---
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	14.6	---	---

GRAPHS

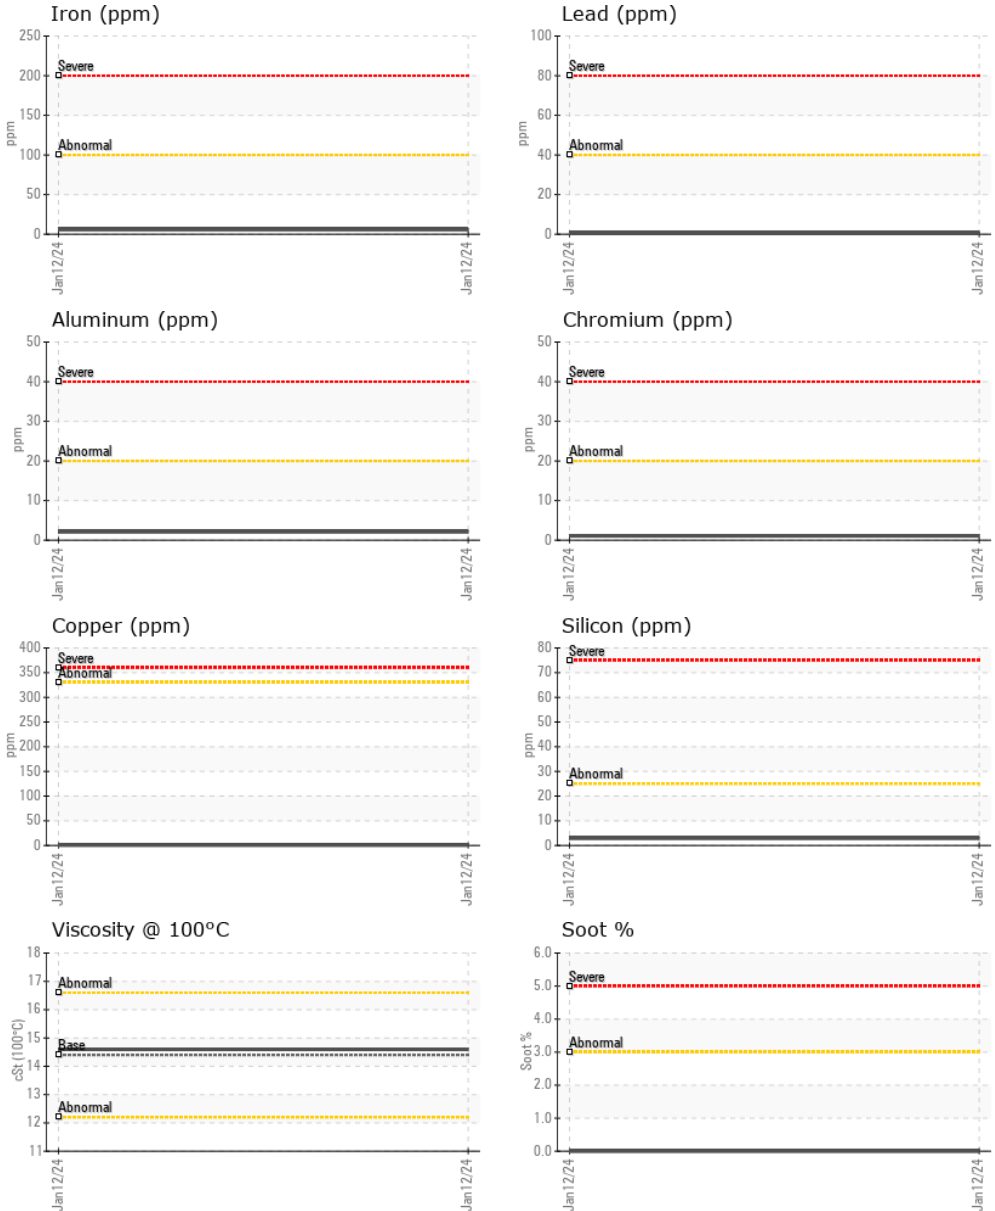

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0020811 **Received** : 17 Jan 2024
Lab Number : 02609223 **Diagnosed** : 17 Jan 2024
Unique Number : 5710309 **Diagnostician** : Wes Davis
Test Package : MOB 1

Wajax Power Systems
 485 VENTURE DR
 MONCTON, NB
 CA E1H 2P4
 Contact: Doug Balsler
 dbalsler@wajax.com
 T: (506)855-5371
 F: (506)870-4448

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.