




# OIL ANALYSIS REPORT

Sample Rating Trend

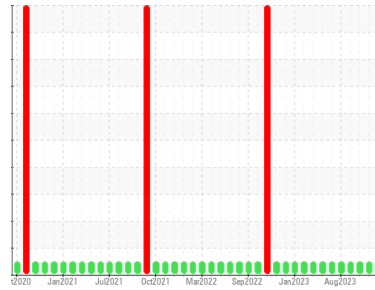

**NORMAL**



Area  
**M09**  
 Machine Id  
**36-K-1900B HP GAS COMPRESSOR (36-T-1910B) (S/N Maint Plan 22480)**  
 Component  
**Compressor**  
 Fluid  
**MOBIL DTE 846 (5582 LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using MAR 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid.

### Wear

Component wear rates appear to be normal (unconfirmed).

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PP</b>	PP	PP
Sample Date	Client Info	<b>19 Dec 2023</b>	15 Nov 2023	14 Nov 2023
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >50	<b>0</b>	0	0
Chromium	ppm ASTM D5185(m) >5	<b>0</b>	0	0
Nickel	ppm ASTM D5185(m)	<b>0</b>	<1	<1
Titanium	ppm ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm ASTM D5185(m)	<b>0</b>	0	<1
Aluminum	ppm ASTM D5185(m) >15	<b>&lt;1</b>	<1	0
Lead	ppm ASTM D5185(m) >65	<b>0</b>	<1	0
Copper	ppm ASTM D5185(m) >65	<b>0</b>	0	<1
Tin	ppm ASTM D5185(m) >10	<b>0</b>	0	0
Antimony	ppm ASTM D5185(m)	<b>0</b>	0	0
Vanadium	ppm ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m)	<b>0</b>	<1	<1
Barium	ppm ASTM D5185(m)	<b>0</b>	0	1
Molybdenum	ppm ASTM D5185(m)	<b>0</b>	0	0
Manganese	ppm ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	0
Calcium	ppm ASTM D5185(m)	<b>0</b>	<1	<1
Phosphorus	ppm ASTM D5185(m)	<b>1136</b>	1127	1116
Zinc	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Sulfur	ppm ASTM D5185(m)	<b>46</b>	87	56
Lithium	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	<1

## CONTAMINANTS






method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >35	<b>&lt;1</b>	1	0
Sodium	ppm ASTM D5185(m)	<b>0</b>	0	0
Potassium	ppm ASTM D5185(m) >20	<b>&lt;1</b>	2	0
Water	% ASTM D6304* >0.1	<b>0.002</b>	0.002	0.003
ppm Water	ppm ASTM D6304* >1000	<b>21</b>	16	25.5

## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>1414</b>	2262	1356
Particles >6µm	ASTM D7647 >2500	<b>260</b>	496	188
Particles >14µm	ASTM D7647 >320	<b>24</b>	20	15
Particles >21µm	ASTM D7647 >80	<b>8</b>	6	5
Particles >38µm	ASTM D7647 >20	<b>1</b>	1	0
Particles >71µm	ASTM D7647 >4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	<b>18/15/12</b>	18/16/11	18/15/11



# OIL ANALYSIS REPORT

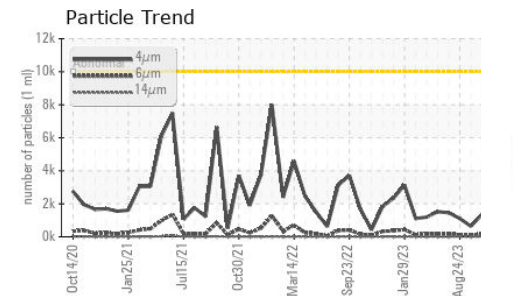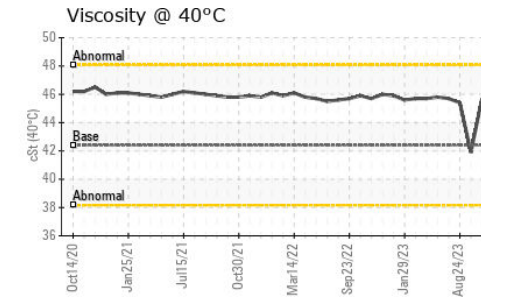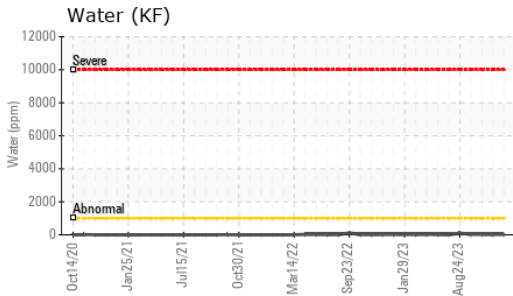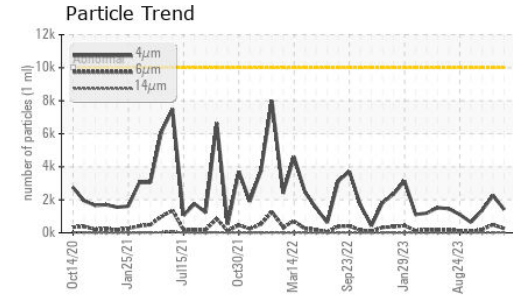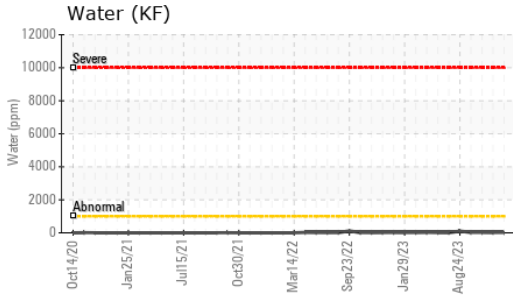


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		<b>0.23</b>	0.18	0.23






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	42.4	<b>45.7</b>	45.5	45.7

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

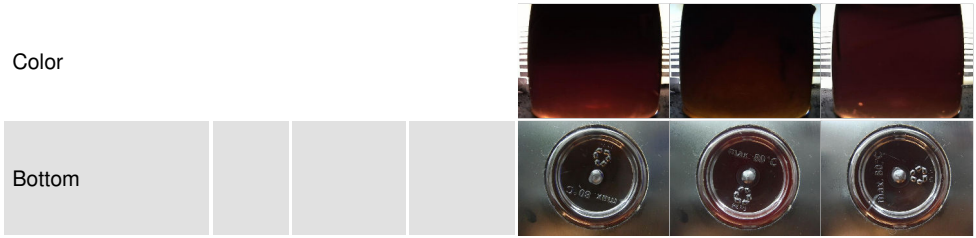

## GRAPHS

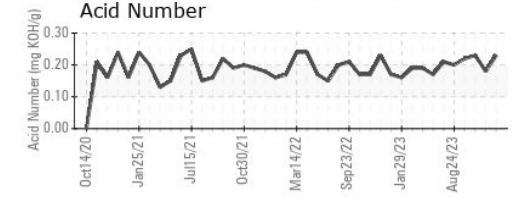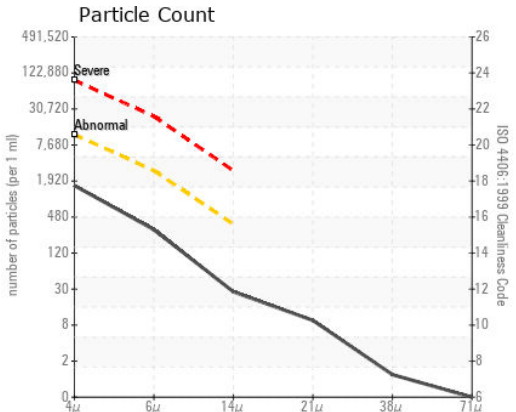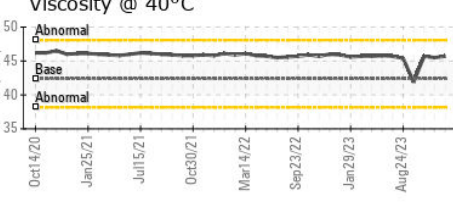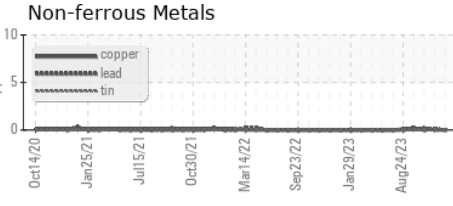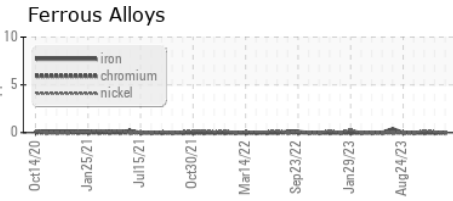

ISO 17025:2017  
Accredited  
Laboratory

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 HUSKY SEA ROSE /AKER SOLUTIONS  
**Sample No.** : PP **Received** : 17 Jan 2024  
**Lab Number** : 02609364 **Diagnosed** : 18 Jan 2024  
**Unique Number** : 5710450 **Diagnostician** : Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: KF, TAN Man )  
 To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

PO BOX 20  
ST. JOHN'S, NL  
CA A1C 6C9  
Contact: Nick Fewer  
nick.fewer@akersolutions.com  
T: (709)757-4582  
F: (709)722-8730