




PROBLEM SUMMARY

Sample Rating Trend

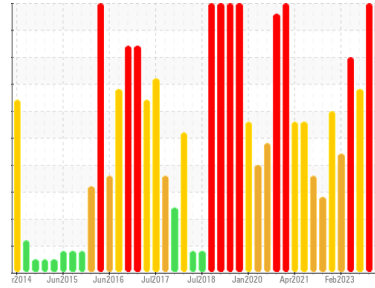


WEAR




Area
BRUCE B/8/43230
 Machine Id
8-43230-P4-P IB Brg Drn
 Component
Inboard Bearing
 Fluid
ESSO NUTO H ISO 46 (--- GAL)

COMPONENT CONDITION SUMMARY

Non-ferrous Metals

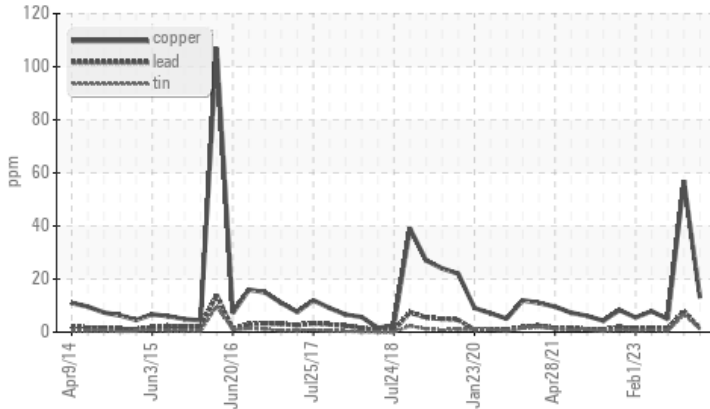

Particle Trend

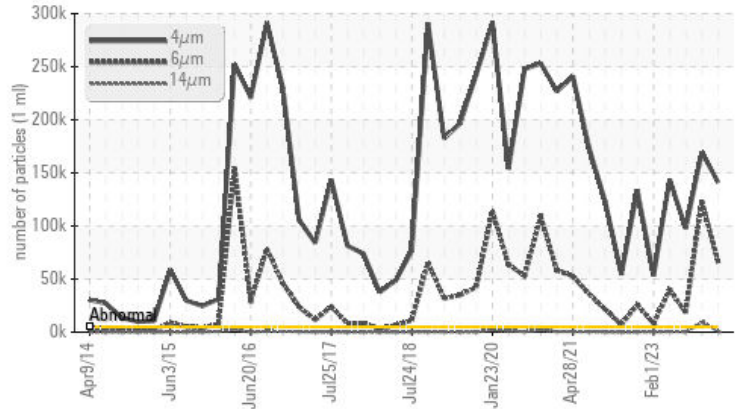

RECOMMENDATION

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. No other corrective action is recommended at this time. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

PROBLEMATIC TEST RESULTS

Sample Status			SEVERE	SEVERE	SEVERE	
Copper	ppm	ASTM D5185(m)	>5	13	57	5
Ferrous Cutting	Scale 0-10	ASTM D7684*		1	1	1
Particles >4µm		ASTM D7647	>5000	141054	169532	97733
Particles >6µm		ASTM D7647	>1300	66351	123574	18240
Particles >14µm		ASTM D7647	>320	959	9288	279
Oil Cleanliness		ISO 4406 (c)	>19/17/15	24/23/17	25/24/20	24/21/15
PrtFilter					no image	no image

Customer Id: BRUTIV
 Sample No.: WC0845406
 Lab Number: 02609392
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	Resample in 30-45 days to monitor this situation.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.

HISTORICAL DIAGNOSIS

06 Dec 2023 Diag: Kevin Marson

WEAR



We advise that you check all areas where contaminants can enter the system. We advise that you perform a compression test. We recommend either performing an oil change or oil filtration. We cannot recommend specific action as we have limited information with regards to reservoir capacity and/or lubricant type. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Copper ppm levels are severe. Lead, tin and chromium ppm levels are abnormal. Wear particle analysis indicates that the ferrous cutting and ferrous sliding particles are marginal. Bearing wear is indicated. Cutting wear particles are caused by either hard protuberances (mis-aligned components, etc.), or abrasives entering the system and embedding themselves in softer materials (sand, etc.), and gouging out mating surfaces. Sliding wear particles are caused from metal on metal contact, and may be the result of high loads, speeds, or temperature, insufficient lubrication, or lack of anti-wear or extreme pressure additives. There is a high amount of particulates (2 to 100 microns in size) present in the oil. Elemental level of silicon (Si) above normal indicating ingress of seal material. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

view report



20 Jul 2023 Diag: Kevin Marson

ISO



Check seals and/or filters for points of contaminant entry. We advise that you check all areas where dirt can enter the system. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Wear particle analysis indicates that the ferrous cutting particles are marginal. All other component wear rates are normal. Cutting wear particles are caused by either hard protuberances (mis-aligned components, etc.), or abrasives entering the system and embedding themselves in softer materials (sand, etc.), and gouging out mating surfaces. There is a high amount of silt (particulates < 14 microns in size) present in the oil. Elemental level of silicon (Si) above normal indicating ingress of seal material. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



26 Apr 2023 Diag: Kevin Marson

ISO



Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Copper ppm levels are abnormal. Wear particle analysis indicates that the ferrous cutting particles are marginal. All other component wear rates are normal. Cutting wear particles are caused by either hard protuberances (mis-aligned components, etc.), or abrasives entering the system and embedding themselves in softer materials (sand, etc.), and gouging out mating surfaces. Particles >6µm are severely high. Oil Cleanliness are severely high. Particles >4µm are severely high. Silicon ppm levels are abnormally high. Particles >14µm are notably high. Elemental level of silicon (Si) above normal indicating ingress of seal material. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

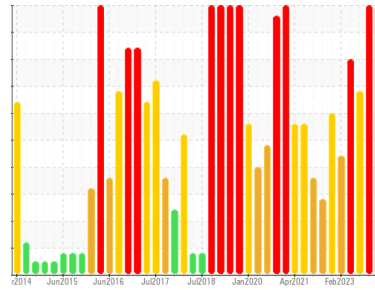

WEAR



Area
BRUCE B/8/43230
 Machine Id
8-43230-P4-P IB Brg Drn
 Component
Inboard Bearing
 Fluid
ESSO NUTO H ISO 46 (--- GAL)

DIAGNOSIS

Recommendation

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. No other corrective action is recommended at this time. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

Copper ppm levels are severe. Wear particle analysis indicates that the ferrous cutting particles are marginal. Bearing wear is indicated. Cutting wear particles are caused by either hard protuberances (mis-aligned components, etc.), or abrasives entering the system and embedding themselves in softer materials (sand, etc.), and gouging out mating surfaces.


Contaminants

There is a high amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code.

Oil Condition

The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

Particle Filter (Magn: 200 x)

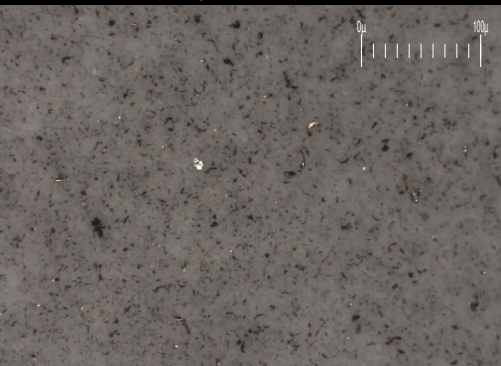

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0845406	WC0744593	WC0744561
Sample Date	Client Info	08 Jan 2024	06 Dec 2023	20 Jul 2023
Machine Age	kms Client Info	0	0	0
Oil Age	kms Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		SEVERE	SEVERE	SEVERE

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185(m) >10	<1	2	0
Chromium ppm	ASTM D5185(m) >5	<1	▲ 6	0
Nickel ppm	ASTM D5185(m) >5	0	<1	0
Titanium ppm	ASTM D5185(m) >5	0	0	0
Silver ppm	ASTM D5185(m)	0	<1	0
Aluminum ppm	ASTM D5185(m) >5	<1	<1	<1
Lead ppm	ASTM D5185(m) >5	1	▲ 8	1
Copper ppm	ASTM D5185(m) >5	● 13	● 57	5
Tin ppm	ASTM D5185(m) >5	1	▲ 7	<1
Antimony ppm	ASTM D5185(m)	0	0	0
Vanadium ppm	ASTM D5185(m)	0	0	0
Beryllium ppm	ASTM D5185(m)	0	0	0
Cadmium ppm	ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185(m) 0	0	<1	0
Barium ppm	ASTM D5185(m) 0	0	<1	0
Molybdenum ppm	ASTM D5185(m) 0	0	0	0
Manganese ppm	ASTM D5185(m)	0	0	0
Magnesium ppm	ASTM D5185(m) 5	<1	0	<1
Calcium ppm	ASTM D5185(m) 50	53	53	54
Phosphorus ppm	ASTM D5185(m) 330	377	348	383
Zinc ppm	ASTM D5185(m) 410	429	444	455
Sulfur ppm	ASTM D5185(m) 2700	6108	5776	5634
Lithium ppm	ASTM D5185(m)	<1	<1	<1






CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185(m) >5	<1	● 17	▲ 7
Sodium ppm	ASTM D5185(m) >5	0	<1	0
Potassium ppm	ASTM D5185(m) >20	0	0	<1
Water %	ASTM D6304* >0.005	0.002	0.002	0.00
ppm Water	ASTM D6304* >50	19	18	0.00

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	● 141054	● 169532	● 97733
Particles >6µm	ASTM D7647 >1300	● 66351	● 123574	● 18240
Particles >14µm	ASTM D7647 >320	▲ 959	● 9288	279
Particles >21µm	ASTM D7647 >80	52	▲ 413	33
Particles >38µm	ASTM D7647 >20	1	3	3
Particles >71µm	ASTM D7647 >4	0	0	2
Oil Cleanliness	ISO 4406 (c) >19/17/15	● 24/23/17	● 25/24/20	● 24/21/15

OIL ANALYSIS REPORT

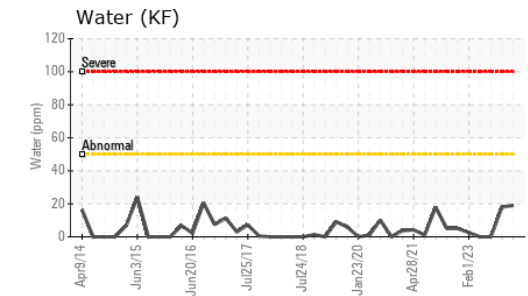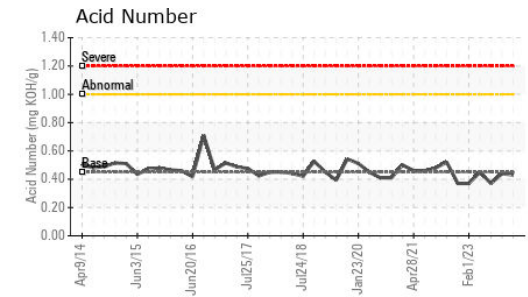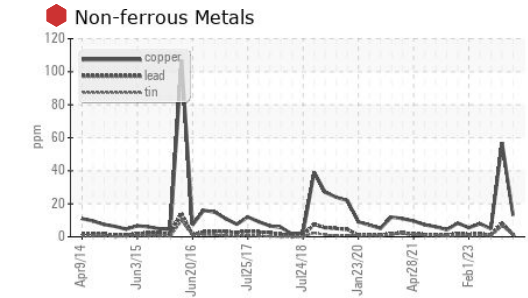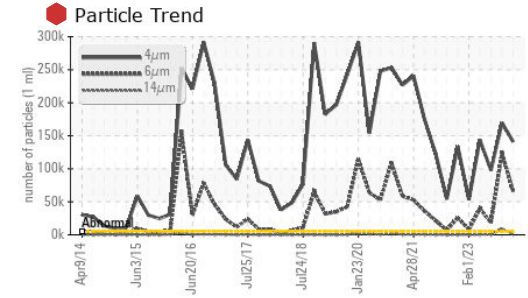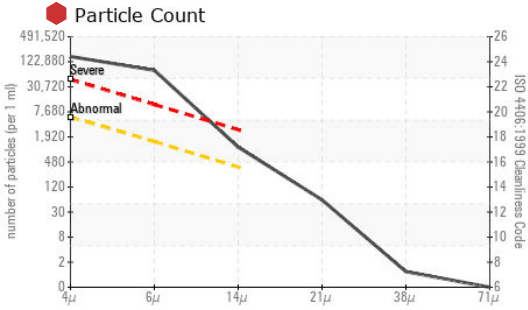


Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0845406 **Received** : 17 Jan 2024
Lab Number : 02609392 **Diagnosed** : 23 Jan 2024
Unique Number : 5710478 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: A-FERR, BottomAnalysis, DR-FERR, FILTERPATCH, PrtFilter)
 To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.45	0.43	0.44	0.37

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	VLITE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.005	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG




FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	46	43.5	43.0	44.4

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

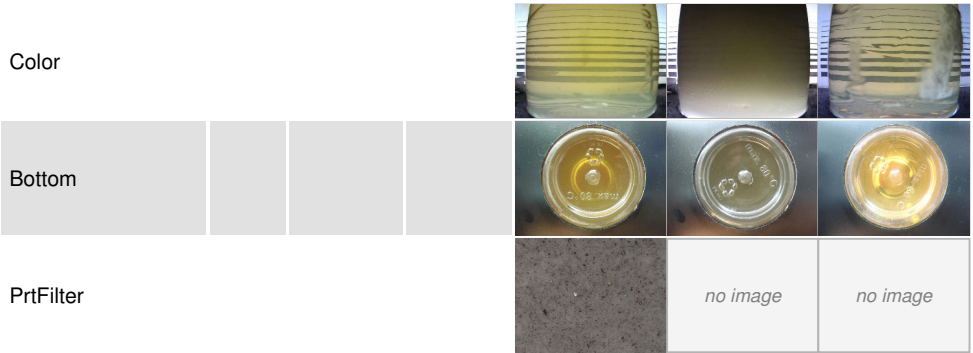

FERROGRAPHY REPORT

Area
BRUCE B/8/43230
 Machine Id
8-43230-P4-P IB Brg Drn
 Component
Inboard Bearing
 Fluid
ESSO NUTO H ISO 46 (--- GAL)

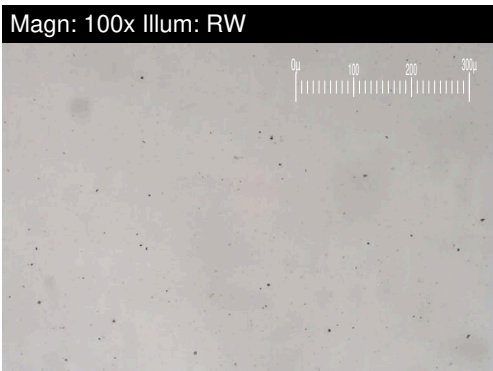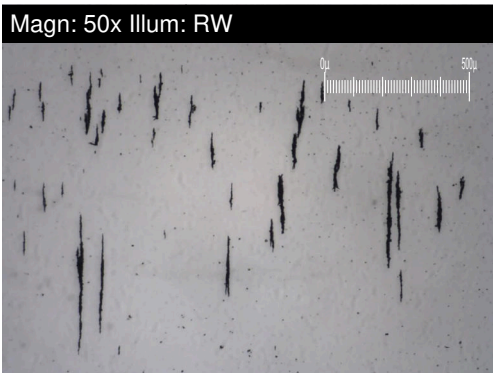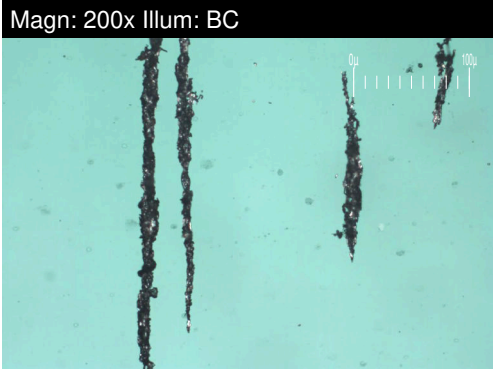


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		9.6	25.0	2.5
Small Particles		DR-Ferr*		2.8	10.3	1.4
Total Particles		DR-Ferr*	>---	12.4	35.3	3.9
Large Particles Percentage	%	DR-Ferr*		54.8	41.6	28.2
Severity Index		DR-Ferr*		65	368	3

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		3	4	2
Ferrous Sliding	Scale 0-10	ASTM D7684*			1	
Ferrous Cutting	Scale 0-10	ASTM D7684*		1	1	1
Ferrous Rolling	Scale 0-10	ASTM D7684*		1	1	1
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*		1		
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*			1	
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		1	1	1
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		1	2	1

WEAR

Copper ppm levels are severe. Wear particle analysis indicates that the ferrous cutting particles are marginal. Bearing wear is indicated. Cutting wear particles are caused by either hard protuberances (mis-aligned components, etc.), or abrasives entering the system and embedding themselves in softer materials (sand, etc.), and gouging out mating surfaces.

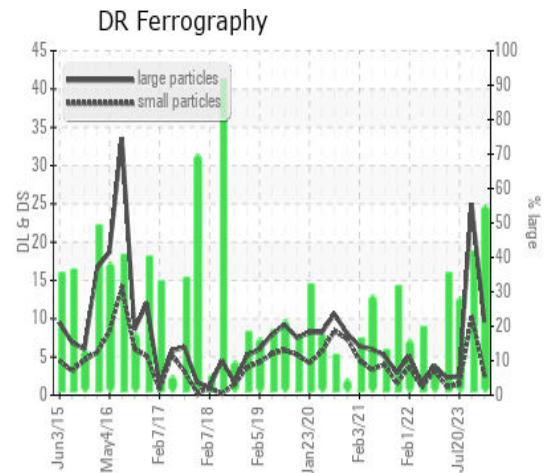

This page left intentionally blank