



# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**[331281]**  
Machine Id  
**1860 G1**

Component  
**Diesel Engine**  
Fluid

**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**



## DIAGNOSIS

### Recommendation

Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition.

### Wear

Les taux d'usure de tous les composants sont normaux.

### Contamination

Il n'y a aucun indice de contamination dans l'huile.

### Fluid Condition

L'état de l'huile est acceptable pour la durée de service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>CU0020300</b>	---	---
Sample Date	Client Info		<b>23 Dec 2023</b>	---	---
Machine Age	hrs	Client Info	<b>1947</b>	---	---
Oil Age	hrs	Client Info	<b>600</b>	---	---
Oil Changed	Client Info		<b>Changed</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>3.0	<b>&lt;1.0</b>	---	---
Water	WC Method	>0.2	<b>NEG</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >90	<b>19</b>	---	---
Chromium	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185(m) >2	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185(m) >2	<b>0</b>	---	---
Silver	ppm	ASTM D5185(m) >2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m) >20	<b>2</b>	---	---
Lead	ppm	ASTM D5185(m) >40	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185(m) >330	<b>1</b>	---	---
Tin	ppm	ASTM D5185(m) >15	<b>0</b>	---	---
Antimony	ppm	ASTM D5185(m)	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 250	<b>37</b>	---	---
Barium	ppm	ASTM D5185(m) 10	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m) 100	<b>62</b>	---	---
Manganese	ppm	ASTM D5185(m)	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m) 450	<b>1092</b>	---	---
Calcium	ppm	ASTM D5185(m) 3000	<b>812</b>	---	---
Phosphorus	ppm	ASTM D5185(m) 1150	<b>968</b>	---	---
Zinc	ppm	ASTM D5185(m) 1350	<b>1169</b>	---	---
Sulfur	ppm	ASTM D5185(m) 4250	<b>2756</b>	---	---
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	---	---

## CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	<b>3</b>	---	---
Sodium	ppm	ASTM D5185(m) >158	<b>4</b>	---	---
Potassium	ppm	ASTM D5185(m) >20	<b>22</b>	---	---
Glycol	%	ASTM D7922*	<b>0.0</b>	---	---

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844* >6	<b>0</b>	---	---
Nitration	Abs/cm	ASTM D7624* >20	<b>11.4</b>	---	---
Sulfation	Abs./1mm	ASTM D7415* >30	<b>23.1</b>	---	---



# OIL ANALYSIS REPORT









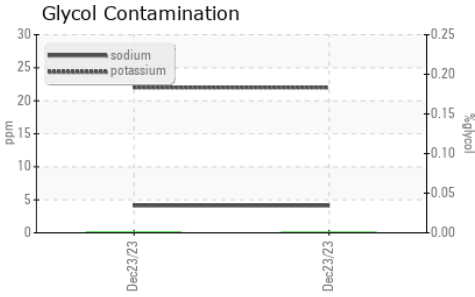


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs./1mm	ASTM D7414*	>25	<b>25.3</b>	---	---

VISUAL	method	limit/base	current	history1	history2	
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	---	---
Free Water	scalar	Visual*		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	<b>14.2</b>	---	---

## GRAPHS

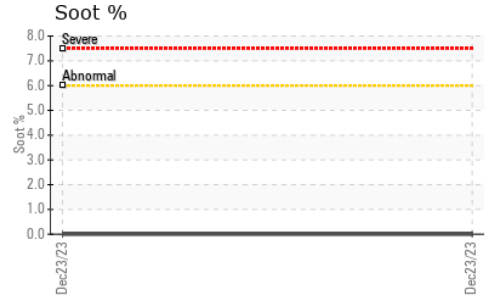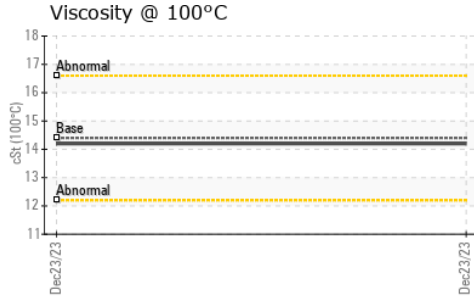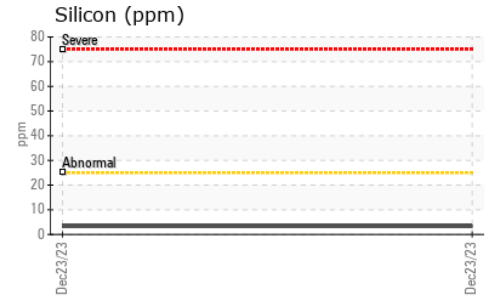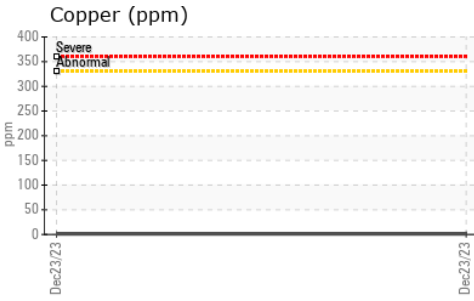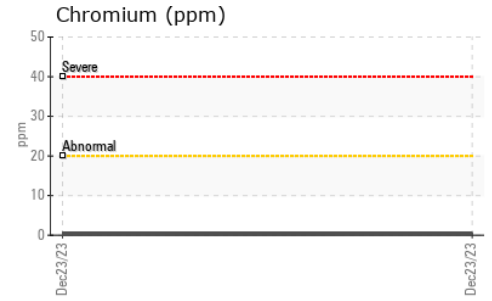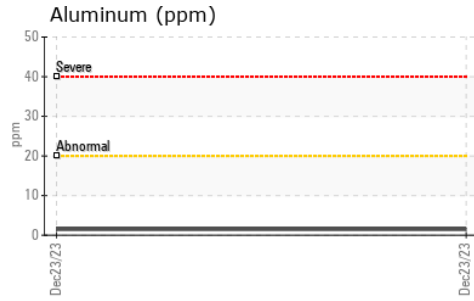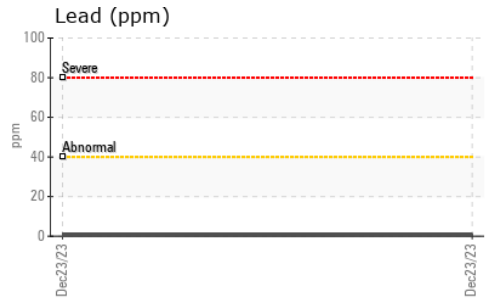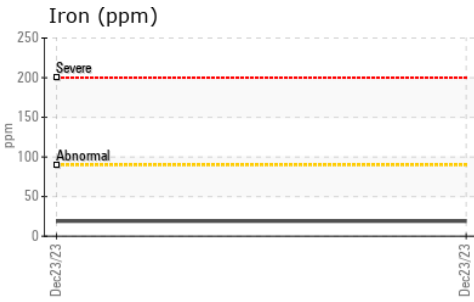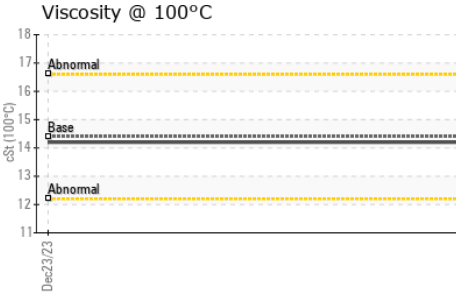

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : CU0020300 **Received** : 18 Jan 2024  
**Lab Number** : 02609609 **Diagnosed** : 18 Jan 2024  
**Unique Number** : 5710695 **Diagnostician** : Kevin Marson  
**Test Package** : MOB 1 ( Additional Tests: Glycol )

**CUMMINS EASTERN CANADA LP**  
 315 AV LIBERTE  
 CANDIAC, QC  
 CA J5R 6Z7  
 Contact: Thomas Owens  
 is275@cummins.com  
 T: (450)638-6863  
 F: (450)638-1202

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.