




FUEL REPORT

Sample Rating Trend

ISO



Area
[331659]
 Machine Id
CN 1874 G2
 Component
Diesel Fuel
 Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

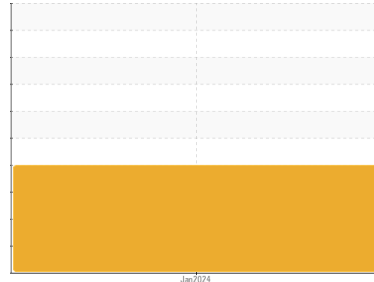

DIAGNOSIS

Recommendation

Vérifier les scelles et/ou les filters pour des points d'entrée des contaminants. Les tests de laboratoire indiquent que ce carburant peut être utilisé et qu'il répond à toutes les exigences. Le reniflard d'air doit être réparé. S'il n'est pas classé, nous vous recommandons de le remplacer par un reniflard à air adapté au micron et / ou au dessicant. Si évalué, nous vous recommandons de réparer / remplacer le reniflard. Nous vous recommandons de filtrer ce fluide avant de l'utiliser. Nous recommandons le remplacement des filtres de ce composant. Échantillonner de nouveau dans 30 à 45 jours afin de contrôler la situation.

Corrosion

(sans objet)

Contaminants

Il y a une grande quantité de limon (particules de 4 à 14 microns) dans le carburant. La teneur en eau est négligeable.

Fuel Condition

Tous les essais en laboratoire indiquent que cet échantillon satisfait aux spécifications pour le carburant diesel à ultra-faible teneur de soufre No.2 (US EPA/CGSB-3.517-3 type B). le carburant peut encore servir si la contamination peut être réduite à un niveau acceptable.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		CU0021955	---	---
Sample Date	Client Info		15 Jan 2024	---	---
Machine Age	hrs	Client Info	1525	---	---
Sample Status			SEVERE	---	---

PHYSICAL PROPERTIES

	method	limit/base	current	history1	history2
Specific Gravity	ASTM D1298*	0.839	0.837	---	---
Fuel Color	text	Visual Screen*	Yellow	---	---
Visc @ 40°C	cSt	ASTM D7279(m)	3.0	---	---
Pensky-Martens Flash Point	°C	ASTM D7215*	52	---	---

SULFUR CONTENT

	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185(m)	10	---	---

DISTILLATION

	method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D2887*	165	---	---
5% Distillation Point	°C	ASTM D2887*	183	---	---
10% Distill Point	°C	ASTM D2887*	201	---	---
15% Distillation Point	°C	ASTM D2887*	196	---	---
20% Distill Point	°C	ASTM D2887*	216	---	---
30% Distill Point	°C	ASTM D2887*	230	---	---
40% Distill Point	°C	ASTM D2887*	243	---	---
50% Distill Point	°C	ASTM D2887*	255	---	---
60% Distill Point	°C	ASTM D2887*	267	---	---
70% Distill Point	°C	ASTM D2887*	280	---	---
80% Distill Point	°C	ASTM D2887*	295	---	---
85% Distillation Point	°C	ASTM D2887*	284	---	---
90% Distill Point	°C	ASTM D2887*	310	---	---
95% Distillation Point	°C	ASTM D2887*	313	---	---
Final Boiling Point	°C	ASTM D2887*	341	---	---

IGNITION QUALITY

	method	limit/base	current	history1	history2
API Gravity	ASTM D1298*	37.7	37	---	---
Cetane Index	ASTM D4737*	<40.0	43	---	---

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	<1.0	0	---
Sodium	ppm	ASTM D5185(m)	<0.1	<1	---
Potassium	ppm	ASTM D5185(m)	<0.1	0	---
Water	%	ASTM D6304*	<0.05	0.003	---
ppm Water	ppm	ASTM D6304*	<500	26	---

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	34552	---	---
Particles >6µm	ASTM D7647	>640	7856	---	---
Particles >14µm	ASTM D7647	>80	143	---	---
Particles >21µm	ASTM D7647	>20	23	---	---
Particles >38µm	ASTM D7647	>4	1	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	22/20/14	---	---






FUEL REPORT

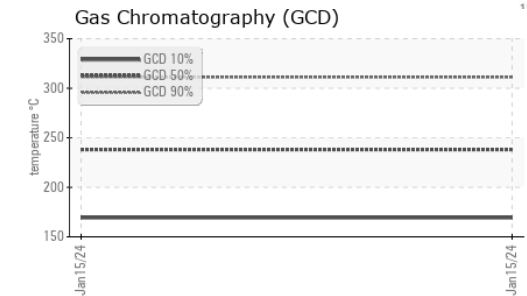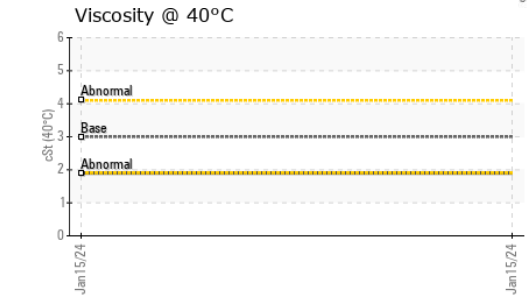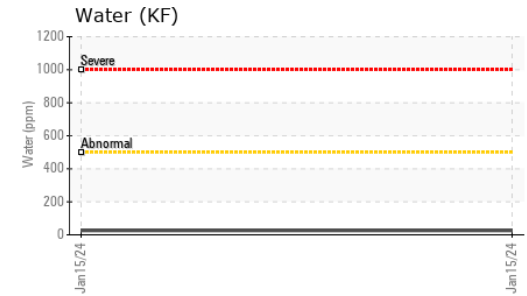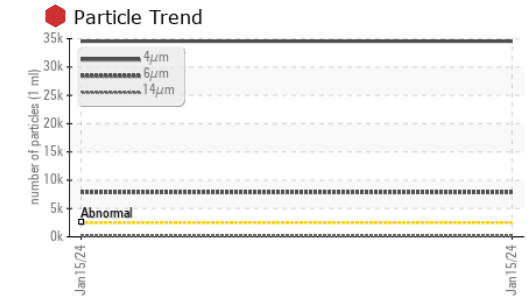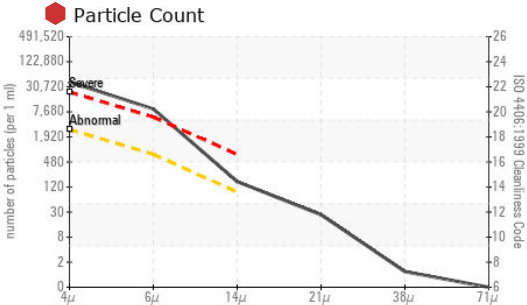

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	0	---	---
Nickel	ppm	ASTM D5185(m)	<0.1	0	---	---
Lead	ppm	ASTM D5185(m)	<0.1	0	---	---
Vanadium	ppm	ASTM D5185(m)	<0.1	0	---	---
Iron	ppm	ASTM D5185(m)	<0.1	<1	---	---
Calcium	ppm	ASTM D5185(m)	<0.1	0	---	---
Magnesium	ppm	ASTM D5185(m)	<0.1	0	---	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	0	---	---
Zinc	ppm	ASTM D5185(m)	<0.1	<1	---	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color				no image	no image	
Bottom				no image	no image	

GRAPHS

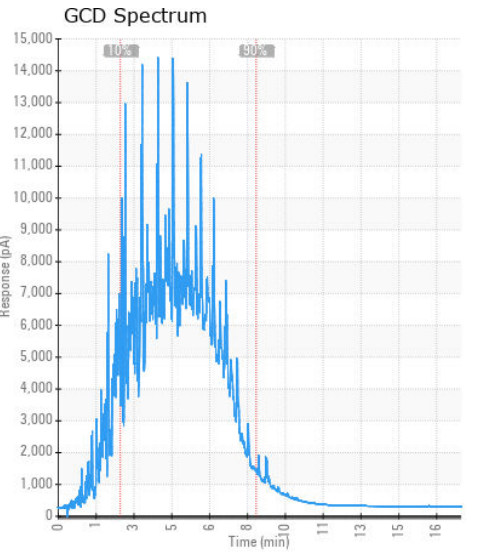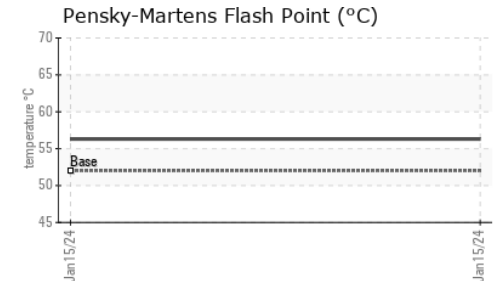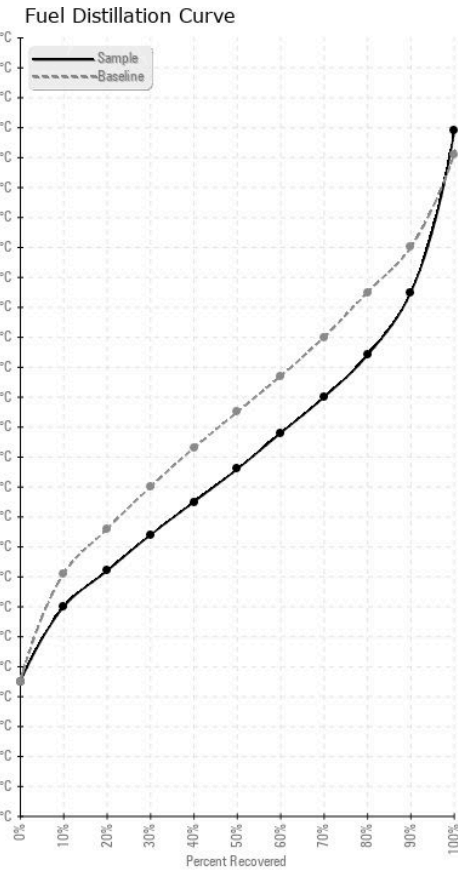

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CU0021955 **Received** : 18 Jan 2024
Lab Number : 02609792 **Diagnosed** : 22 Jan 2024
Unique Number : 5710878 **Diagnostician** : Kevin Marson
Test Package : FUEL (Additional Tests: CC Flash, GC-PercFuel, PrtCount)

CUMMINS EASTERN CANADA LP
 315 AV LIBERTE
 CANDIAC, QC
 CA J5R 6Z7
 Contact: Thomas Owens
 is275@cummins.com
 T: (450)638-6863
 F: (450)638-1202

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.