




FUEL REPORT

Sample Rating Trend

ISO



Area
[331659]
 Machine Id
CN 1874 G1
 Component
Diesel Fuel
 Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

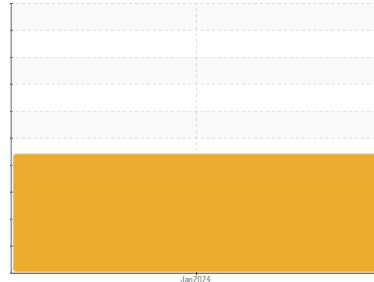

DIAGNOSIS

Recommendation

Nous vous recommandons de vérifier tous les endroits par lesquels des contaminants peuvent pénétrer dans le système. Les tests de laboratoire indiquent que ce carburant peut être utilisé et qu'il répond à toutes les exigences. Nous vous recommandons de remplacer le filtre et d'utiliser un système de filtrage hors-ligne afin d'améliorer la propreté du fluide. Le reniflard d'air doit être réparé. S'il n'est pas classé, nous vous recommandons de le remplacer par un reniflard à air adapté au micron et / ou au dessicant. Si évalué, nous vous recommandons de réparer / remplacer le reniflard. Nous vous recommandons de filtrer ce fluide avant de l'utiliser. Échantillonner de nouveau dans 30 à 45 jours afin de contrôler la situation.

Corrosion

(sans objet)

Contaminants

Il y a une quantité élevée de matières particulaires (2 à 100 µm de taille) présente dans le carburant. La teneur en eau est négligeable.

Fuel Condition

le carburant peut encore servir si la contamination peut être réduite à un niveau acceptable. Tous les essais en laboratoire indiquent que cet échantillon satisfait aux spécifications pour le carburant diesel à ultra-faible teneur de soufre No.2 (US EPA/CGSB-3.517-3 type B).

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	CU0021956	---	---
Sample Date	Client Info	15 Jan 2024	---	---
Machine Age	hrs Client Info	1556	---	---
Sample Status		SEVERE	---	---

PHYSICAL PROPERTIES

method	limit/base	current	history1	history2	
Specific Gravity	ASTM D1298*	0.839	0.837	---	---
Fuel Color	text Visual Screen*	Yellow	Red	---	---
Visc @ 40°C	cSt ASTM D7279(m)	3.0	1.9	---	---
Pensky-Martens Flash Point	°C ASTM D7215*	52	56.2	---	---

SULFUR CONTENT

method	limit/base	current	history1	history2	
Sulfur	ppm ASTM D5185(m)	10	4	---	---

DISTILLATION

method	limit/base	current	history1	history2	
Initial Boiling Point	°C ASTM D2887*	165	165	---	---
5% Distillation Point	°C ASTM D2887*		182	---	---
10% Distill Point	°C ASTM D2887*	201	189	---	---
15% Distillation Point	°C ASTM D2887*		196	---	---
20% Distill Point	°C ASTM D2887*	216	202	---	---
30% Distill Point	°C ASTM D2887*	230	213	---	---
40% Distill Point	°C ASTM D2887*	243	225	---	---
50% Distill Point	°C ASTM D2887*	255	236	---	---
60% Distill Point	°C ASTM D2887*	267	248	---	---
70% Distill Point	°C ASTM D2887*	280	260	---	---
80% Distill Point	°C ASTM D2887*	295	274	---	---
85% Distillation Point	°C ASTM D2887*		284	---	---
90% Distill Point	°C ASTM D2887*	310	294	---	---
95% Distillation Point	°C ASTM D2887*		313	---	---
Final Boiling Point	°C ASTM D2887*	341	349	---	---

IGNITION QUALITY

method	limit/base	current	history1	history2	
API Gravity	ASTM D1298*	37.7	37	---	---
Cetane Index	ASTM D4737*	<40.0	43	---	---

CONTAMINANTS


method	limit/base	current	history1	history2	
Silicon	ppm ASTM D5185(m)	<1.0	0	---	---
Sodium	ppm ASTM D5185(m)	<0.1	<1	---	---
Potassium	ppm ASTM D5185(m)	<0.1	0	---	---
Water	% ASTM D6304*	<0.05	0.003	---	---
ppm Water	ppm ASTM D6304*	<500	26	---	---

FLUID CLEANLINESS


method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>2500	44387	---	---
Particles >6µm	ASTM D7647	>640	11237	---	---
Particles >14µm	ASTM D7647	>80	293	---	---
Particles >21µm	ASTM D7647	>20	49	---	---
Particles >38µm	ASTM D7647	>4	4	---	---
Particles >71µm	ASTM D7647	>3	1	---	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	23/21/15	---	---




FUEL REPORT

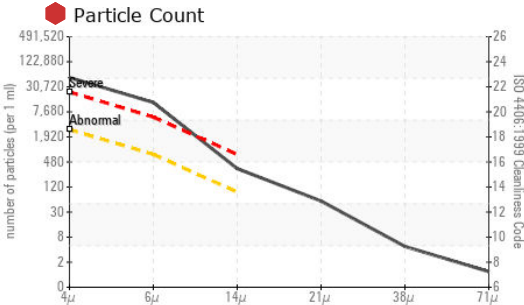






HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	0	---
Nickel	ppm	ASTM D5185(m)	<0.1	0	---
Lead	ppm	ASTM D5185(m)	<0.1	0	---
Vanadium	ppm	ASTM D5185(m)	<0.1	0	---
Iron	ppm	ASTM D5185(m)	<0.1	<1	---
Calcium	ppm	ASTM D5185(m)	<0.1	0	---
Magnesium	ppm	ASTM D5185(m)	<0.1	0	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	0	---
Zinc	ppm	ASTM D5185(m)	<0.1	<1	---

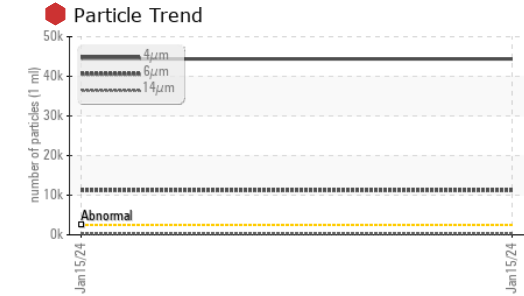

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

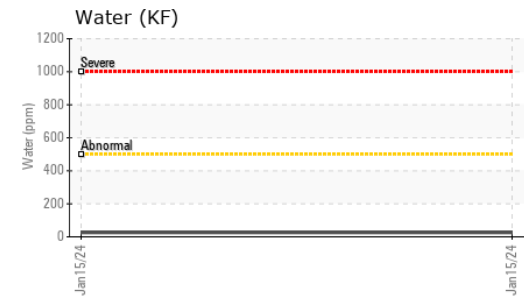

GRAPHS

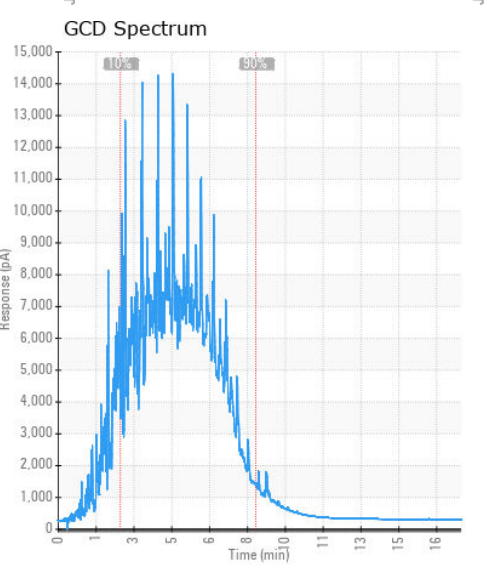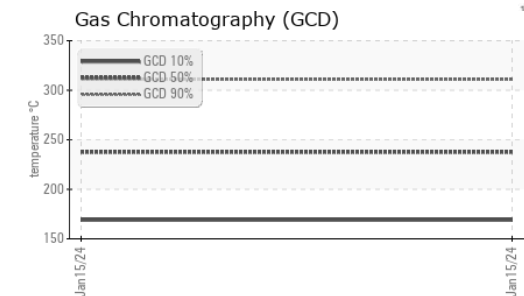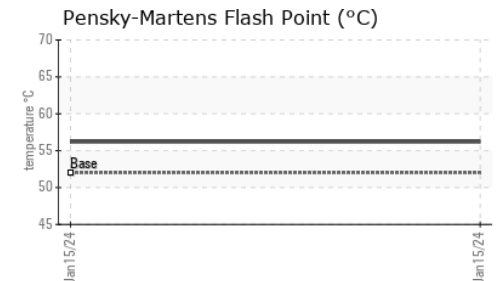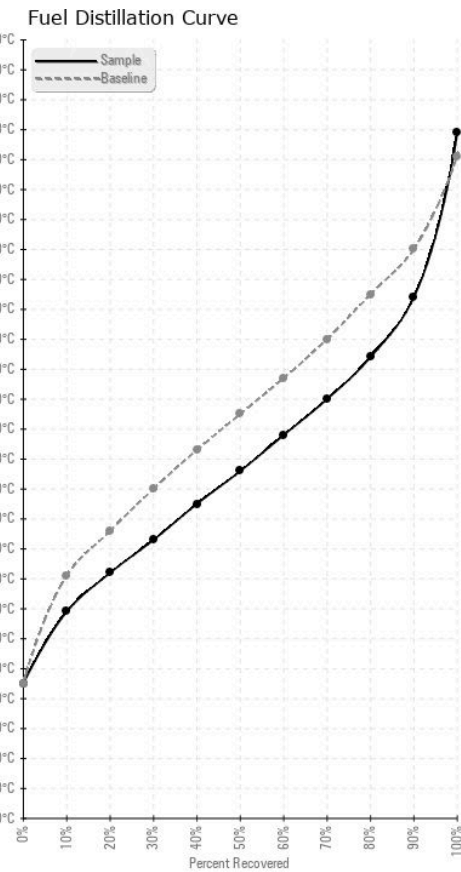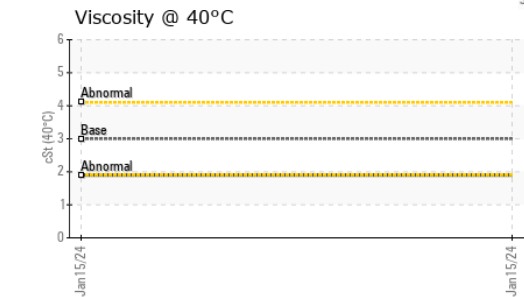

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CU0021956
Lab Number : 02609793
Unique Number : 5710879
Test Package : FUEL (Additional Tests: CC Flash, GC-PercFuel, PrtCount)

CUMMINS EASTERN CANADA LP
 315 AV LIBERTE
 CANDIAC, QC
 CA J5R 6Z7
 Contact: Thomas Owens
 is275@cummins.com
 T: (450)638-6863
 F: (450)638-1202

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.