




# PROBLEM SUMMARY


Area  
**BRUCE B/6/43230**  
 Machine Id  
**6-43230-P4-P IB Brg Drn**  
 Component  
**Inboard Bearing**  
 Fluid  
**ESSO NUTO H ISO 46 (--- GAL)**

Sample Rating Trend

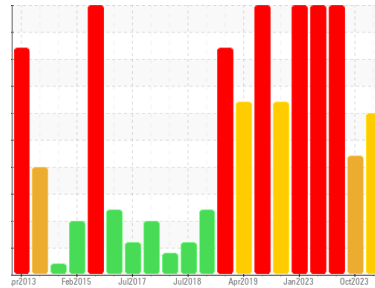


## COMPONENT CONDITION SUMMARY

Particle Trend

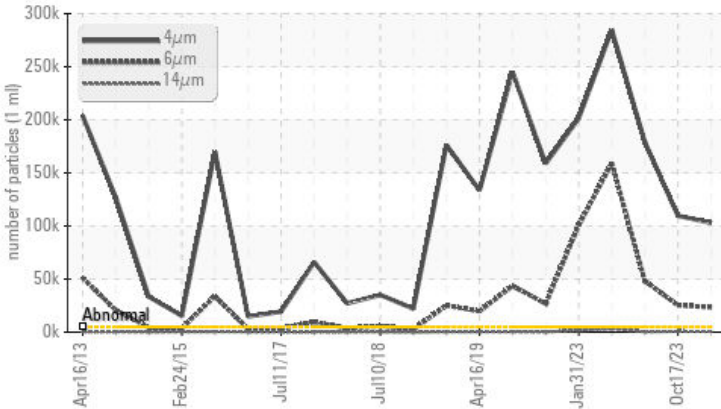

Silicon (ppm)

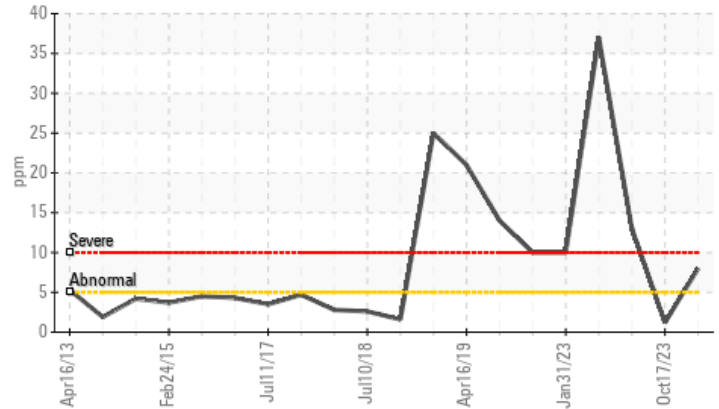


## RECOMMENDATION

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

## PROBLEMATIC TEST RESULTS

Sample Status			SEVERE	SEVERE	SEVERE	
Silicon	ppm	ASTM D5185(m)	>5	▲ 8	1	● 13
Particles >4µm		ASTM D7647	>5000	● 102908	● 109647	● 178919
Particles >6µm		ASTM D7647	>1300	● 23388	● 25331	● 48296
Particles >14µm		ASTM D7647	>320	▲ 672	▲ 725	320
Oil Cleanliness		ISO 4406 (c)	>19/17/15	● 24/22/17	● 24/22/17	● 25/23/15

PrtFilter



Customer Id: BRUTIV  
 Sample No.: WC0845394  
 Lab Number: 02610569  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Kevin Marson +1 (289)291-4644 x4644  
[Kevin.Marson@wearcheck.com](mailto:Kevin.Marson@wearcheck.com)


To change component or sample information:  
 Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.
Resample	---	---	?	Resample in 30-45 days to monitor this situation.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.
Filter Fluid	---	---	?	We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.

HISTORICAL DIAGNOSIS


ISO




**17 Oct 2023 Diag: Kevin Marson**

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report




WEAR




**22 Sep 2023 Diag: Kevin Marson**

Check seals and/or filters for points of contaminant entry. Check seals and/or filters for points of contaminant entry. We advise that you check all areas where dirt can enter the system. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Copper ppm levels are severe. Bearing wear is indicated. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. There is a high amount of silt (particulates < 14 microns in size) present in the oil. Elemental level of silicon (Si) above normal indicating ingress of seal material. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

view report




WEAR



**11 Apr 2023 Diag: Kevin Marson**

Check seals and/or filters for points of contaminant entry. We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. No other corrective action is recommended at this time. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Chromium and copper and tin ppm levels are severe. Lead ppm levels are abnormal. Wear particle analysis indicates that the ferrous cutting particles are marginal. Bearing wear is indicated. Cutting wear particles are caused by either hard protuberances (mis-aligned components, etc.), or abrasives entering the system and embedding themselves in softer materials (sand, etc.), and gouging out mating surfaces. There is a high amount of particulates (2 to 100 microns in size) present in the oil. Elemental level of silicon (Si) above normal indicating ingress of seal material. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

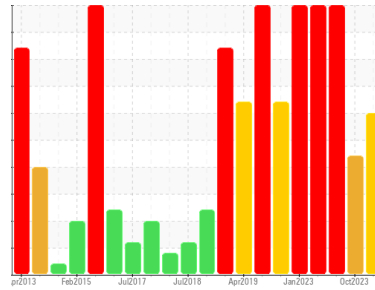

ISO



Area  
**BRUCE B/6/43230**  
 Machine Id  
**6-43230-P4-P IB Brg Drn**  
 Component  
**Inboard Bearing**  
 Fluid  
**ESSO NUTO H ISO 46 (--- GAL)**

## DIAGNOSIS

### Recommendation

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

### Wear

All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system.


### Contaminants

There is a high amount of silt (particulates < 14 microns in size) present in the oil. Elemental level of silicon (Si) above normal indicating ingress of seal material. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code.

### Oil Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

Particle Filter (Magn: 200 x)

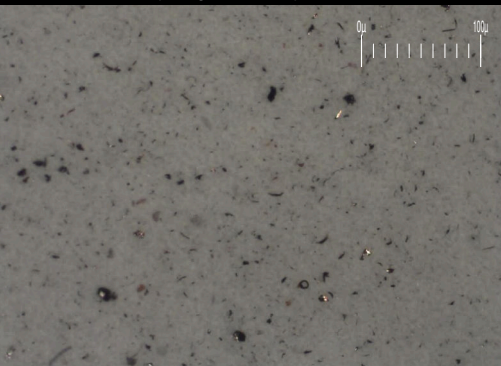

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0845394</b>	WC0791594	WC0845425
Sample Date	Client Info	<b>16 Jan 2024</b>	17 Oct 2023	22 Sep 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>SEVERE</b>	SEVERE	SEVERE

## WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185(m)	>10	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185(m)	>5	<b>2</b>	1	4
Nickel	ppm	ASTM D5185(m)	>5	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185(m)	>5	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185(m)	>5	<b>&lt;1</b>	<1	3
Copper	ppm	ASTM D5185(m)	>5	<b>1</b>	<1	12
Tin	ppm	ASTM D5185(m)	>5	<b>&lt;1</b>	<1	3
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185(m)	0	<b>0</b>	<1	0
Barium	ppm	ASTM D5185(m)	0	<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)	5	<b>&lt;1</b>	<1	<1
Calcium	ppm	ASTM D5185(m)	50	<b>53</b>	53	52
Phosphorus	ppm	ASTM D5185(m)	330	<b>353</b>	345	348
Zinc	ppm	ASTM D5185(m)	410	<b>429</b>	437	439
Sulfur	ppm	ASTM D5185(m)	2700	<b>6053</b>	5863	5831
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

## CONTAMINANTS






method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185(m)	>5	<b>▲ 8</b>	1	13
Sodium	ppm	ASTM D5185(m)	>5	<b>0</b>	0	0
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304*	>0.005	<b>0.001</b>	0.001	0.001
ppm Water	ppm	ASTM D6304*	>50	<b>7</b>	14.5	3.0

## FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>5000	<b>102908</b>	109647	178919
Particles >6µm	ASTM D7647	>1300	<b>23388</b>	25331	48296
Particles >14µm	ASTM D7647	>320	<b>▲ 672</b>	725	320
Particles >21µm	ASTM D7647	>80	<b>▲ 125</b>	118	21
Particles >38µm	ASTM D7647	>20	<b>4</b>	2	1
Particles >71µm	ASTM D7647	>4	<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/15	<b>24/22/17</b>	24/22/17	25/23/15



# OIL ANALYSIS REPORT

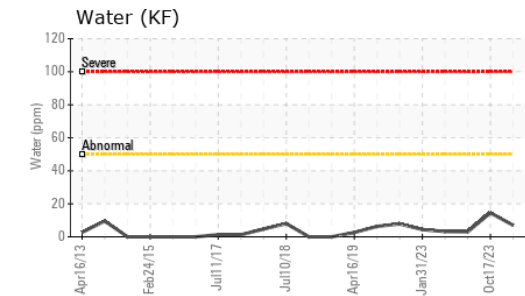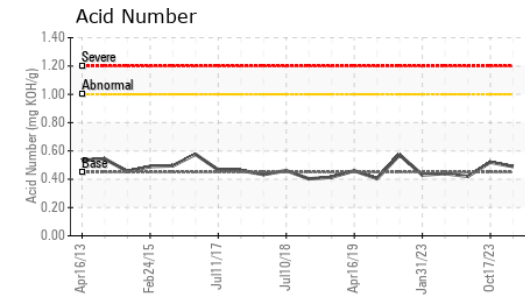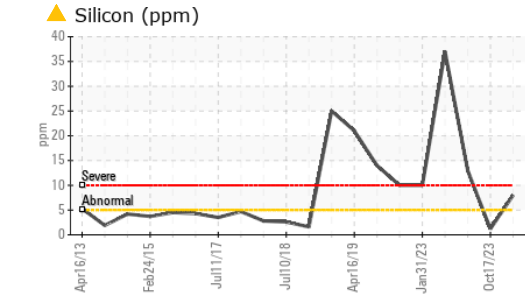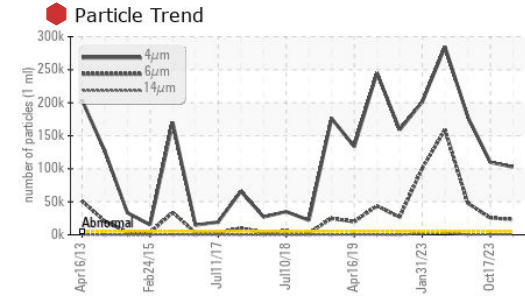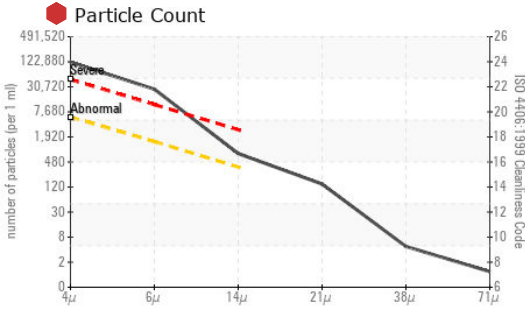

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0845394 **Received** : 23 Jan 2024  
**Lab Number** : 02610569 **Diagnosed** : 26 Jan 2024  
**Unique Number** : 5711655 **Diagnostician** : Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: A-FERR, BottomAnalysis, DR-FERR, FILTERPATCH, PrtFilter, TAN Man )

**Bruce Power - Bruce A PdM**  
 P.O.Box 1540, 177 Tie Road., RM-222 U2 Column 2N11 615'  
 Tiverton, ON  
 CA N0G 2T0  
 Contact: Pierre Adouki  
 pierre.adouki@brucepower.com  
 T: (519)361-2673  
 F:


To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.45	<b>0.49</b>	0.52	0.42

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	VLITE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.005	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	46	<b>43.1</b>	43.1	43.0




SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

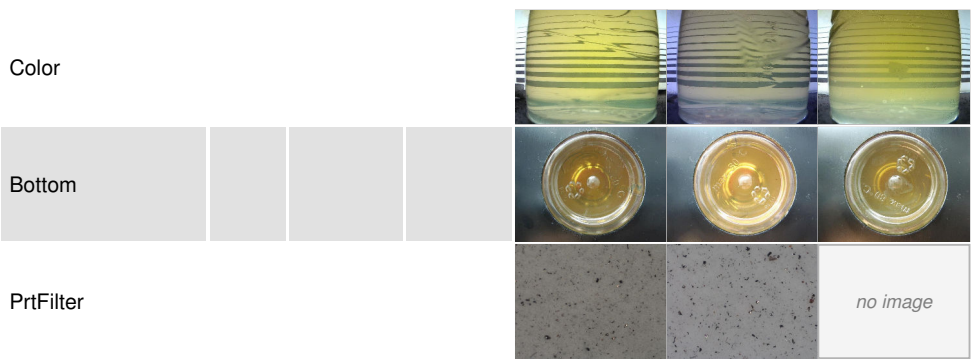



# FERROGRAPHY REPORT

Area  
**BRUCE B/6/43230**  
 Machine Id  
**6-43230-P4-P IB Brg Drn**  
 Component  
**Inboard Bearing**  
 Fluid  
**ESSO NUTO H ISO 46 (--- GAL)**

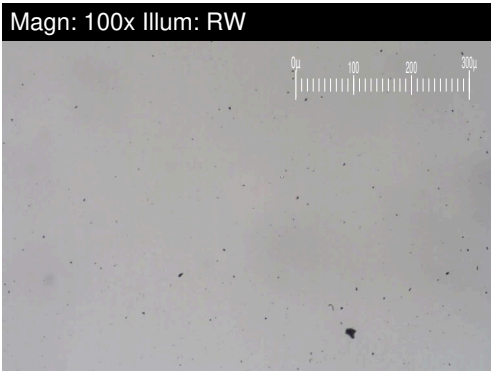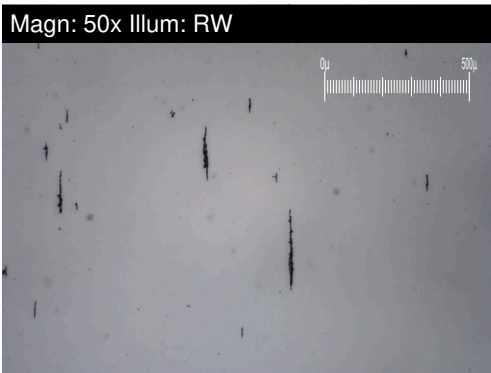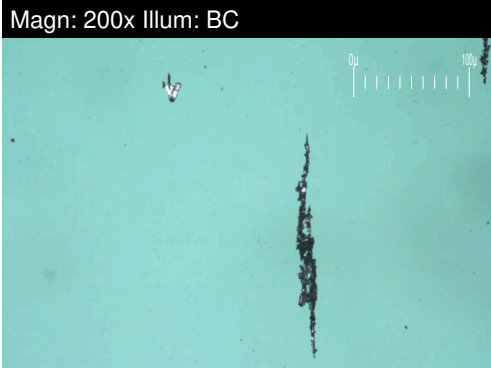


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		<b>9.4</b>	9.3	2.9
Small Particles		DR-Ferr*		<b>6.3</b>	3.0	3.8
Total Particles		DR-Ferr*	>---	<b>15.7</b>	12.3	6.7
Large Particles Percentage	%	DR-Ferr*		<b>19.7</b>	51.2	0
Severity Index		DR-Ferr*		<b>29</b>	59	3

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		<b>2</b>		2
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		<b>1</b>		1
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*		<b>1</b>		
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		<b>1</b>		1
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		<b>1</b>		2

## WEAR

All component wear rates are normal.  
 The ferrography results are normal indicating no abnormal wear in the system.

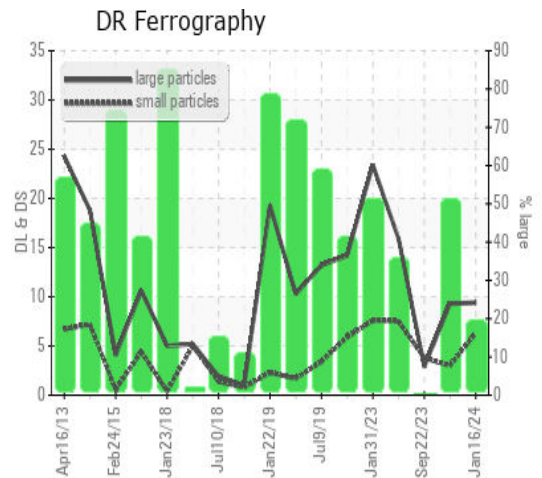

*This page left intentionally blank*