




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**Production de l'énergie électrique**  
 Machine Id  
**13B02#01 - Diesel auxiliaire 1 (S/N 524101274)**  
 Component  
**Diesel Engine**  
 Fluid  
**PETRO CANADA DURON SHP 15W40 (--- GAL)**

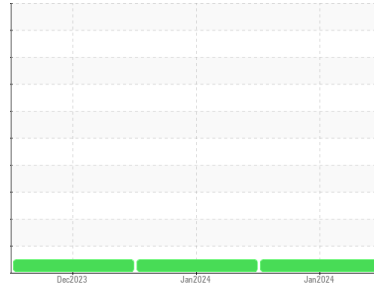

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.  
 Please specify the component make and model with your next sample.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0866041</b>	WC0866042	WC0866051
Sample Date	Client Info			<b>23 Jan 2024</b>	20 Jan 2024	22 Dec 2023
Machine Age	hrs	Client Info		<b>35583</b>	36497	35962
Oil Age	hrs	Client Info		<b>0</b>	2000	0
Oil Changed	Client Info			<b>Not Chngd</b>	Changed	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2		<b>NEG</b>	NEG	NEG
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>100	<b>7</b>	10	8
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>4	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<b>1</b>	1	1
Lead	ppm	ASTM D5185(m)	>40	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185(m)	>330	<b>&lt;1</b>	1	1
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	<b>2</b>	2	2
Barium	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)	60	<b>61</b>	62	62
Manganese	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)	1010	<b>1001</b>	1017	1011
Calcium	ppm	ASTM D5185(m)	1070	<b>1098</b>	1127	1102
Phosphorus	ppm	ASTM D5185(m)	1150	<b>1037</b>	1035	1039
Zinc	ppm	ASTM D5185(m)	1270	<b>1220</b>	1251	1223
Sulfur	ppm	ASTM D5185(m)	2060	<b>2762</b>	2743	2759
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	<b>2</b>	2	2
Sodium	ppm	ASTM D5185(m)		<b>1</b>	1	<1
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	<1

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>3	<b>0.1</b>	0.2	0.1
Nitration	Abs/cm	ASTM D7624*	>20	<b>6.8</b>	7.6	7.3
Sulfation	Abs.1mm	ASTM D7415*	>30	<b>19.2</b>	19.7	19.5



# OIL ANALYSIS REPORT



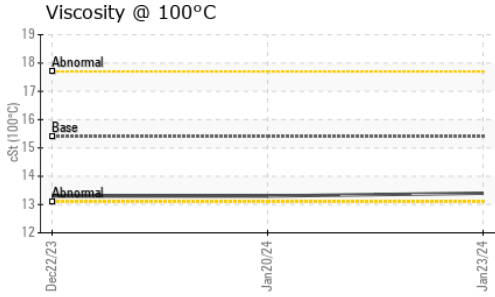


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	>25	<b>15.3</b>	16.3	16.0

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	<b>13.4</b>	13.3	13.3

## GRAPHS

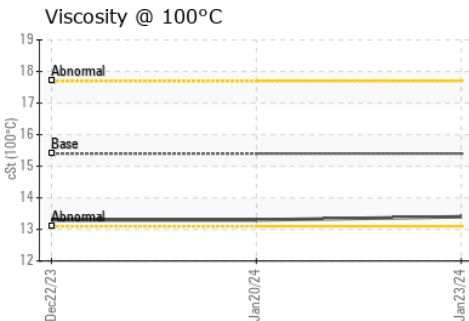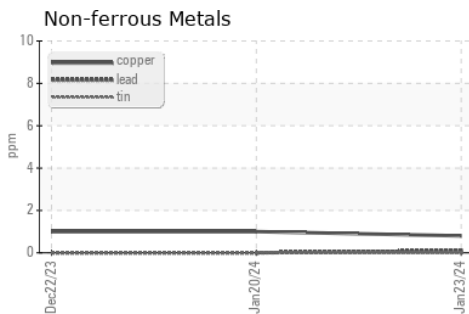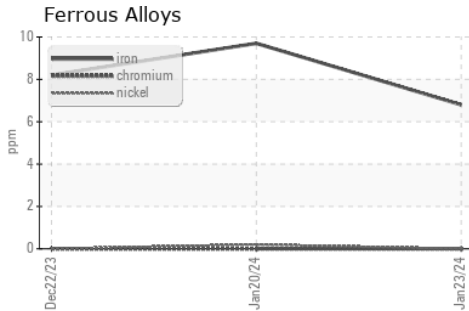

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0866041  
**Lab Number** : **02610798**  
**Unique Number** : 5711884  
**Test Package** : MAR 1

**Canadian Coast Guard**  
 CCGS Pierre Radisson, 101 Boul. Champlain  
 Quebec, QC  
 CA G1K 7Y7  
 Contact: Pierre Radisson  
 PierreRadissonCE@ccgs-ngcc.gc.ca  
 T: (418)563-1737  
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.