




OIL ANALYSIS REPORT

Sample Rating Trend

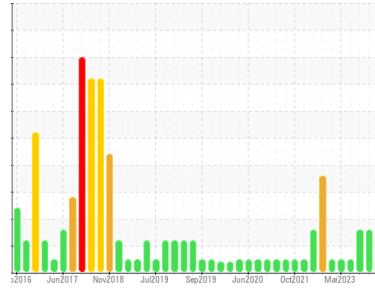

NORMAL



Area
T.A.P
 Machine Id
52-2401-02
 Component
Reduction Gear
 Fluid
MOBIL MOBILGEAR 600 XP 320 (205 LTR)

DIAGNOSIS

Recommendation

Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition.

Wear

Les taux d'usure de tous les composants sont normaux.

Contamination

La propreté du système est acceptable pour votre objectif de propreté ISO 4406. La teneur en eau est négligeable. La propreté du système et du fluide est acceptable.

Fluid Condition

Le AN est acceptable pour ce fluide. L'état de l'huile permet d'en prolonger l'utilisation.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0901044	WC0872707	WC0818551
Sample Date	Client Info	07 Mar 2024	04 Dec 2023	21 Jun 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	Not Changd	N/A
Sample Status		NORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m) >117	29	28	23
Chromium	ppm	ASTM D5185(m) >2	0	0	<1
Nickel	ppm	ASTM D5185(m) >2	<1	<1	<1
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	<1	0
Aluminum	ppm	ASTM D5185(m) >11	<1	<1	<1
Lead	ppm	ASTM D5185(m) >10	5	5	4
Copper	ppm	ASTM D5185(m) >55	17	15	12
Tin	ppm	ASTM D5185(m) >15	<1	1	<1
Antimony	ppm	ASTM D5185(m) >5	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m) 32	16	16	16
Barium	ppm	ASTM D5185(m) 0.0	0	<1	0
Molybdenum	ppm	ASTM D5185(m) 0.0	0	0	<1
Manganese	ppm	ASTM D5185(m) 0.0	0	0	<1
Magnesium	ppm	ASTM D5185(m) 0.4	1	<1	<1
Calcium	ppm	ASTM D5185(m) 1.8	6	4	3
Phosphorus	ppm	ASTM D5185(m) 308	291	291	322
Zinc	ppm	ASTM D5185(m) 0.3	10	9	9
Sulfur	ppm	ASTM D5185(m) 16666	15126	14917	15197
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS






method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m) >50	3	5	4
Sodium	ppm	ASTM D5185(m)	10	10	10
Potassium	ppm	ASTM D5185(m) >20	1	<1	1
Water	%	ASTM D6304* >0.1	0.005	0.014	0.00
ppm Water	ppm	ASTM D6304* >1000	55	144	0.00

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	1524	6645	10103
Particles >6µm	ASTM D7647 >640	353	▲ 1943	▲ 3334
Particles >14µm	ASTM D7647 >80	35	▲ 199	▲ 354
Particles >21µm	ASTM D7647 >20	11	▲ 60	▲ 107
Particles >38µm	ASTM D7647 >4	2	6	4
Particles >71µm	ASTM D7647 >3	1	0	1
Oil Cleanliness	ISO 4406 (c) >--/16/13	18/16/12	▲ 20/18/15	▲ 21/19/16



OIL ANALYSIS REPORT

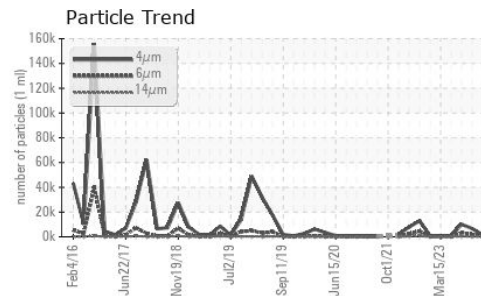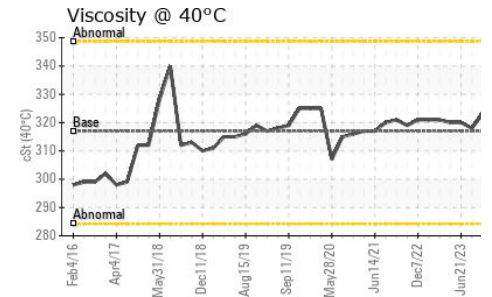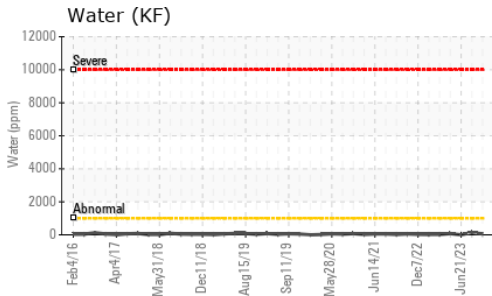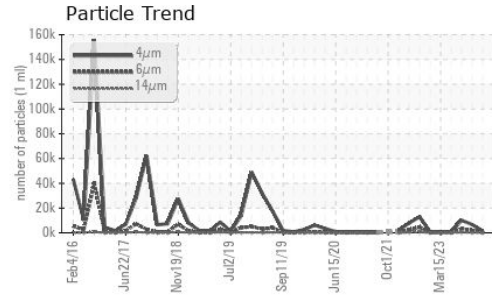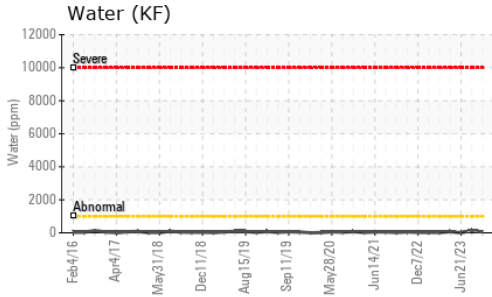


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.630	1.04	0.98	0.96





VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	317	323	318	320

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

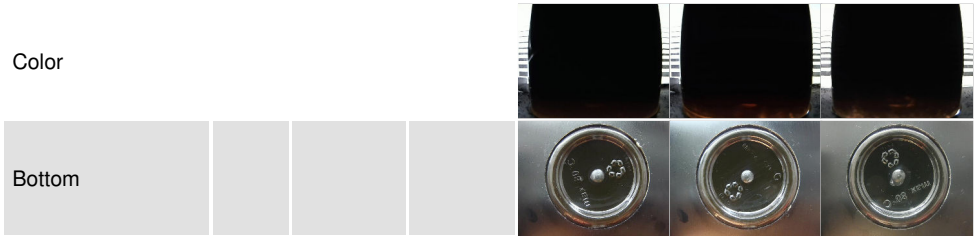

GRAPHS

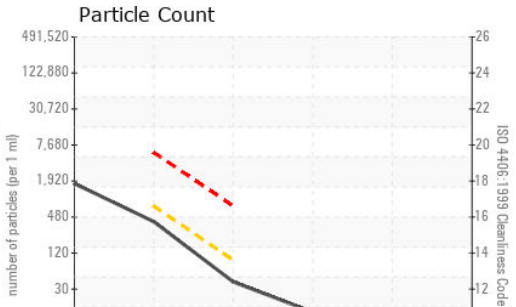

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0901044 **Received** : 11 Mar 2024
Lab Number : **02621238** **Tested** : 12 Mar 2024
Unique Number : 5746357 **Diagnosed** : 12 Mar 2024 - Wes Davis
Test Package : IND 2 (Additional Tests: KF, TAN Man)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

RTA - UGB
 C.P. 900
 Ville de la Baie, QC
 CA G7B 4G9
 Contact: Alcan Epc
 mathieu.tremblay2@riotinto.com
 T: (418)697-9568
 F: (418)697-9550