




OIL ANALYSIS REPORT

Sample Rating Trend

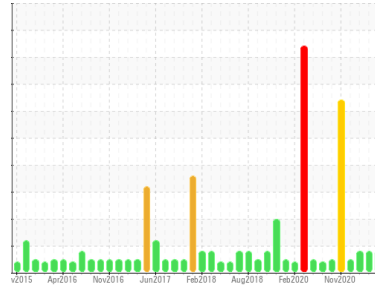

ISO



Area
1 White Oil/029 #2HTU/P Pump/401C 2 Stage HTU Charge
 Machine Id
N/A 29P401C (RECIP)
 Component
Pump
 Fluid
PETRO CANADA COMPRO COMPRESSOR OIL 150 (150 LTR)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a light amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0902165	WC0783264	WC0301714
Sample Date	Client Info		25 Feb 2024	17 Feb 2023	06 Jan 2022
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	ATTENTION	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >90	<1	<1	<1
Chromium	ppm	ASTM D5185(m) >5	0	0	0
Nickel	ppm	ASTM D5185(m) >5	<1	0	<1
Titanium	ppm	ASTM D5185(m) >3	0	0	0
Silver	ppm	ASTM D5185(m) >3	0	0	0
Aluminum	ppm	ASTM D5185(m) >7	<1	<1	<1
Lead	ppm	ASTM D5185(m) >12	0	<1	<1
Copper	ppm	ASTM D5185(m) >30	<1	<1	<1
Tin	ppm	ASTM D5185(m) >9	0	0	<1
Antimony	ppm	ASTM D5185(m)	0	0	0
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	0	<1	<1
Barium	ppm	ASTM D5185(m) 0	0	0	0
Molybdenum	ppm	ASTM D5185(m) 0	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m) 70	<1	0	0
Calcium	ppm	ASTM D5185(m) 0	0	0	<1
Phosphorus	ppm	ASTM D5185(m) 60	0	6	2
Zinc	ppm	ASTM D5185(m) 2	<1	1	<1
Sulfur	ppm	ASTM D5185(m) 5300	3313	3161	3158
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >60	<1	<1	0
Sodium	ppm	ASTM D5185(m)	0	0	0
Potassium	ppm	ASTM D5185(m) >20	0	0	<1

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		5391	4059	3876
Particles >6µm	ASTM D7647	>1300	1355	1338	1292
Particles >14µm	ASTM D7647	>160	77	85	226
Particles >21µm	ASTM D7647	>40	12	17	102
Particles >38µm	ASTM D7647	>10	0	0	8
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/14	20/18/13	19/18/14	19/17/15



OIL ANALYSIS REPORT

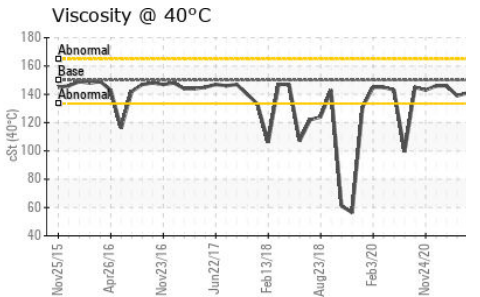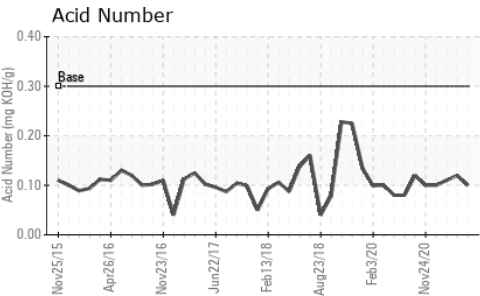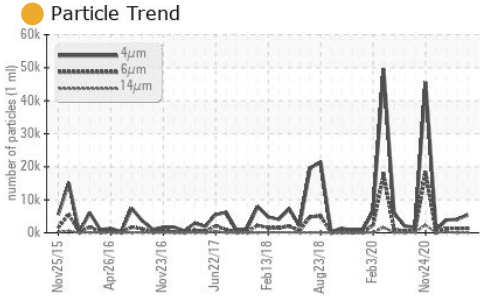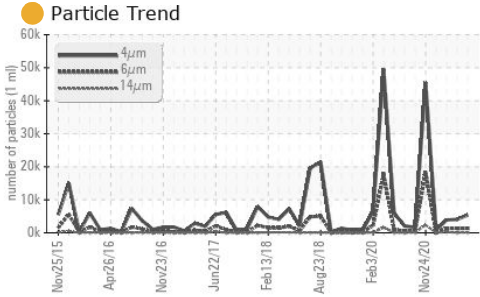







FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.3	0.10	0.12	0.11

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	VLITE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>.1	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	150	141	139	146

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						

GRAPHS

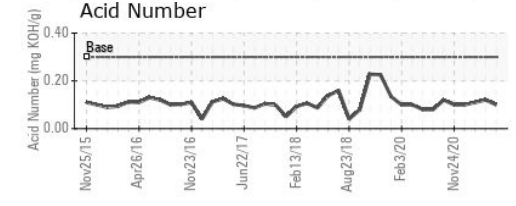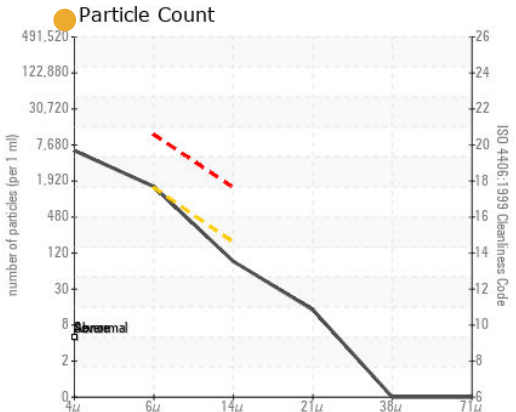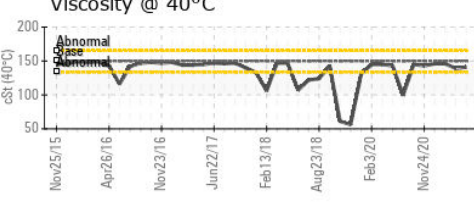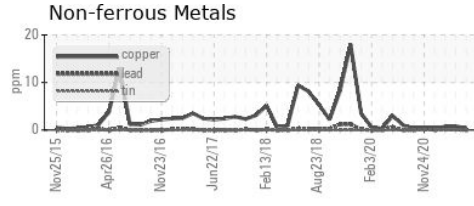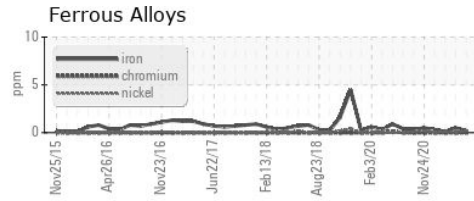

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0902165 **Received** : 11 Mar 2024
Lab Number : **02621254** **Tested** : 12 Mar 2024
Unique Number : 5746373 **Diagnosed** : 12 Mar 2024 - Wes Davis
Test Package : IND 2 (Additional Tests: TAN Man)

Petro Canada Lubricants Inc.
 385 Southdown Road
 Mississauga, ON
 CA L5J 2Y3
 Contact: Kyle Blezard
 kyle.blezard@HFSinclair.com
 T: (905)403-6768
 F: (905)822-6025

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.