




OIL ANALYSIS REPORT

Sample Rating Trend

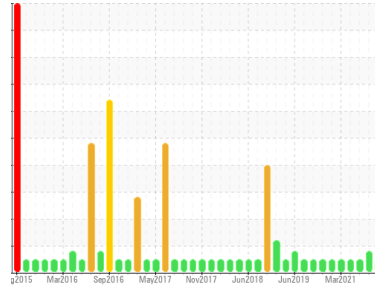

NORMAL



Area
1 White Oil/028 #1HTU/P Pump/201C 1 Stage HTU Charge
 Machine Id
N/A 28GP201C
 Component
Gearbox
 Fluid
PETRO CANADA ENDURATEX SYNTHETIC EP 220 (85 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | WC0902158 | WC0783257 | WC0296188 |
| Sample Date | Client Info | | 25 Feb 2024 | 17 Feb 2023 | 06 Jan 2022 |
| Machine Age | hrs | Client Info | 0 | 0 | 0 |
| Oil Age | hrs | Client Info | 0 | 0 | 0 |
| Oil Changed | Client Info | | N/A | N/A | N/A |
| Sample Status | | | NORMAL | ATTENTION | NORMAL |

CONTAMINATION

| | method | limit/base | current | history1 | history2 |
|-------|-----------|------------|------------|----------|----------|
| Water | WC Method | >0.2 | NEG | NEG | NEG |

WEAR METALS

| | method | limit/base | current | history1 | history2 | |
|-----------|--------|---------------|---------|--------------|----------|----|
| Iron | ppm | ASTM D5185(m) | >200 | 3 | 5 | <1 |
| Chromium | ppm | ASTM D5185(m) | >15 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185(m) | >15 | <1 | 0 | 0 |
| Titanium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185(m) | | 0 | 0 | <1 |
| Aluminum | ppm | ASTM D5185(m) | >25 | <1 | <1 | 0 |
| Lead | ppm | ASTM D5185(m) | >100 | <1 | 0 | <1 |
| Copper | ppm | ASTM D5185(m) | >200 | <1 | <1 | <1 |
| Tin | ppm | ASTM D5185(m) | >25 | 0 | 0 | 0 |
| Antimony | ppm | ASTM D5185(m) | >5 | 0 | <1 | 0 |
| Vanadium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Beryllium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 | |
|------------|--------|---------------|---------|--------------|----------|------|
| Boron | ppm | ASTM D5185(m) | 33 | 23 | 10 | 27 |
| Barium | ppm | ASTM D5185(m) | 5 | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185(m) | 5 | <1 | <1 | 0 |
| Calcium | ppm | ASTM D5185(m) | 5 | <1 | 0 | <1 |
| Phosphorus | ppm | ASTM D5185(m) | 437 | 418 | 454 | 432 |
| Zinc | ppm | ASTM D5185(m) | 5 | 1 | 3 | <1 |
| Sulfur | ppm | ASTM D5185(m) | 5000 | 4963 | 4896 | 4861 |
| Lithium | ppm | ASTM D5185(m) | | <1 | <1 | <1 |





CONTAMINANTS

| | method | limit/base | current | history1 | history2 | |
|-----------|--------|---------------|---------|--------------|----------|----|
| Silicon | ppm | ASTM D5185(m) | >50 | <1 | <1 | 0 |
| Sodium | ppm | ASTM D5185(m) | | <1 | <1 | <1 |
| Potassium | ppm | ASTM D5185(m) | >20 | <1 | <1 | <1 |

FLUID CLEANLINESS

| | method | limit/base | current | history1 | history2 |
|-----------------|--------------|------------|-----------------|----------|----------|
| Particles >4µm | ASTM D7647 | >20000 | 4489 | 16451 | 1712 |
| Particles >6µm | ASTM D7647 | >5000 | 1141 | 5044 | 402 |
| Particles >14µm | ASTM D7647 | >640 | 58 | 430 | 21 |
| Particles >21µm | ASTM D7647 | >160 | 17 | 110 | 4 |
| Particles >38µm | ASTM D7647 | >40 | 3 | 3 | 0 |
| Particles >71µm | ASTM D7647 | >10 | 1 | 1 | 0 |
| Oil Cleanliness | ISO 4406 (c) | >21/19/16 | 19/17/13 | 21/20/16 | 18/16/12 |

OIL ANALYSIS REPORT

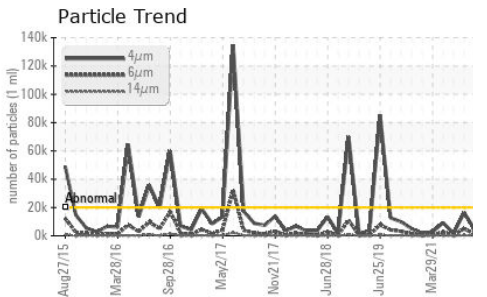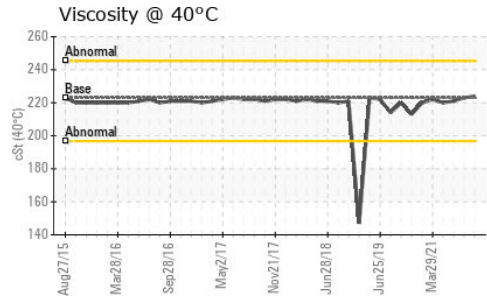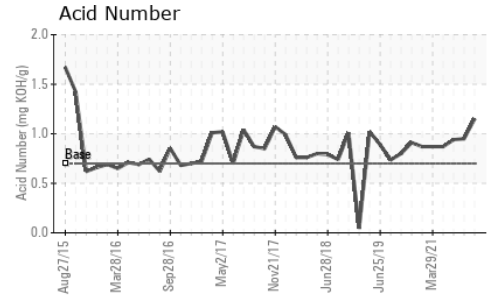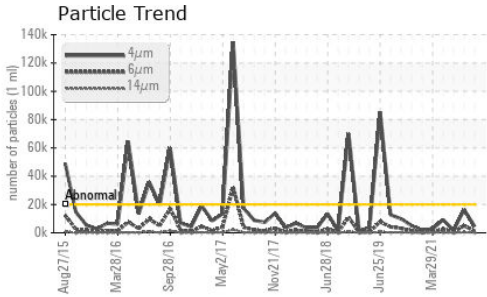


| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D974* | 0.7 | 1.15 | 0.95 | 0.94 |






| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------|--------|---------|------------|--------------|----------|----------|
| White Metal | scalar | Visual* | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | Visual* | NONE | NONE | NONE | NONE |
| Precipitate | scalar | Visual* | NONE | NONE | NONE | NONE |
| Silt | scalar | Visual* | NONE | NONE | NONE | NONE |
| Debris | scalar | Visual* | NONE | NONE | NONE | VLITE |
| Sand/Dirt | scalar | Visual* | NONE | NONE | NONE | NONE |
| Appearance | scalar | Visual* | NORML | NORML | NORML | NORML |
| Odor | scalar | Visual* | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | Visual* | >0.2 | NEG | NEG | NEG |
| Free Water | scalar | Visual* | | NEG | NEG | NEG |

| FLUID PROPERTIES | | method | limit/base | current | history1 | history2 |
|------------------|-----|---------------|------------|------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D7279(m) | 223 | 224 | 223 | 221 |

SAMPLE IMAGES

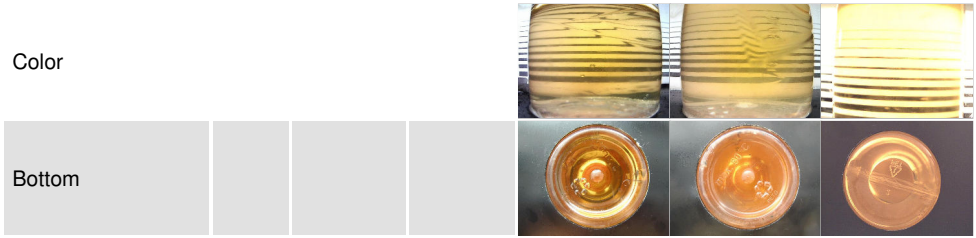

GRAPHS

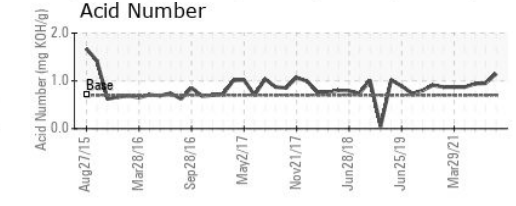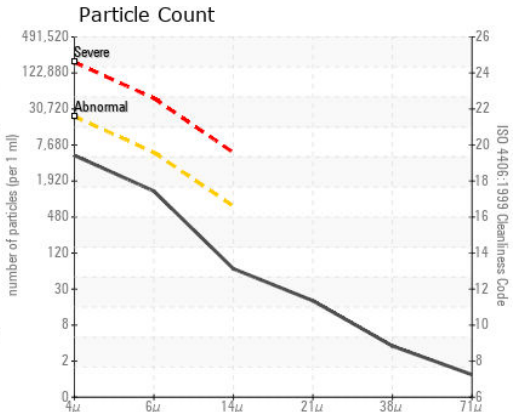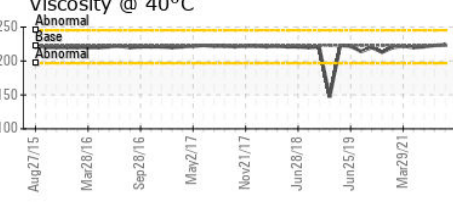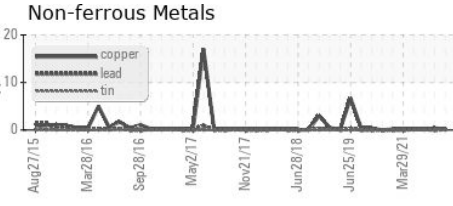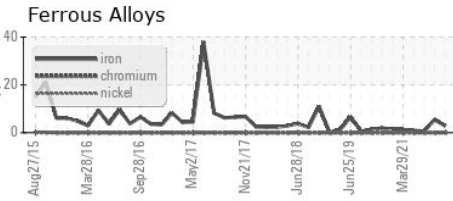

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0902158 **Received** : 11 Mar 2024
Lab Number : **02621262** **Tested** : 12 Mar 2024
Unique Number : 5746381 **Diagnosed** : 12 Mar 2024 - Wes Davis
Test Package : IND 2 (Additional Tests: TAN Man)

Petro Canada Lubricants Inc.
 385 Southdown Road
 Mississauga, ON
 CA L5J 2Y3
 Contact: Kyle Blezard
 kyle.blezard@HFSinclair.com
 T: (905)403-6768
 F: (905)822-6025

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.