




# OIL ANALYSIS REPORT

## Sample Rating Trend

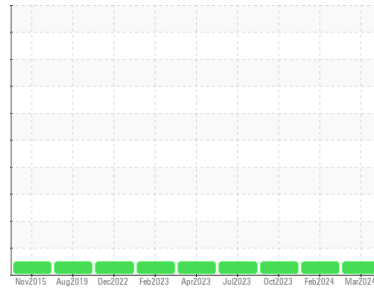

**NORMAL**



Area

**Bruce B/0B/54300**

Machine Id

**0B-54300-EPG3-VH902-1**

Component

**Turbine**

Fluid

**SHELL AEROSHELL 500 (1800 LTR)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor. Diagnostician's Note: RULER testing not performed as we do not have a new unused sample of Shell Aeroshell 500 for reference. We understand that these samples are being sent. Once received we will conduct this testing and re-issue the sample report.

#### Wear

All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system.

#### Contaminants

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

#### Oil Condition

Rust Prevention test (ASTM D665) indicates the oil retains good anti-corrosion properties. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0821164</b>	WC0642728	WC0677277
Sample Date	Client Info		<b>06 Mar 2024</b>	06 Feb 2024	27 Oct 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

### WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	---	---
Iron	ppm	ASTM D5185(m) >2	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185(m) >1	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m) >1	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185(m) >5	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185(m) >1	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185(m) >2	<b>&lt;1</b>	<1	0
Copper	ppm	ASTM D5185(m) >1	<b>0</b>	0	<1
Tin	ppm	ASTM D5185(m) >1	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	<b>0</b>	0	<1
Barium	ppm	ASTM D5185(m) 0	<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m) 0	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m) 0	<b>0</b>	<1	0
Calcium	ppm	ASTM D5185(m) 0	<b>0</b>	<1	<1
Phosphorus	ppm	ASTM D5185(m) 1000	<b>1163</b>	1180	1145
Zinc	ppm	ASTM D5185(m) 5	<b>&lt;1</b>	<1	<1
Sulfur	ppm	ASTM D5185(m) 0	<b>0</b>	0	11
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >5	<b>0</b>	0	0
Sodium	ppm	ASTM D5185(m) >5	<b>0</b>	0	0
Potassium	ppm	ASTM D5185(m) >20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304* >0.05	<b>0.002</b>	0.001	0.002
ppm Water	ppm	ASTM D6304* >500	<b>18</b>	11	21.2


### INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	<b>0</b>	---	---
Nitration	Abs/cm	ASTM D7624*	<b>3.9</b>	---	---
Sulfation	Abs.1mm	ASTM D7415*	<b>22.8</b>	---	---




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

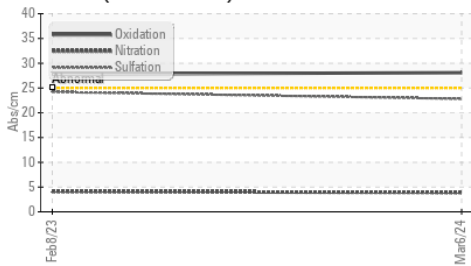


Foaming SEQ I/II/III

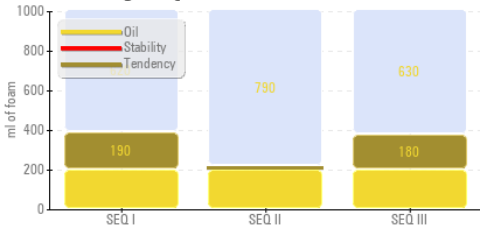


Varnish Potential

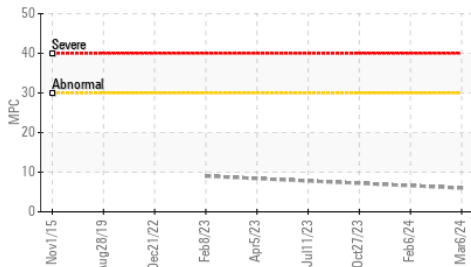

RPVOT

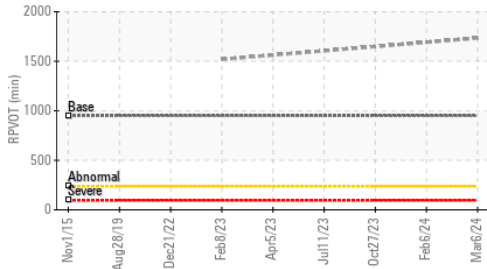

Particle Count

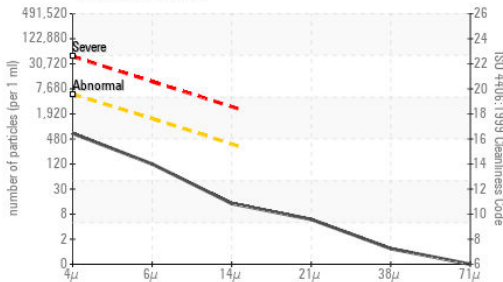

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>575</b>	520	428
Particles >6µm	ASTM D7647	>1300	<b>106</b>	156	116
Particles >14µm	ASTM D7647	>320	<b>12</b>	18	13
Particles >21µm	ASTM D7647	>80	<b>5</b>	5	3
Particles >38µm	ASTM D7647	>20	<b>1</b>	1	1
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/15	<b>16/14/11</b>	16/14/11	16/14/11


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	<b>28.1</b>	---	---
Acid Number (AN)	mg KOH/g	ASTM D974*	<b>0.16</b>	0.16	0.14
MPC Varnish Potential	Scale	ASTM D7843(m)*	<b>6</b>	---	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*	<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	<b>29.5</b>	29.5	28.7
Visc @ 100°C	cSt	ASTM D7279(m)	<b>5.5</b>	---	5.6
Viscosity Index (VI)	Scale	ASTM D2270*	<b>125</b>	---	137
Separability	oil/h2o/em	ASTM D1401*	<b>40/40/0 (10)</b>	---	---
Air Release Time	min	ASTM D3427*	<b>1.40</b>	---	---
Foam Tendency	I/II/III	ASTM D892*	<b>190/20/180</b>	---	---
Foam Stability	I/II/III	ASTM D892*	<b>0/0/0</b>	---	---
ASTM Color	scalar	ASTM D1500*	<b>L2.0</b>	---	---
Rust Prevention	PASS/FAIL	ASTM D665*	<b>PASS</b>	---	---
Oxidation Test (RPVOT)	minutes	ASTM D2272*	<b>1734</b>	---	---

SEDIMENT	method	limit/base	current	history1	history2
Pentane Insolubles	%	ASTM D893(m)*	<b>0.052</b>	---	---
Toluene Insolubles	%	ASTM D893(m)*	<b>0.018</b>	---	0.008

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

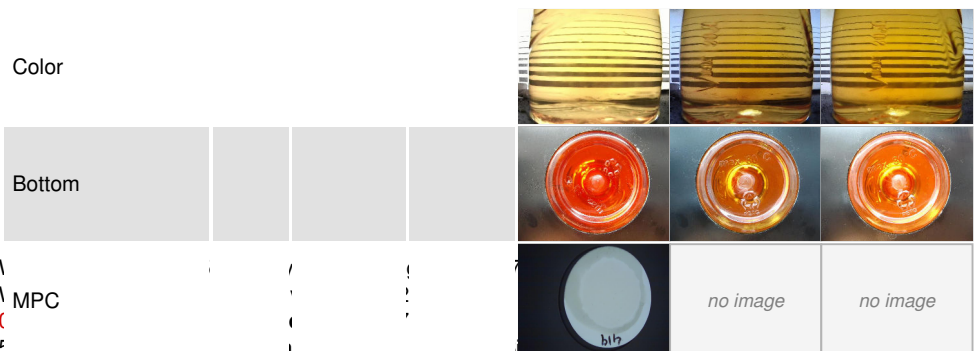




Laboratory : \ Laboratory  
 Sample No. : \ MPC  
 Lab Number : ( )  
 Unique Number : ( )  
 Test Package : AOM 3 ( Additional Tests: Tollnsol )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

Contact: Pierre Adouki  
 pierre.adouki@brucepower.com  
 T: (519)361-2673  
 F:

# FERROGRAPHY REPORT

Area  
**Bruce B/0B/54300**  
Machine Id  
**0B-54300-EPG3-VH902-1**  
Component  
**Turbine**  
Fluid  
**SHELL AEROSHELL 500 (1800 LTR)**

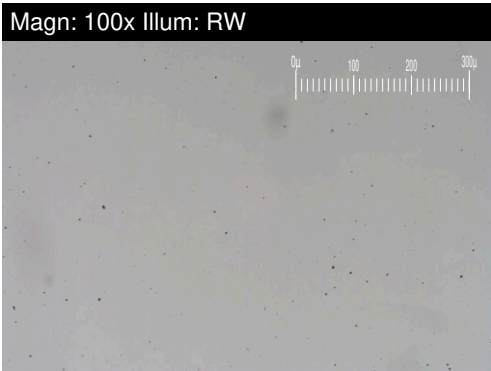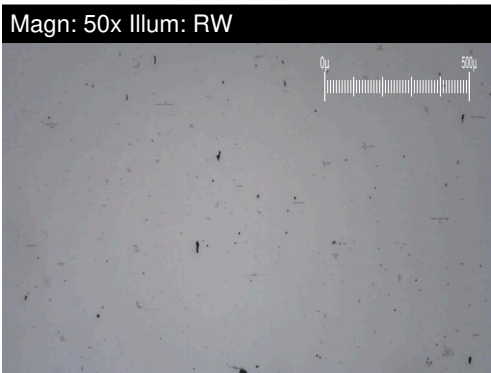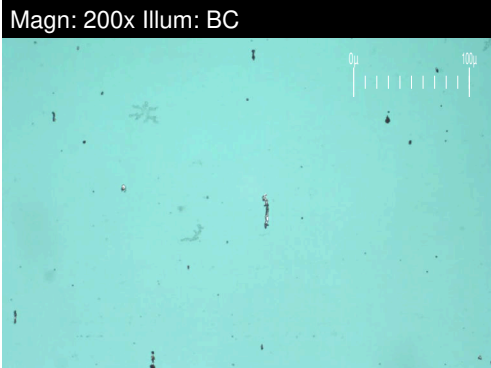


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		<b>2.3</b>	---	---
Small Particles		DR-Ferr*		<b>1.0</b>	---	---
Total Particles		DR-Ferr*	>---	<b>3.3</b>	---	---
Large Particles Percentage	%	DR-Ferr*		<b>39.4</b>	---	---
Severity Index		DR-Ferr*		<b>3</b>	---	---


FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		<b>2</b>		
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		<b>1</b>		
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*				
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		<b>1</b>		
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		<b>1</b>		

### WEAR


All component wear rates are normal.  
 The ferrography results are normal indicating no abnormal wear in the system.

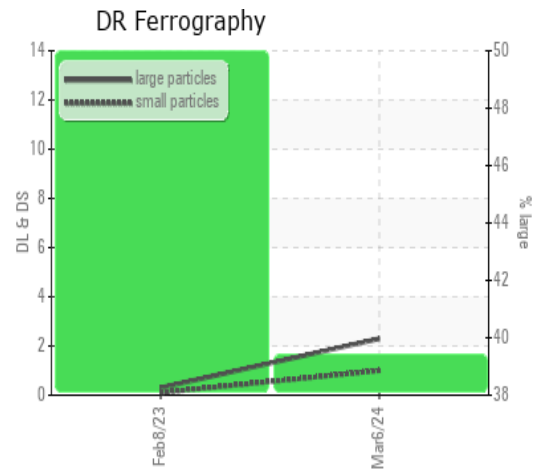


### Rotating Pressure Vessel Oxidation Test

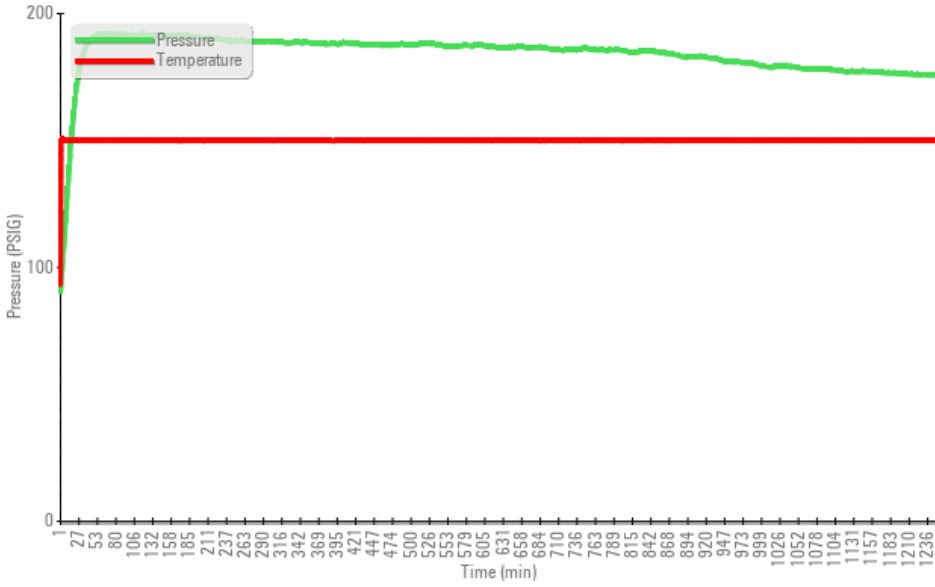

### Foaming SEQ I/II/III

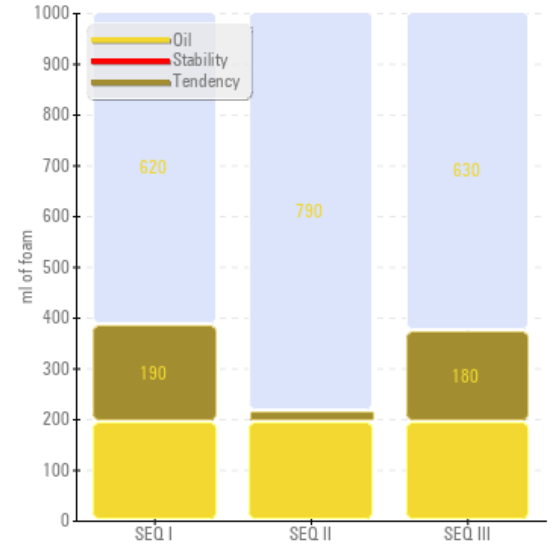

### Water Separability

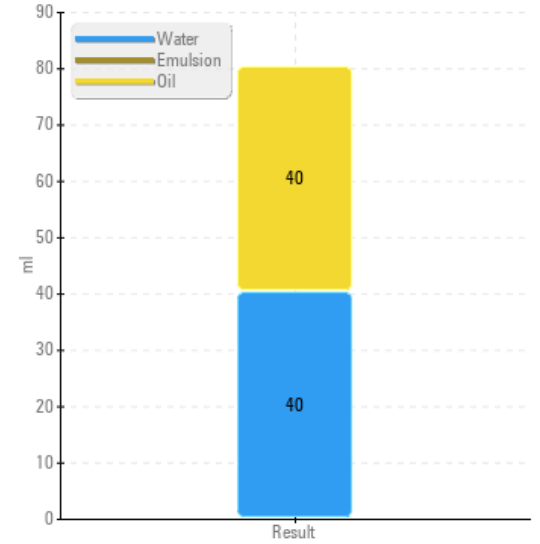

MPC (Varnish Test)



Sample Color & Clarity

