



# FUEL REPORT

Sample Rating Trend

**NORMAL**



Area  
**CBRE PRATT & WHITNEY [134153]**  
 Machine Id  
**RG6081A100622**  
 Component  
**Diesel Fuel**  
 Fluid  
**No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)**



## DIAGNOSIS

### Recommendation

Laboratory test indicate that this fuel is suitable for use and meets all test requirements. Resample at the next service interval to monitor.

### Contaminants

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. There is no indication of any contamination in the diesel fuel.

### Fuel Condition

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B).

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>CU0022639</b>	---	---
Sample Date	Client Info			<b>07 Mar 2024</b>	---	---
Machine Age	hrs	Client Info		<b>1297</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		ASTM D1298*	0.839	<b>0.837</b>	---	---
Fuel Color	text	Visual Screen*	Yllow	<b>Yllow</b>	---	---
Visc @ 40°C	cSt	ASTM D7279(m)	3.0	<b>2.4</b>	---	---
Pensky-Martens Flash Point	°C	ASTM D7215*	52	<b>66</b>	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185(m)	10	<b>11</b>	---	---

DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D2887*	165	<b>175</b>	---	---
5% Distillation Point	°C	ASTM D2887*		<b>194</b>	---	---
10% Distill Point	°C	ASTM D2887*	201	<b>203</b>	---	---
15% Distillation Point	°C	ASTM D2887*		<b>211</b>	---	---
20% Distill Point	°C	ASTM D2887*	216	<b>218</b>	---	---
30% Distill Point	°C	ASTM D2887*	230	<b>231</b>	---	---
40% Distill Point	°C	ASTM D2887*	243	<b>243</b>	---	---
50% Distill Point	°C	ASTM D2887*	255	<b>255</b>	---	---
60% Distill Point	°C	ASTM D2887*	267	<b>268</b>	---	---
70% Distill Point	°C	ASTM D2887*	280	<b>281</b>	---	---
80% Distill Point	°C	ASTM D2887*	295	<b>297</b>	---	---
85% Distillation Point	°C	ASTM D2887*		<b>309</b>	---	---
90% Distill Point	°C	ASTM D2887*	310	<b>321</b>	---	---
95% Distillation Point	°C	ASTM D2887*		<b>342</b>	---	---
Final Boiling Point	°C	ASTM D2887*	341	<b>370</b>	---	---






IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D1298*	37.7	<b>37</b>	---	---
Cetane Index		ASTM D4737*	<40.0	<b>48</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	<1.0	<b>0</b>	---	---
Sodium	ppm	ASTM D5185(m)	<0.1	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185(m)	<0.1	<b>0</b>	---	---
Water	%	ASTM D6304*	<0.05	<b>0.003</b>	---	---
ppm Water	ppm	ASTM D6304*	<500	<b>31</b>	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	<b>934</b>	---	---
Particles >6µm		ASTM D7647	>640	<b>299</b>	---	---
Particles >14µm		ASTM D7647	>80	<b>30</b>	---	---
Particles >21µm		ASTM D7647	>20	<b>5</b>	---	---
Particles >38µm		ASTM D7647	>4	<b>0</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	<b>17/15/12</b>	---	---






# FUEL REPORT

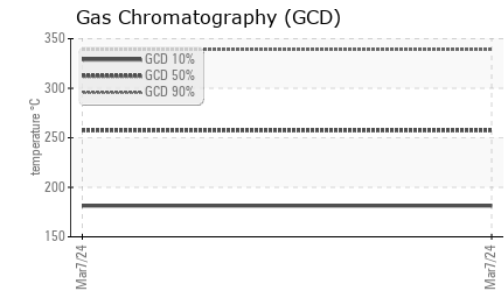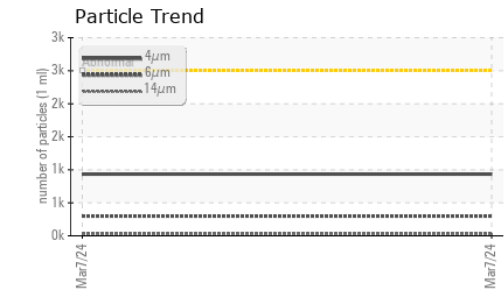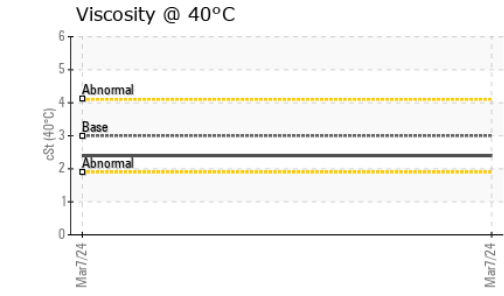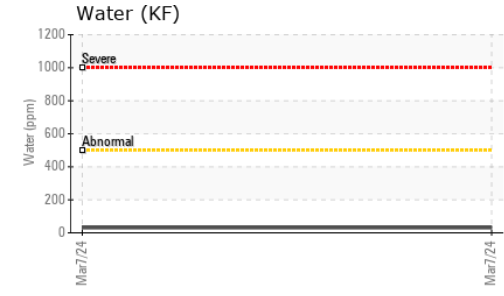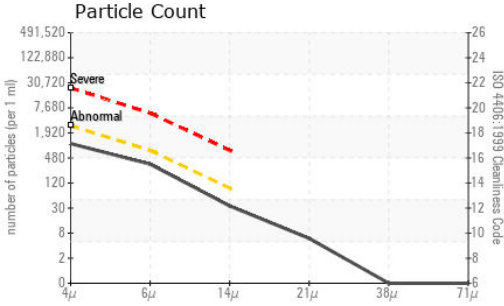

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	0	---
Nickel	ppm	ASTM D5185(m)	<0.1	0	---
Lead	ppm	ASTM D5185(m)	<0.1	0	---
Vanadium	ppm	ASTM D5185(m)	<0.1	0	---
Iron	ppm	ASTM D5185(m)	<0.1	0	---
Calcium	ppm	ASTM D5185(m)	<0.1	0	---
Magnesium	ppm	ASTM D5185(m)	<0.1	0	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	<1	---
Zinc	ppm	ASTM D5185(m)	<0.1	0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

## GRAPHS

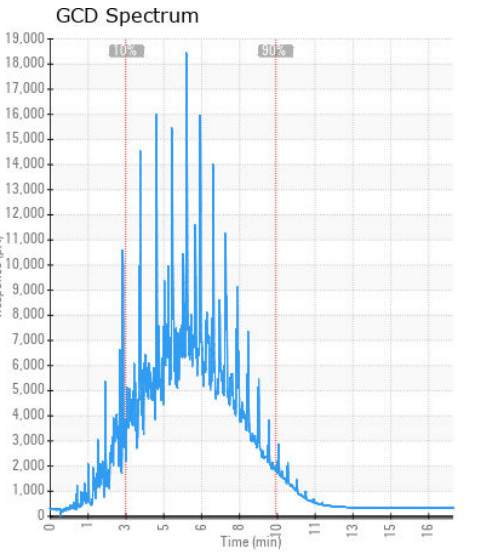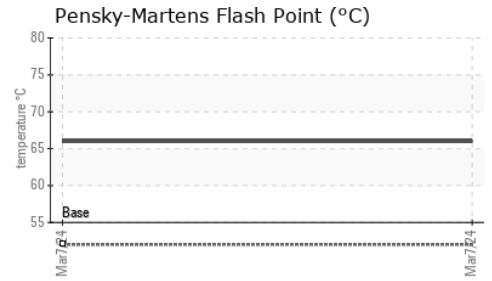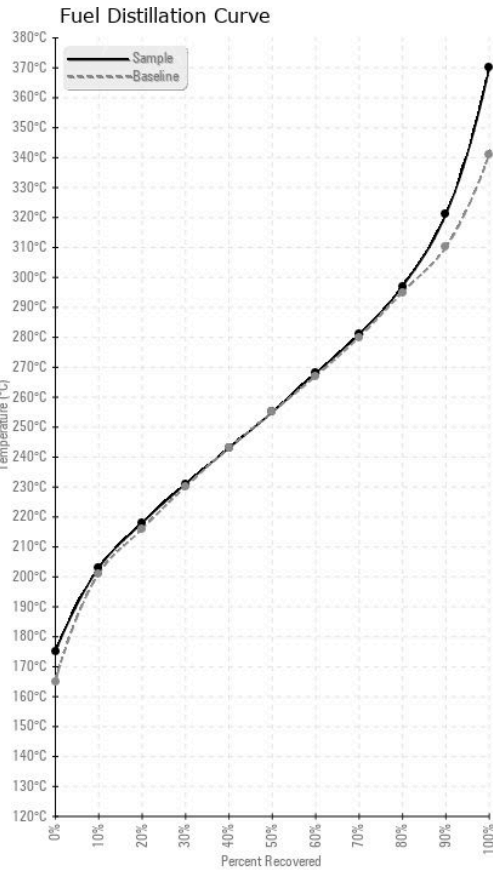

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : CU0022639 **Received** : 12 Mar 2024  
**Lab Number** : 02621623 **Tested** : 18 Mar 2024  
**Unique Number** : 5746742 **Diagnosed** : 18 Mar 2024 - Kevin Marson  
**Test Package** : FUEL ( Additional Tests: CC Flash, GC-PercFuel, PrtCount )

**CUMMINS DIESEL**  
 50 SIMMONDS DRIVE  
 DARTMOUTH, NS  
 CA B3B 1R3  
 Contact: Stephen Hulse  
 stephen.hulse@cummins.com  
 T: (782)409-4641  
 F: (902)468-5177

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.