




OIL ANALYSIS REPORT

Sample Rating Trend

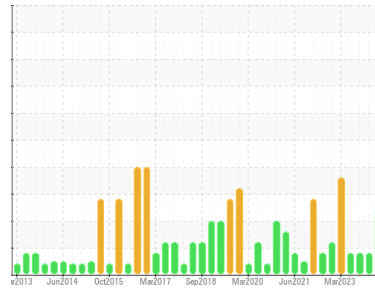

WATER



Area
2 Phoenix/020 ISO Dewax/P Pump/101 Injection Pump
 Machine Id
N/A 20P101 (East) - CRANK CASE

Component
Pump
 Fluid
PETRO CANADA COMPRO COMPRESSOR FLUID 100 (5 LTR)

DIAGNOSIS

Recommendation

We advise that you check for the source of water entry. Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you follow the water drain-off procedure for this component. We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. Free water present. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0912449	WC	WC0883395
Sample Date	Client Info		12 Mar 2024	16 Jan 2024	15 Dec 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ATTENTION	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>90	3	<1	<1
Chromium	ppm	ASTM D5185(m)	>5	0	0	0
Nickel	ppm	ASTM D5185(m)	>5	0	<1	0
Titanium	ppm	ASTM D5185(m)	>3	0	0	0
Silver	ppm	ASTM D5185(m)	>3	0	0	<1
Aluminum	ppm	ASTM D5185(m)	>7	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>12	<1	0	0
Copper	ppm	ASTM D5185(m)	>30	2	<1	<1
Tin	ppm	ASTM D5185(m)	>9	0	0	0
Antimony	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	0	<1	0	<1
Barium	ppm	ASTM D5185(m)	0	0	0	<1
Molybdenum	ppm	ASTM D5185(m)	0	0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)	0	<1	<1	0
Calcium	ppm	ASTM D5185(m)	0	<1	<1	<1
Phosphorus	ppm	ASTM D5185(m)	50	5	7	7
Zinc	ppm	ASTM D5185(m)	0	1	<1	<1
Sulfur	ppm	ASTM D5185(m)	1500	3351	3321	3073
Lithium	ppm	ASTM D5185(m)		<1	<1	<1





CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>60	0	0	0
Sodium	ppm	ASTM D5185(m)		0	0	<1
Potassium	ppm	ASTM D5185(m)	>20	<1	1	0

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		27925	11240	21707
Particles >6µm	ASTM D7647	>1300	5616	2360	4903
Particles >14µm	ASTM D7647	>160	96	134	88
Particles >21µm	ASTM D7647	>40	14	29	12
Particles >38µm	ASTM D7647	>10	3	2	1
Particles >71µm	ASTM D7647	>3	3	1	0
Oil Cleanliness	ISO 4406 (c)	>--/17/14	22/20/14	21/18/14	22/19/14

OIL ANALYSIS REPORT

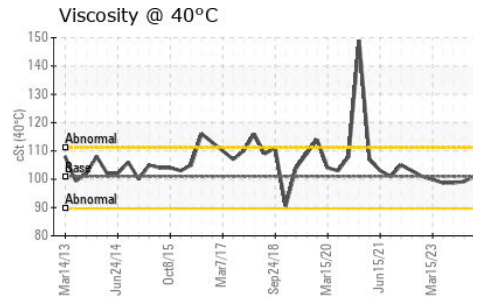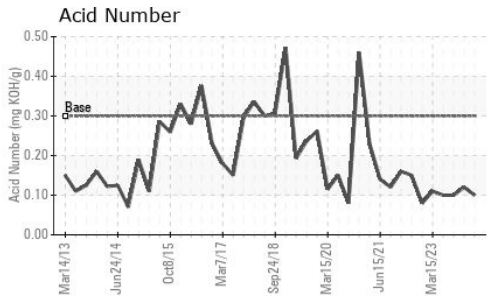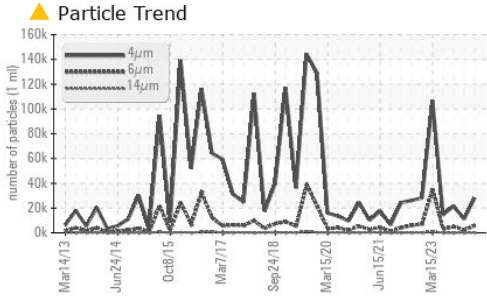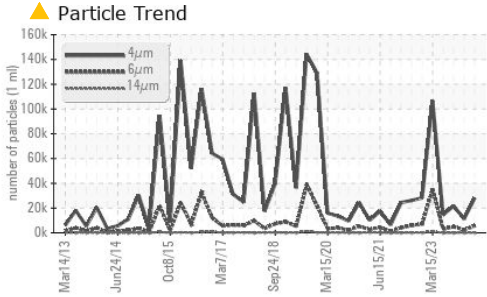


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.3	0.10	0.12	0.10






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>.1	.2%	NEG	NEG
Free Water	scalar	Visual*		▲ 1%	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	101.0	101	99.2	98.7

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

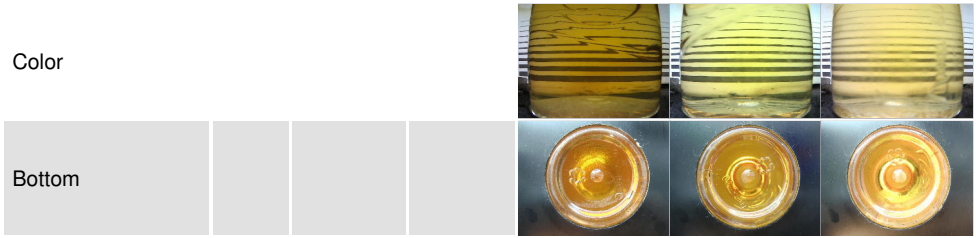

GRAPHS

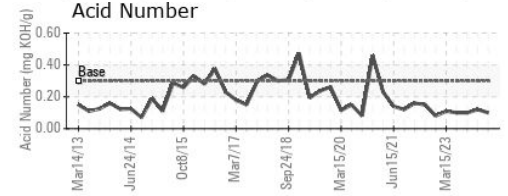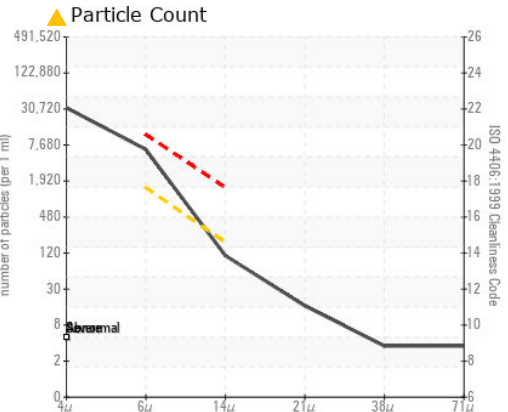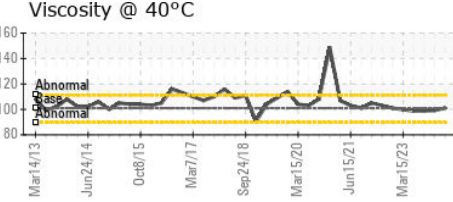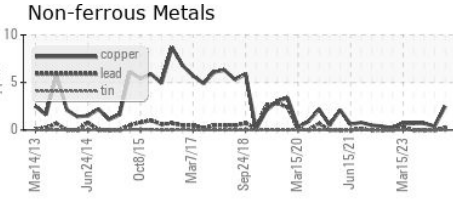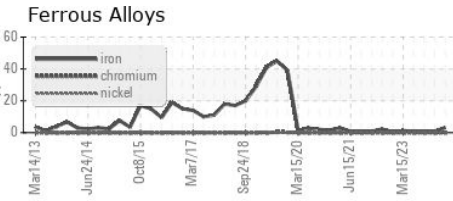

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0912449 **Received** : 13 Mar 2024
Lab Number : **02621844** **Tested** : 14 Mar 2024
Unique Number : 5746963 **Diagnosed** : 14 Mar 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: TAN Man)

Petro Canada Lubricants Inc.
 385 Southdown Road
 Mississauga, ON
 CA L5J 2Y3
 Contact: Martin Wagenaar
 martin.wagenaar@HFSinclair.com
 T: (905)403-5682
 F: (905)822-6025

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.