

# **COOLANT REPORT**

## DT

# Sample Rating Trend WEAR

KOHLER Franklin Gardebs

Component

**Bottom Coolant** 

**CONVENTIONAL COOLANT (--- GAL)** 

# DIAGNOSIS

### Recommendation

We recommend drain system, and refill with 50/50 antifreeze water mixture. We advise that you replenish the supplemental coolant additives (SCAs) and add per manufacturer's specifications. We recommend an early resample to monitor this condition.

### Corrosion

Lead ppm levels are abnormal. The high metal levels indicate corrosion in the system.

### Contaminants

There is no indication of any contamination in the coolant.


### **Coolant Condition**


The nitrite level is acceptable. The pH level of this fluid is within the acceptable limits.

				Mar2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0870001		
Sample Date		Client Info		12 Mar 2024		
Machine Age	hrs	Client Info		880		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
PHYSICAL TEST F	RESULTS	method	limit/base	current	history1	history2
Glycol Type		FT-IR		UNK		
Specific Gravity		ASTM D1298*		1.071		
pH	Scale 0-14	ASTM D1287*	9.5	8.81		
Nitrites	ppm	Alcan Test Kit*	1500	1400		
Reserve Alkalinity	Scale 0-20	ASTM D1121*	8.5	2.8		
Percentage Glycol	%	ASTM D3321*	50	53.2		
Freezing Point	°C	ASTM D3321*	-40	-42		
Carboxylate						
CORROSION INH	IBITORS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)		32		
Phosphorus	ppm	ASTM D5185(m)		87		
Boron	ppm	ASTM D5185(m)		194		
Molybdenum	ppm	ASTM D5185(m)		0		
CORROSION		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>15	0		
Aluminum	ppm	ASTM D5185(m)	>10	<1		
Copper	ppm	ASTM D5185(m)	>10	<1		
Lead	ppm	ASTM D5185(m)	>10	<u> </u>		
Tin	ppm	ASTM D5185(m)	>10	0		
Silver	ppm	ASTM D5185(m)	>10	1		
Zinc	ppm	ASTM D5185(m)		<1		
CARRIER SALTS		method	limit/base	current	history1	history2
Sodium	ppm	ASTM D5185(m)		1917		
Potassium	ppm	ASTM D5185(m)		1199		
SCALE POTENTI	AL	method	limit/base	current	history1	history2
Calcium	ppm	ASTM D5185(m)	>100	<1		
Magnesium	ppm	ASTM D5185(m)	>40	<1		



# **COOLANT REPORT**

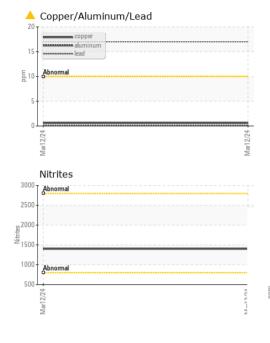

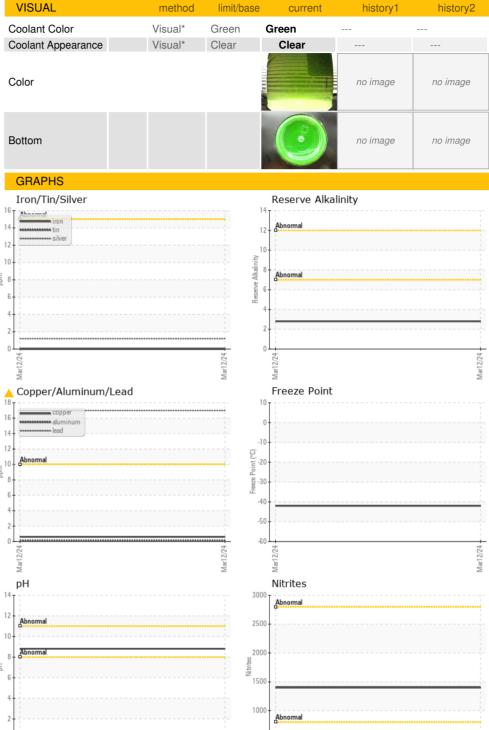



CALA ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Sample No.

: WC0870001 Lab Number : 02622150

Unique Number : 5747269

Received : 14 Mar 2024 **Tested** Diagnosed

: 14 Mar 2024

: 15 Mar 2024 - Kevin Marson

500

**Test Package**: COOL (Additional Tests: GlycolType)

To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

**CF Industrial Products Inc.** 

1928 Road 3 East Kingsville, ON CA N9Y 2E5

Contact: Dan Hammond danh@cfgroups.com T: (519)564-2241

F: (519)322-2916