




# OIL ANALYSIS REPORT

Sample Rating Trend

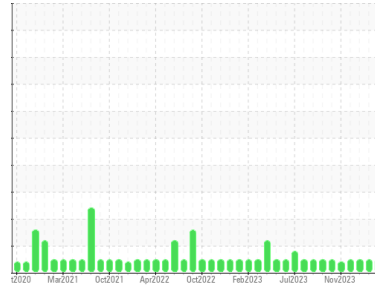

**NORMAL**



Area  
**centre énergétique**  
 Machine Id  
**14-1801-01**  
 Component  
**1 Screw Compressor**  
 Fluid  
**SULLAIR SULLUBE (500 LTR)**

## DIAGNOSIS

### Recommendation

Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition.

### Wear

Les taux d'usure de tous les composants sont normaux.

### Contamination

La propreté du système est acceptable pour votre objectif de propreté ISO 4406. La teneur en eau est négligeable. La propreté du système et du fluide est acceptable.

### Fluid Condition

Le AN est acceptable pour ce fluide. L'état de l'huile permet d'en prolonger l'utilisation.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0912870</b>	WC0892378	WC0827940
Sample Date	Client Info		<b>11 Mar 2024</b>	13 Feb 2024	16 Jan 2024
Machine Age	hrs	Client Info	<b>0</b>	19077	0
Oil Age	hrs	Client Info	<b>0</b>	4158	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >60	<b>7</b>	6	6
Chromium	ppm	ASTM D5185(m) >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m) >5	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185(m) >10	<b>&lt;1</b>	<1	<1
Copper	ppm	ASTM D5185(m) >30	<b>&lt;1</b>	<1	2
Tin	ppm	ASTM D5185(m) >15	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 12	<b>&lt;1</b>	0	<1
Barium	ppm	ASTM D5185(m) 500	<b>694</b>	700	689
Molybdenum	ppm	ASTM D5185(m) 0.0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m) 0.0	<b>&lt;1</b>	<1	<1
Calcium	ppm	ASTM D5185(m) 8.2	<b>4</b>	4	3
Phosphorus	ppm	ASTM D5185(m) 4.0	<b>0</b>	0	0
Zinc	ppm	ASTM D5185(m) 0.1	<b>5</b>	5	4
Sulfur	ppm	ASTM D5185(m) 240	<b>439</b>	430	402
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

## CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >50	<b>&lt;1</b>	1	2
Sodium	ppm	ASTM D5185(m)	<b>67</b>	66	65
Potassium	ppm	ASTM D5185(m) >20	<b>9</b>	9	7
Water	%	ASTM D6304* >0.5	<b>0.133</b>	0.058	0.055
ppm Water	ppm	ASTM D6304* >5000	<b>1330</b>	586	558

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>2859</b>	1113	759
Particles >6µm	ASTM D7647	>2500	<b>908</b>	381	175
Particles >14µm	ASTM D7647	>320	<b>82</b>	44	15
Particles >21µm	ASTM D7647	>80	<b>22</b>	13	4
Particles >38µm	ASTM D7647	>20	<b>1</b>	1	1
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	1
Oil Cleanliness	ISO 4406 (c)	>18/15	<b>17/14</b>	16/13	15/11



# OIL ANALYSIS REPORT

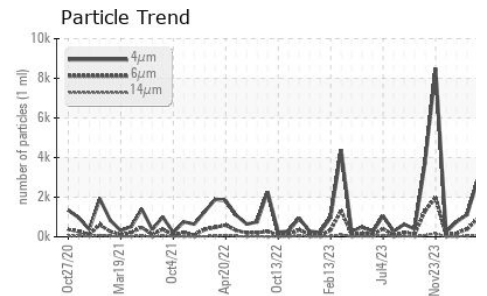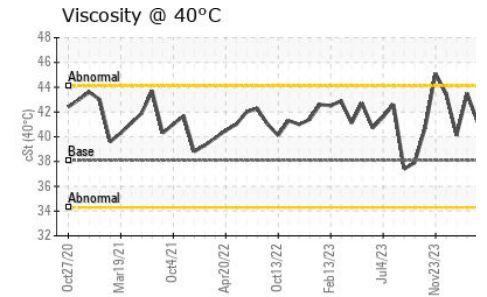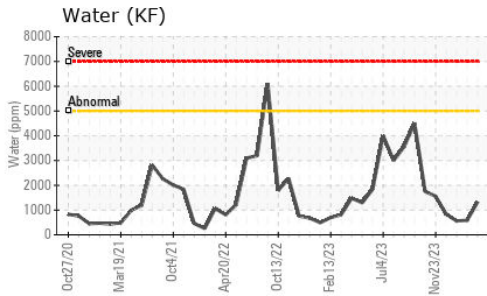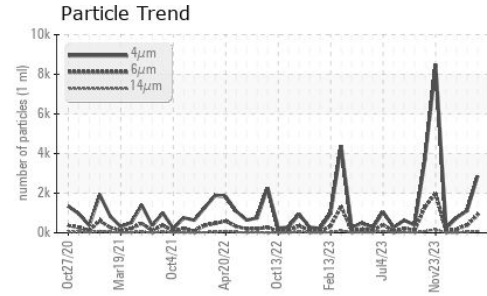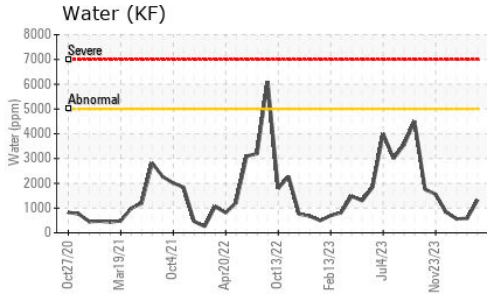


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.06	<b>0.87</b>	0.56	0.41






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.5	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	38.1	<b>41.2</b>	43.5	40.1

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

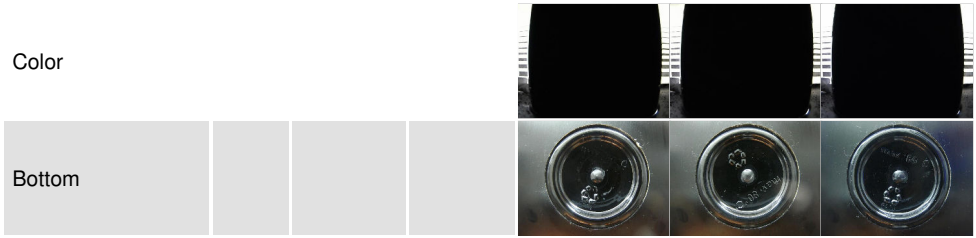

## GRAPHS

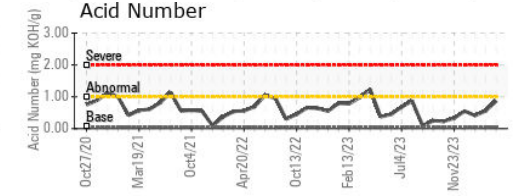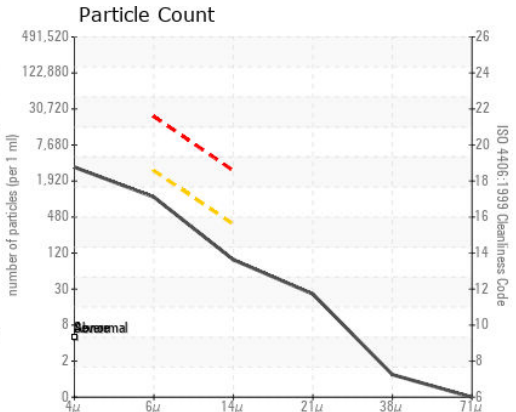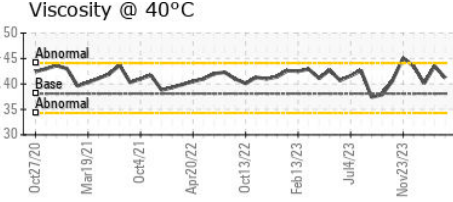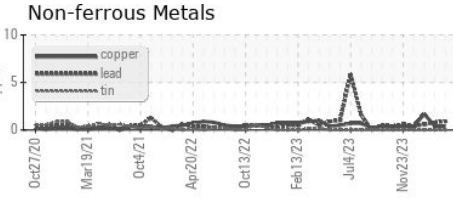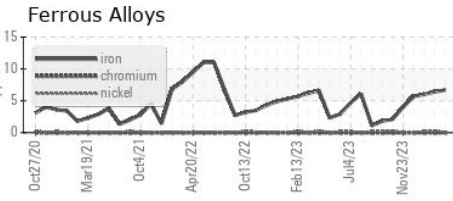

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC0912870 **Received** : 15 Mar 2024  
**Lab Number** : **02622357** **Tested** : 18 Mar 2024  
**Unique Number** : 5747476 **Diagnosed** : 18 Mar 2024 - Wes Davis  
**Test Package** : IND 2 ( Additional Tests: KF, TAN Man )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**RTA - UGB**  
 C.P. 900  
 Ville de la Baie, QC  
 CA G7B 4G9  
 Contact: Alcan Epc  
 mathieu.tremblay2@riotinto.com  
 T: (418)697-9568  
 F: (418)697-9550