

OIL ANALYSIS REPORT

COAST GUARD [134602] GELIGET

Component

Port Diesel Engine

{not provided} (--- GAL)

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.


Metal levels are typical for a new component breaking in.

Contamination

There is no indication of any contamination in the

Fluid Condition

The condition of the oil is acceptable for the time in service.







				Mar2024		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		CU0023085		
Sample Date		Client Info		17 Mar 2024		
Machine Age	hrs	Client Info		512		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATION	J	method	limit/base	current	history1	history2
Fuel		WC Method	>3.0	<1.0		
Water		WC Method	>0.2	NEG		
Glycol		WC Method		NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>90	22		
Chromium	ppm	ASTM D5185(m)	>20	<1		
Nickel	ppm	ASTM D5185(m)	>2	2		
Titanium	ppm	ASTM D5185(m)	>2	0		
Silver	ppm	ASTM D5185(m)	>2	<1		
Aluminum	ppm	ASTM D5185(m)	>20	3		
Lead	ppm	ASTM D5185(m)	>40	3		
Copper	ppm	ASTM D5185(m)	>330	31		
Tin	ppm	ASTM D5185(m)	>15	1		
Antimony	ppm	ASTM D5185(m)		0		
Vanadium	ppm	ASTM D5185(m)		0		
Beryllium	ppm	ASTM D5185(m)		0		
Cadmium	ppm	ASTM D5185(m)		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		32		
Barium	ppm	ASTM D5185(m)		0		
Molybdenum	ppm	ASTM D5185(m)		46		
Manganese	ppm	ASTM D5185(m)		<1		
Magnesium	ppm	ASTM D5185(m)		765		
Calcium	ppm	ASTM D5185(m)		1212		
Phosphorus	ppm	ASTM D5185(m)		723		
Zinc	ppm	ASTM D5185(m)		799		
Sulfur	ppm	ASTM D5185(m)		2041		
Lithium	ppm	ASTM D5185(m)		<1		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	8		
Sodium	ppm	ASTM D5185(m)		5		
Potassium	ppm	ASTM D5185(m)	>20	1		
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	>6	0.8		
Nitration	Abs/cm	ASTM D7624*	>20	9.6		
Sulfation	Abs/.1mm	ASTM D7415*	>30	21.8		



OIL ANALYSIS REPORT



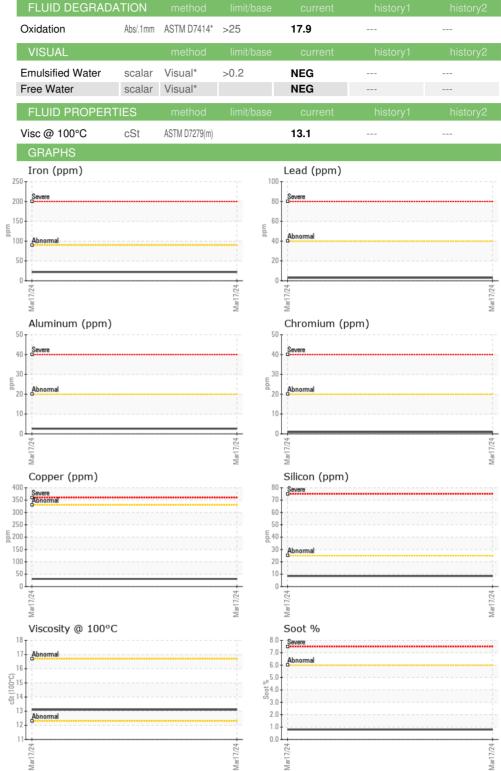



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No.

Lab Number : 02622612 Unique Number : 5747731 Test Package : MOB 1

To discuss this sample report, contact Customer Service at 1-800-268-2131.

: CU0023085 Received **Tested**

Diagnosed

: 18 Mar 2024 : 18 Mar 2024

: 18 Mar 2024 - Kevin Marson

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 CUMMINS CANADA ULC - GENERATOR DIVISION 7175 PACIFIC CIRCLE MISSISSAUGA, ON

CA L5T 2A5 Contact: Elisia Johnson

elisia.johnson@cummins.com T: (905)795-0050

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied. F: (905)795-9252

Contact/Location: Elisia Johnson - CUMMISGEN