




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

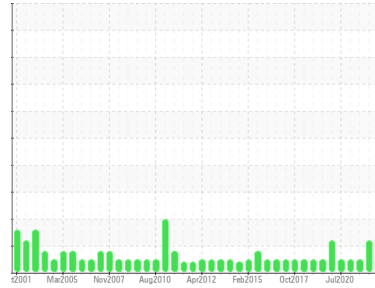

Area
EQR [152301]
 Machine Id
LOUPGEN1BRGTHR (S/N 456246)
 Component
Thrust Bearing
 Fluid
SHELL TURBO T ISO 68 (70 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system.

Contaminants

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Oil Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0548058	WC0659853	WC0429591
Sample Date	Client Info		14 Mar 2024	13 Sep 2023	31 Mar 2022
Machine Age	mths	Client Info	140	332	116
Oil Age	mths	Client Info	64	58	40
Oil Changed	Client Info		Not Changed	Not Changed	Not Changed
Sample Status			NORMAL	MARGINAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>2	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		0	---	---
Iron	ppm	ASTM D5185(m) >85	<1	<1	<1
Chromium	ppm	ASTM D5185(m) >20	0	0	0
Nickel	ppm	ASTM D5185(m) >20	0	<1	<1
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	0	0
Aluminum	ppm	ASTM D5185(m) >40	<1	0	<1
Lead	ppm	ASTM D5185(m) >60	<1	1	1
Copper	ppm	ASTM D5185(m) >7	<1	<1	<1
Tin	ppm	ASTM D5185(m) >40	0	0	<1
Antimony	ppm	ASTM D5185(m)	0	0	<1
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	0	<1
Barium	ppm	ASTM D5185(m)	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0
Magnesium	ppm	ASTM D5185(m)	0	0	0
Calcium	ppm	ASTM D5185(m)	<1	<1	<1
Phosphorus	ppm	ASTM D5185(m)	0	<1	1
Zinc	ppm	ASTM D5185(m)	3	4	3
Sulfur	ppm	ASTM D5185(m)	33	46	49
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >20	<1	<1	<1
Sodium	ppm	ASTM D5185(m)	0	<1	<1
Potassium	ppm	ASTM D5185(m) >20	<1	<1	<1

Particle Filter (Magn: 200 x)





OIL ANALYSIS REPORT

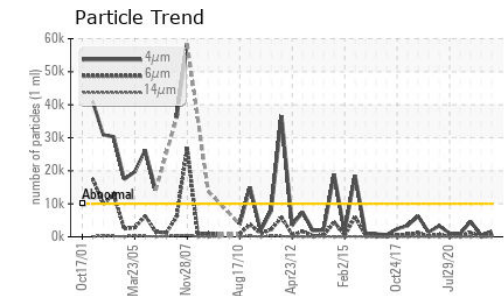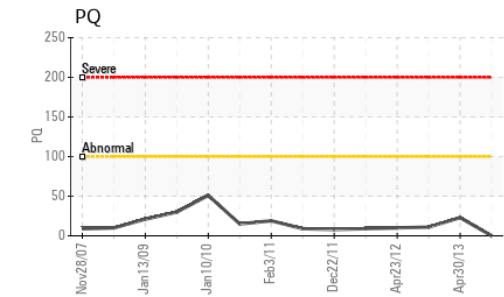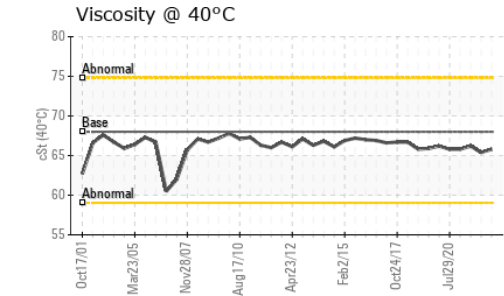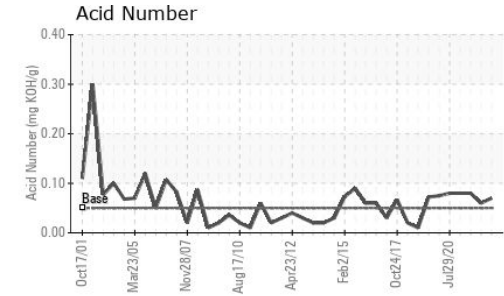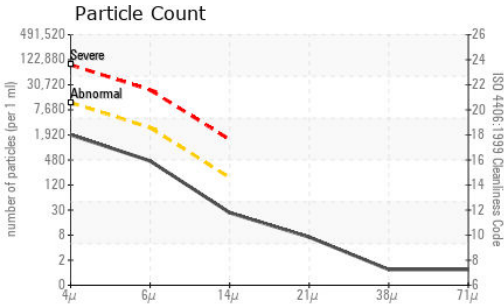

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **ALGONQUIN POWER SYSTEMS INC.**
Sample No. : WC0548058 **Received** : 18 Mar 2024 354 DAVIS ROAD
Lab Number : 02622724 **Tested** : 21 Mar 2024 OAKVILLE, ON
Unique Number : 5747843 **Diagnosed** : 21 Mar 2024 - Kevin Marson CA L6J 2X1
Test Package : IND 3 (Additional Tests: BottomAnalysis, FilterPatch, PrtCount, PrtFilter, AutoMain) **Antonino Champ Fernando**
 antoninoChamp.fernando@algonquinpower.com
 T: (905)465-7065
 F: x:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	1690	533	4695
Particles >6µm	ASTM D7647	>2500	400	129	1257
Particles >14µm	ASTM D7647	>160	23	7	51
Particles >21µm	ASTM D7647	>40	6	2	8
Particles >38µm	ASTM D7647	>10	1	1	1
Particles >71µm	ASTM D7647	>3	1	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	18/16/12	16/14/10	19/17/13

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974*	.05	0.07	0.06	0.08

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	NONE	▲ VLITE	VLITE
Yellow Metal	scalar Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar Visual*	NONE	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	NONE	NONE
Debris	scalar Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar Visual*	NONE	NONE	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar Visual*	>2	NEG	NEG	NEG
Free Water	scalar Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	68	65.8	65.4	66.2



SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

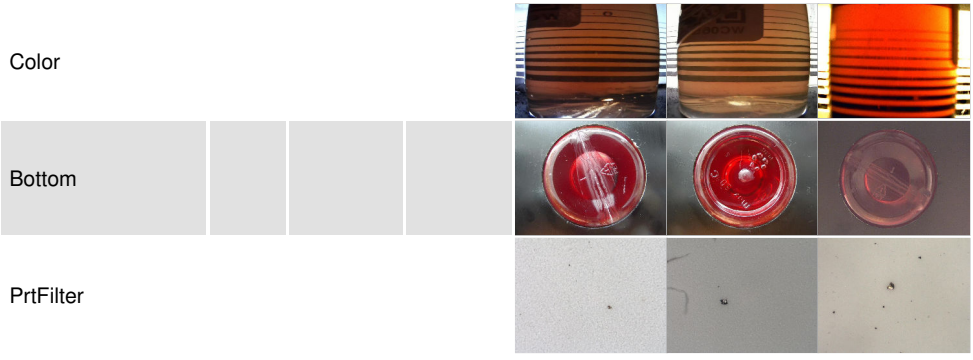



FERROGRAPHY REPORT

Area
EQR [152301]
 Machine Id
LOUPGEN1BRGTHR (S/N 456246)
 Component
Thrust Bearing
 Fluid
SHELL TURBO T ISO 68 (70 LTR)

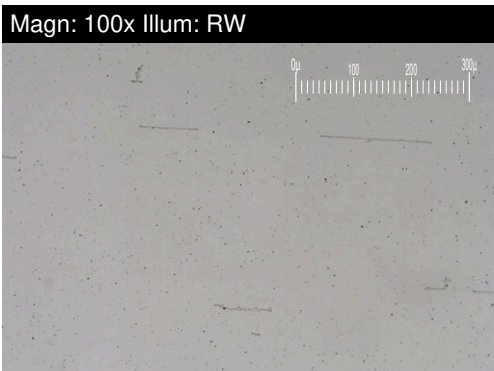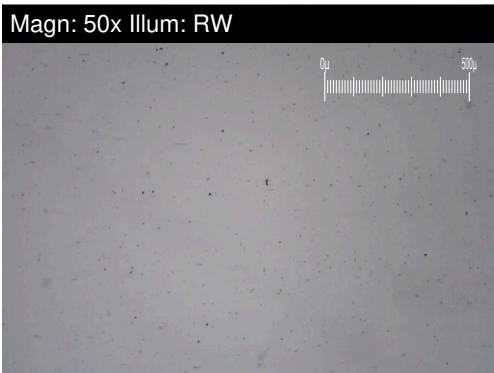


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		1.8	---	---
Small Particles		DR-Ferr*		0.5	---	---
Total Particles		DR-Ferr*	>---	2.3	---	---
Large Particles Percentage	%	DR-Ferr*		56.5	---	---
Severity Index		DR-Ferr*		2	---	---

FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		1		
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		1		
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*				
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*				
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		1		

WEAR

All component wear rates are normal.
 The ferrography results are normal indicating no abnormal wear in the system.

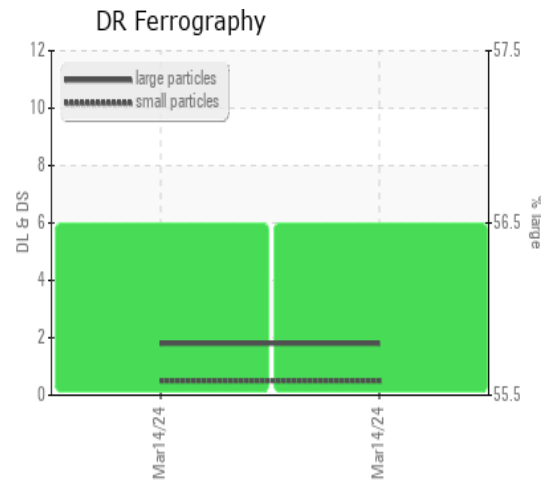

This page left intentionally blank