




PROBLEM SUMMARY

Sample Rating Trend





WEAR



Area
[9302476288]
 Machine Id
007-10011-1 WEST AERATION BLOWER NON DRIVE END
 Component
Non-Drive End Blower
 Fluid
PETRO CANADA SYNDURO SHB ISO150 (--- GAL)

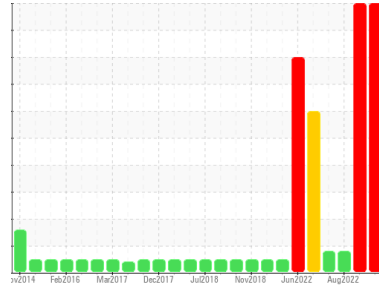

COMPONENT CONDITION SUMMARY

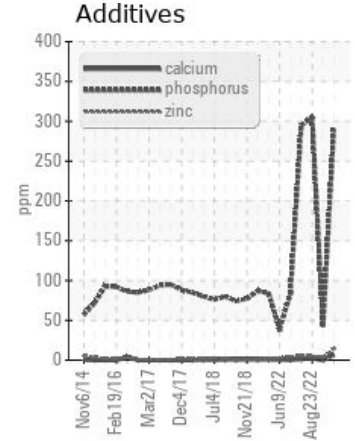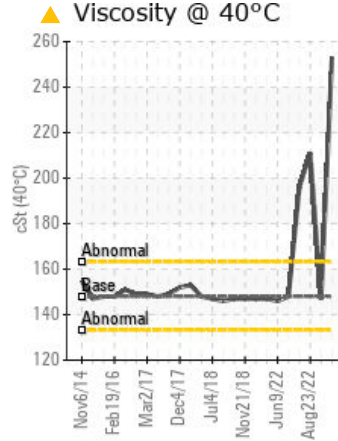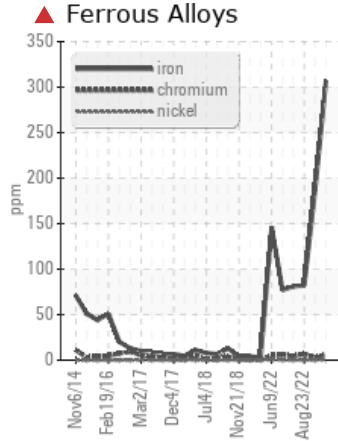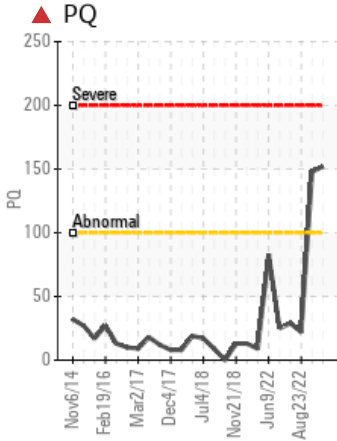

RECOMMENDATION

We recommend that you drain the oil from the component if this has not already been done. Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

PROBLEMATIC TEST RESULTS

Sample Status			SEVERE	SEVERE	ABNORMAL
PQ		ASTM D8184*	▲ 152	▲ 148	22
Iron	ppm	ASTM D5185(m) >20	▲ 307	▲ 187	▲ 82
Visc @ 40°C	cSt	ASTM D7279(m) 148	▲ 253	147	211

Customer Id: GEPCOB
 Sample No.: WC0839729
 Lab Number: 02622847
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	We recommend that you drain the oil from the component if this has not already been done.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.
Check Fluid Source	---	---	?	Confirm the source of the lubricant being utilized for top-up/fill.

HISTORICAL DIAGNOSIS

25 May 2023 Diag: Bill Quesnel

WEAR



We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Iron ppm levels are severe. PQ levels are severe. The very high ferrous density (PQ) index indicates that severe wear is occurring. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

view report



23 Aug 2022 Diag: Kevin Marson

WEAR



We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Iron ppm levels are abnormal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

view report



04 Jul 2022 Diag: Kevin Marson

WEAR



Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample. Iron ppm levels are abnormal. The diagnosis reflects updated information on this component. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

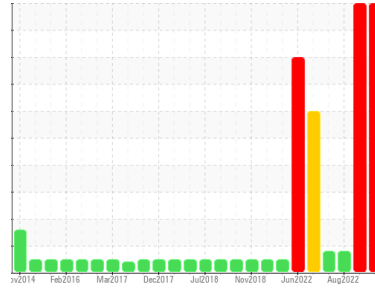

Area
[9302476288]
 Machine Id
007-10011-1 WEST AERATION BLOWER NON DRIVE END
 Component
Non-Drive End Blower
 Fluid
PETRO CANADA SYNDURO SHB ISO150 (--- GAL)

DIAGNOSIS

▲ Recommendation
 We recommend that you drain the oil from the component if this has not already been done. Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

▲ Wear
 Iron ppm levels are severe. PQ levels are severe. The very high ferrous density (PQ) index indicates that severe wear is occurring.

Contamination
 There is no indication of any contamination in the oil.

▲ Fluid Condition
 Viscosity of sample indicates oil is within ISO 220 range, advise investigate. This plus the additive levels indicates that this is not the same brand, or type of oil as reported. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0839729	WC0818459	WC0704925
Sample Date	Client Info		13 Mar 2024	25 May 2023	23 Aug 2022
Machine Age	days	Client Info	0	0	0
Oil Age	days	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	SEVERE	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		▲ 152	▲ 148	22
Iron	ppm	ASTM D5185(m) >20	▲ 307	▲ 187	▲ 82
Chromium	ppm	ASTM D5185(m) >20	6	3	7
Nickel	ppm	ASTM D5185(m) >20	<1	<1	<1
Titanium	ppm	ASTM D5185(m)	0	<1	0
Silver	ppm	ASTM D5185(m)	0	0	0
Aluminum	ppm	ASTM D5185(m) >20	4	2	1
Lead	ppm	ASTM D5185(m) >20	0	0	0
Copper	ppm	ASTM D5185(m) >20	<1	<1	0
Tin	ppm	ASTM D5185(m) >20	0	0	0
Antimony	ppm	ASTM D5185(m)	0	<1	<1
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	16	3	17
Barium	ppm	ASTM D5185(m) 5.0	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	2	1	<1
Magnesium	ppm	ASTM D5185(m) 5.0	<1	0	<1
Calcium	ppm	ASTM D5185(m) 5.0	6	0	2
Phosphorus	ppm	ASTM D5185(m) 100	293	43	305
Zinc	ppm	ASTM D5185(m) 5.0	14	4	5
Sulfur	ppm	ASTM D5185(m) 1900	11730	2063	12510
Lithium	ppm	ASTM D5185(m)	3	1	2






CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >15	4	3	2
Sodium	ppm	ASTM D5185(m)	2	<1	<1
Potassium	ppm	ASTM D5185(m) >20	4	1	<1

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974* 0.3	0.59	0.16	0.69


OIL ANALYSIS REPORT

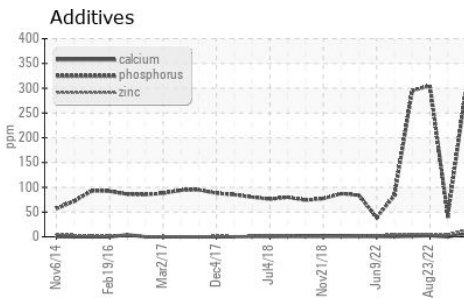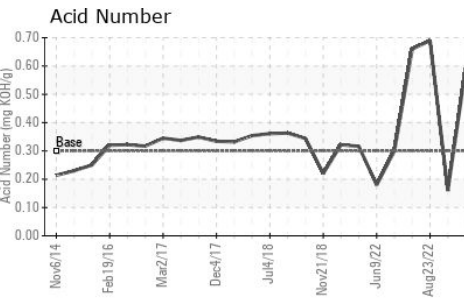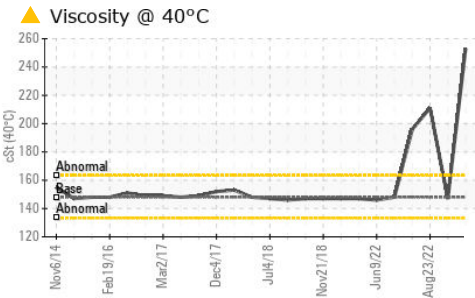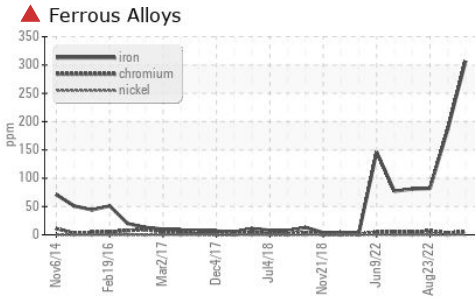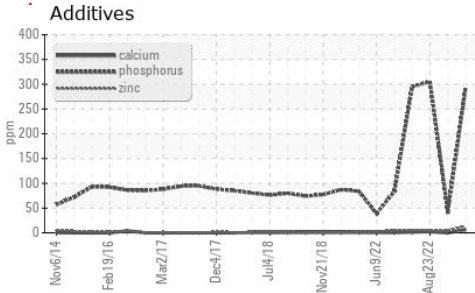






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	VLITE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	NEG	NEG	NEG
Free Water	scalar	Visual*	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	▲ 253	147	211

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

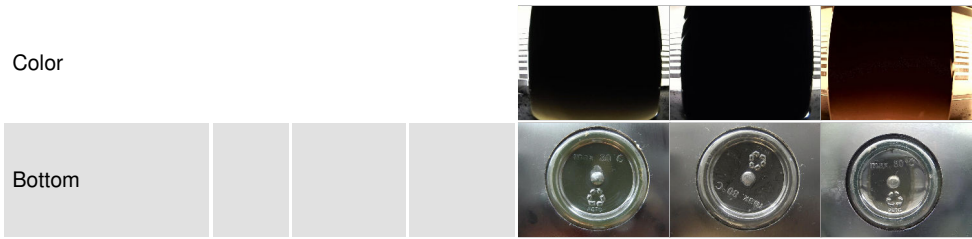

GRAPHS

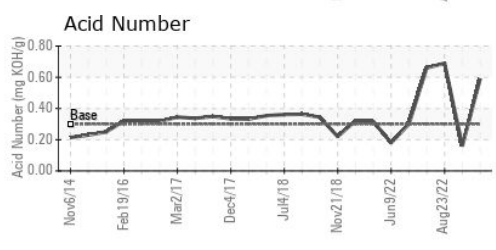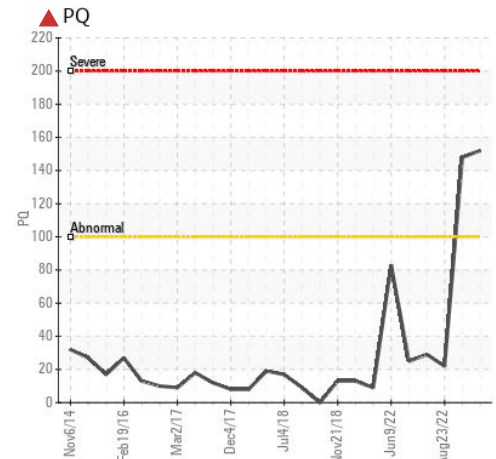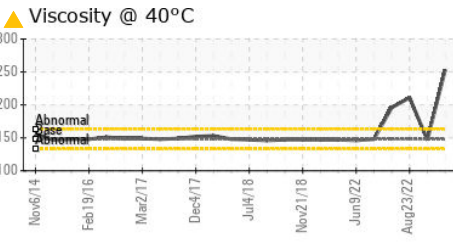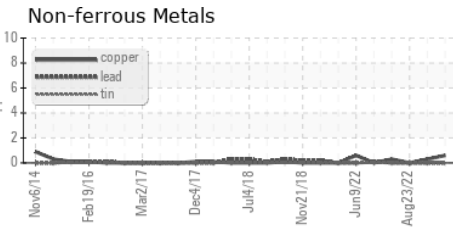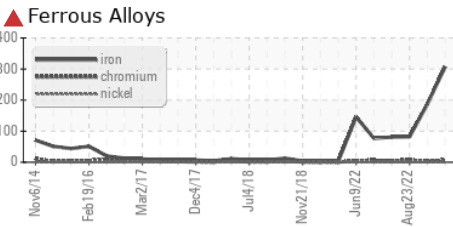

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0839729 **Received** : 18 Mar 2024
Lab Number : 02622847 **Tested** : 19 Mar 2024
Unique Number : 5747966 **Diagnosed** : 19 Mar 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: TAN Man)

DXP - SCS - Sabic IP Cobourg
 44 Normar Road
 Cobourg, ON
 CA K9A 4L7
 Contact: George DiFrancesco
 george.difrancesco@sabic.com
 T: (905)373-3988
 F: (905)373-3844

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.