FUEL REPORT

Sample Rating Trend

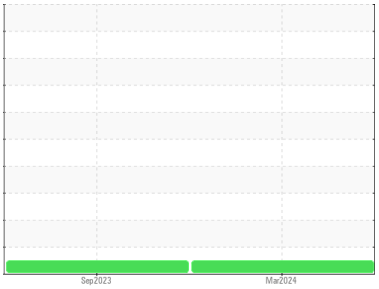

NORMAL

Area
GESTION [152826]
Machine Id
L130613700 HOMER BRIDGE - 4
Component
Diesel Fuel
Fluid
No.2 DIESEL FUEL (LOW-SULPHUR) (--- GAL)

DIAGNOSIS

Recommendation
Laboratory test indicate that this fuel is suitable for use and meets all test requirements. Resample at the next service interval to monitor.

Contaminants
The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. There is no indication of any contamination in the diesel fuel.

Fuel Condition
All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B).

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**CU0022871**	CU0021473	---
Sample Date		Client Info		**17 Mar 2024**	12 Sep 2023	---
Machine Age	hrs	Client Info		**0**	0	---
Sample Status				**NORMAL**	NORMAL	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		ASTM D1298*	0.839	**0.845**	0.845	---
Fuel Color	text	Visual Screen*	Yllow	**Pink**	Pink	---
Visc @ 40°C	cSt	ASTM D7279(m)	3.0	**2.8**	2.6	---
Pensky-Martens Flash Point	°C	ASTM D7215*	52	**62.1**	61.2	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185(m)	250	**5**	9	---

DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D2887*	165	**173**	173	---
5% Distillation Point	°C	ASTM D2887*		**200**	200	---
10% Distill Point	°C	ASTM D2887*	201	**210**	210	---
15% Distillation Point	°C	ASTM D2887*		**218**	218	---
20% Distill Point	°C	ASTM D2887*	216	**226**	226	---
30% Distill Point	°C	ASTM D2887*	230	**241**	239	---
40% Distill Point	°C	ASTM D2887*	243	**253**	251	---
50% Distill Point	°C	ASTM D2887*	255	**266**	262	---
60% Distill Point	°C	ASTM D2887*	267	**278**	274	---
70% Distill Point	°C	ASTM D2887*	280	**290**	286	---
80% Distill Point	°C	ASTM D2887*	295	**302**	298	---
85% Distillation Point	°C	ASTM D2887*		**311**	307	---
90% Distill Point	°C	ASTM D2887*	310	**320**	317	---
95% Distillation Point	°C	ASTM D2887*		**337**	334	---
Final Boiling Point	°C	ASTM D2887*	341	**356**	351	---

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D1298*	37.7	**35**	35	---
Cetane Index		ASTM D4737*	<40.0	**48**	47	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	<1.0	**0**	<1	---
Sodium	ppm	ASTM D5185(m)	<0.1	**0**	0	---
Potassium	ppm	ASTM D5185(m)	<0.1	**0**	<1	---
Water	%	ASTM D6304*	<0.05	**0.001**	0.003	---
ppm Water	ppm	ASTM D6304*	<500	**13**	28.5	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	**1062**	1039	---
Particles >6µm		ASTM D7647	>640	**288**	349	---
Particles >14µm		ASTM D7647	>80	**26**	37	---
Particles >21µm		ASTM D7647	>20	**5**	12	---
Particles >38µm		ASTM D7647	>4	**1**	1	---
Particles >71µm		ASTM D7647	>3	**0**	0	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	**17/15/12**	17/16/12	---

FUEL REPORT

Particle Count

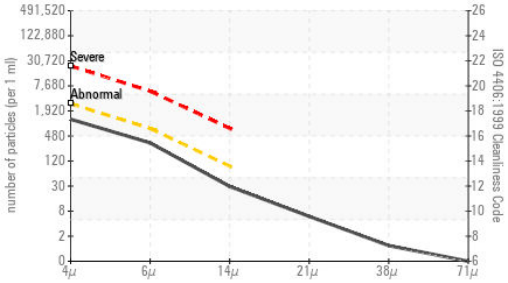

Water (KF)

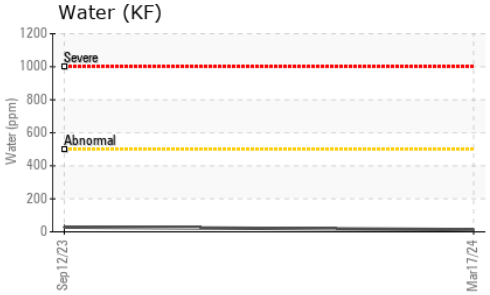

Viscosity @ 40°C

Particle Trend

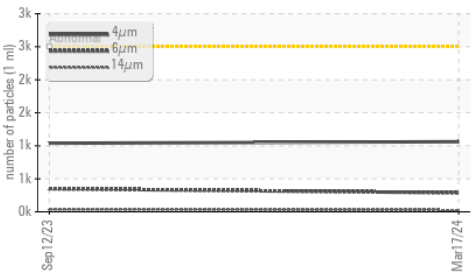

Gas Chromatography (GCD)

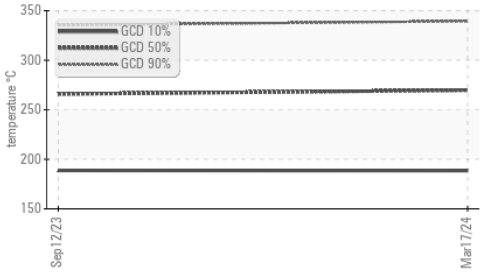

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	**0**	0	---
Nickel	ppm	ASTM D5185(m)	<0.1	**0**	0	---
Lead	ppm	ASTM D5185(m)	<0.1	**0**	<1	---
Vanadium	ppm	ASTM D5185(m)	<0.1	**0**	0	---
Iron	ppm	ASTM D5185(m)	<0.1	**0**	<1	---
Calcium	ppm	ASTM D5185(m)	<0.1	**0**	<1	---
Magnesium	ppm	ASTM D5185(m)	<0.1	**0**	0	---
Phosphorus	ppm	ASTM D5185(m)	<0.1	**<1**	<1	---
Zinc	ppm	ASTM D5185(m)	<0.1	**0**	<1	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					*no image*
Bottom					*no image*

GRAPHS

Fuel Distillation Curve

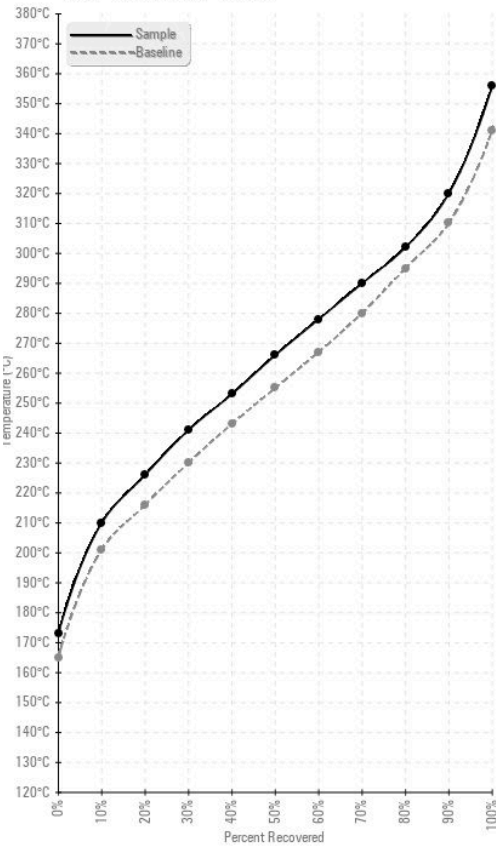

Pensky-Martens Flash Point (°C)

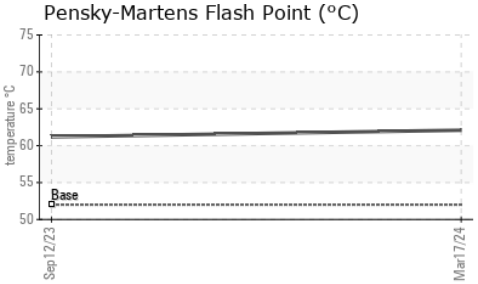

GCD Spectrum

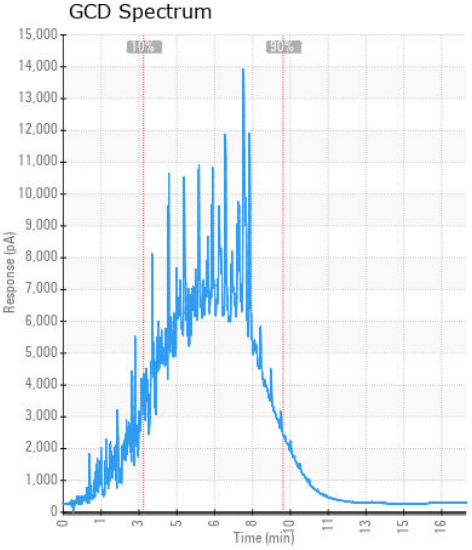

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CU0022871
Lab Number : 02622883
Unique Number : 5748002
Test Package : FUEL (Additional Tests: CC Flash, GC-PercFuel, PrtCount)

Received : 18 Mar 2024
Tested : 20 Mar 2024
Diagnosed : 20 Mar 2024 - Kevin Marson

ISO 17025:2017 Accredited Laboratory

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

CUMMINS CANADA ULC - GENERATOR DIVISION
7175 PACIFIC CIRCLE
MISSISSAUGA, ON
CA L5T 2A5
Contact: Zaneef Abboobakar
zaneef.abboobakar@cummins.com
T:
F: (905)795-0035